


Plan Name	Tygun
Date	3/7/2019
Location	Lone Oak Estates Lot 119 Battle Ground, WA

Total SqFt = 1,615

# Elevations

Scale: 1/4" = 1'


This plan is property of:

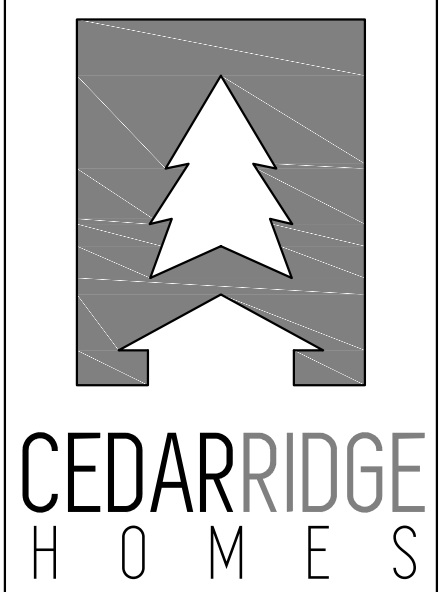


© 2019 Cedar Ridge Homes  
(P) 503-666-4240  
(F) 503-666-2408  
www.cedarridgehomes.us

Designed by:  
TYSON GREY  
tyson@cedarridgehomes.us


1

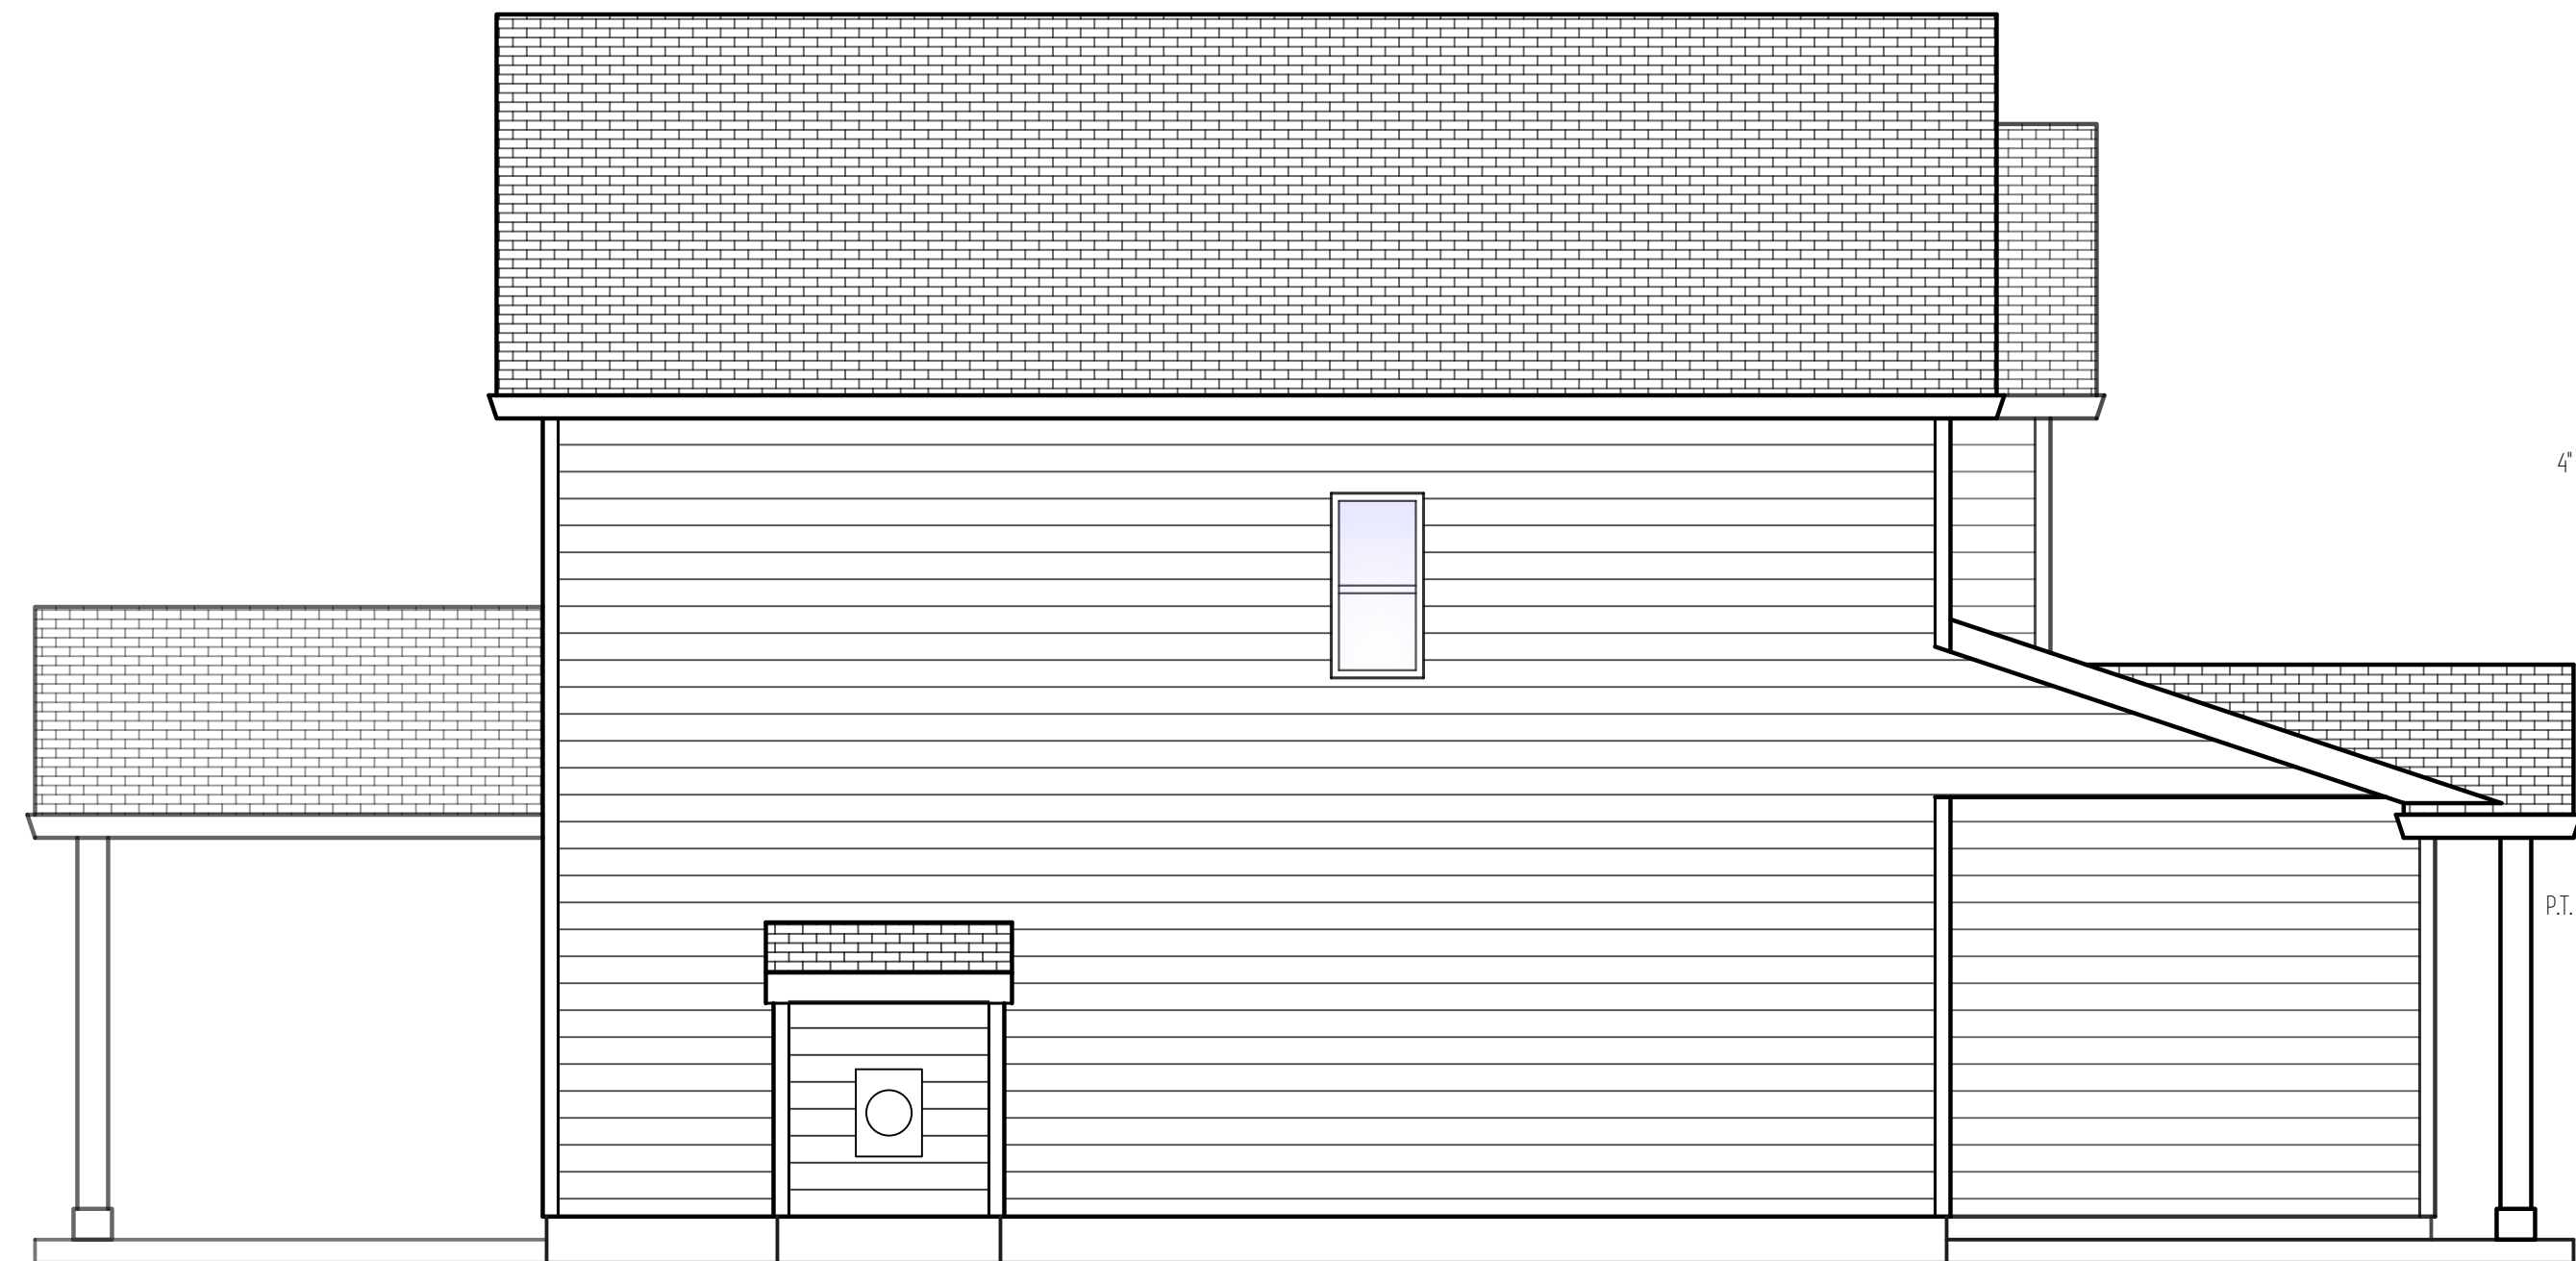

Left Elevation

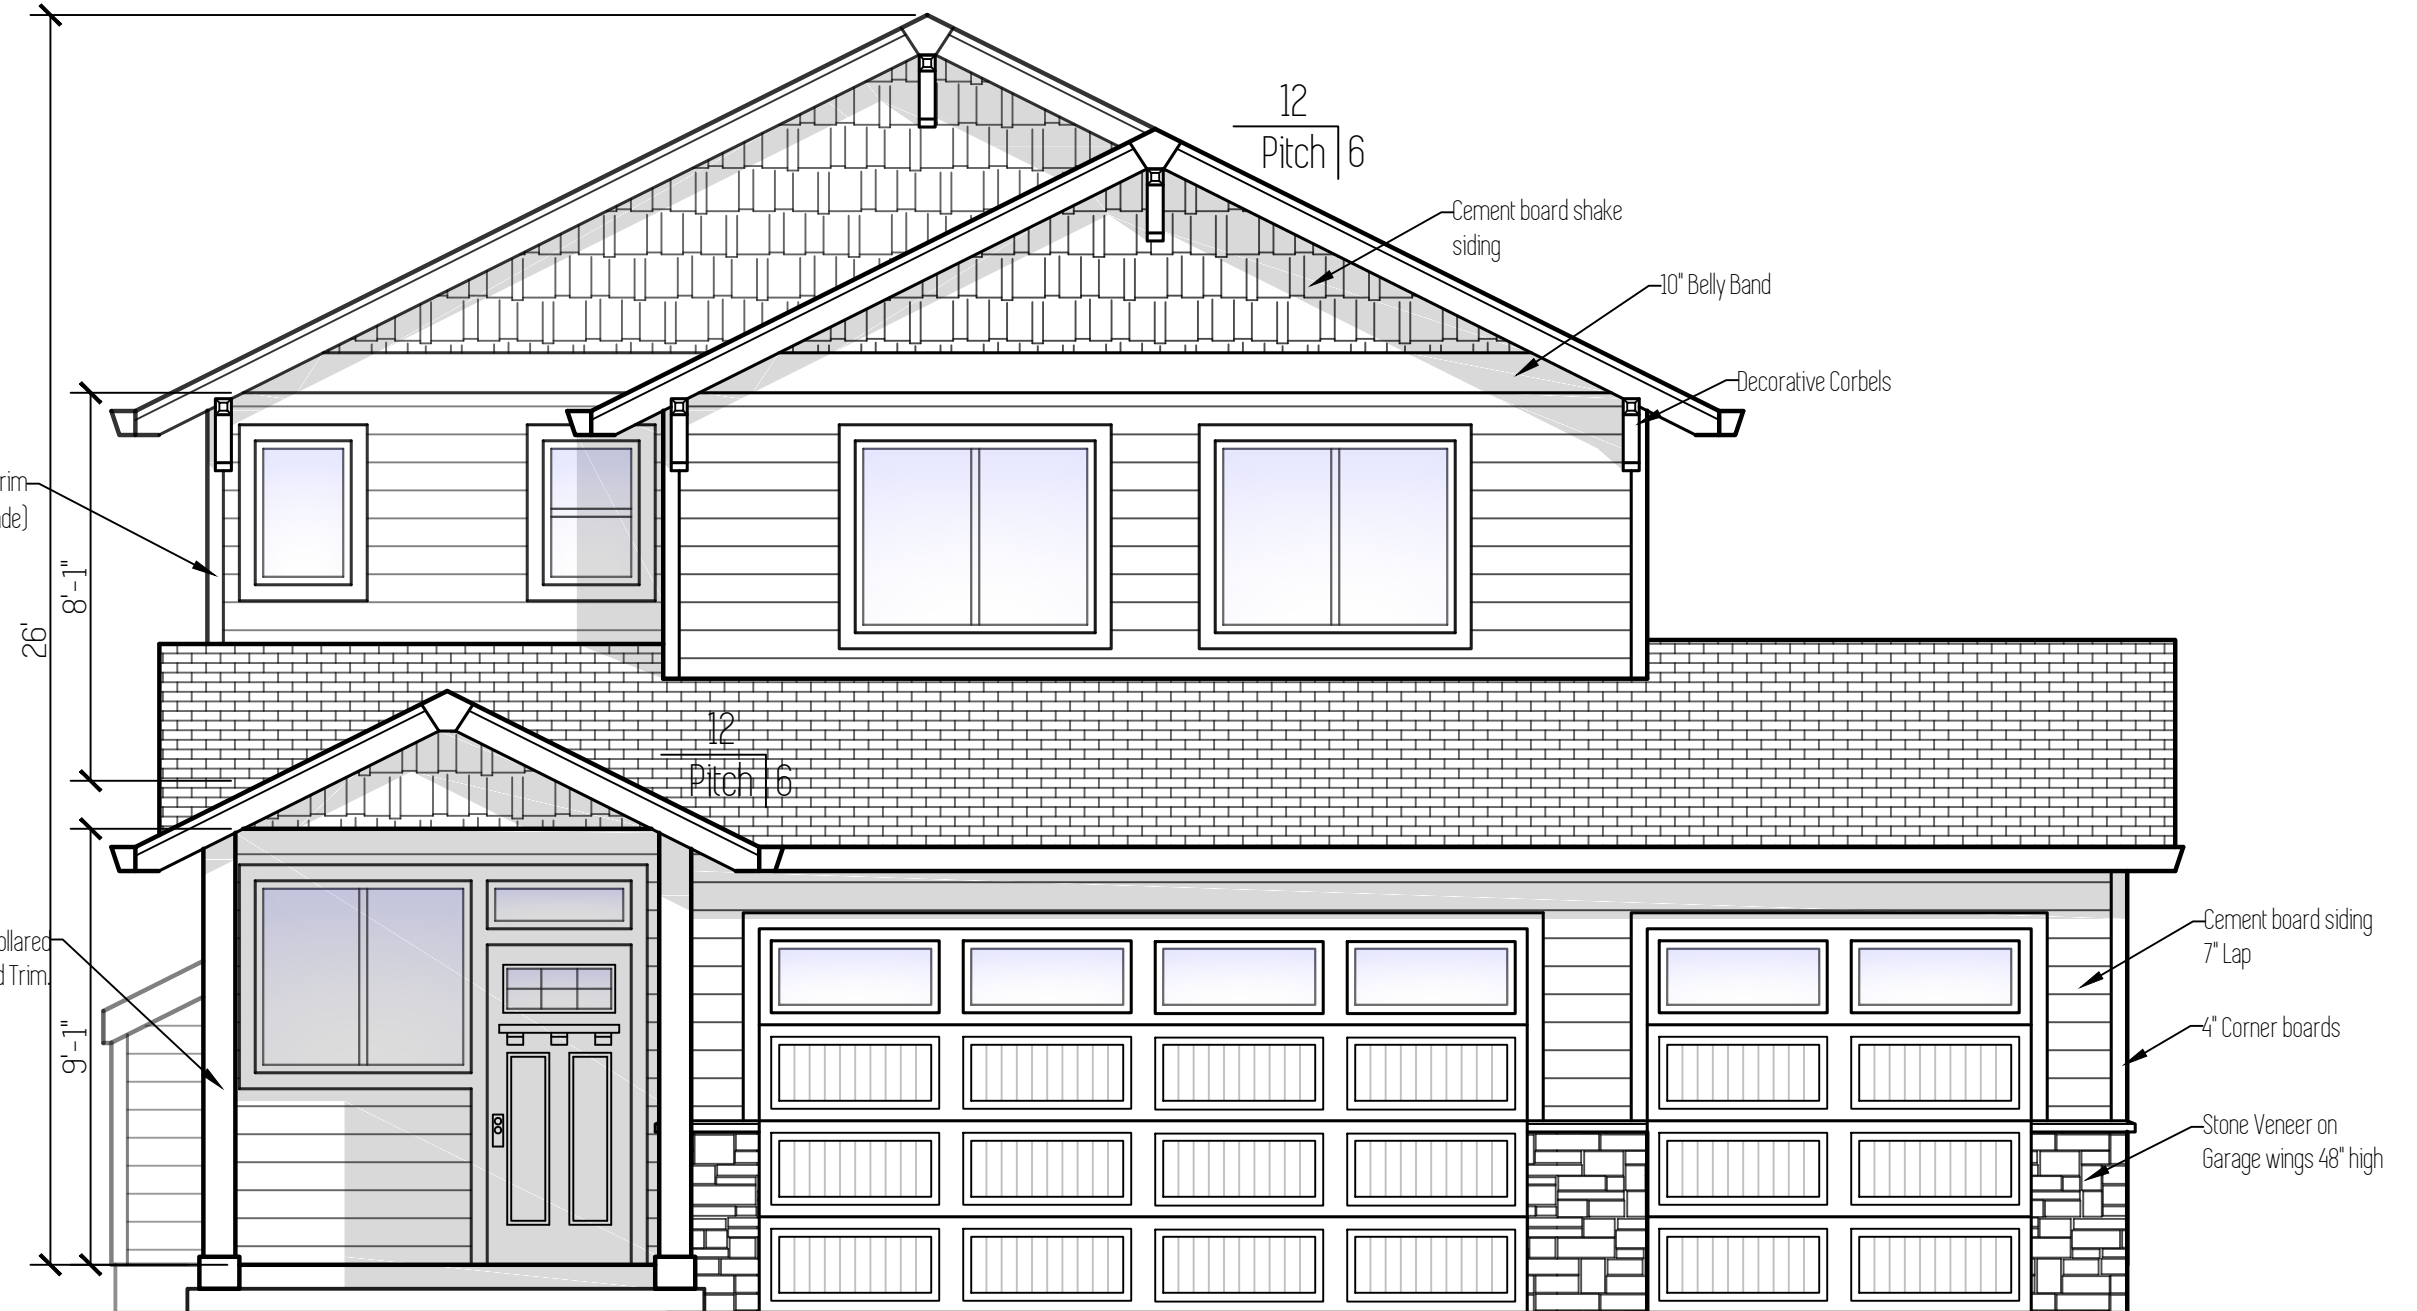

Front Elevation

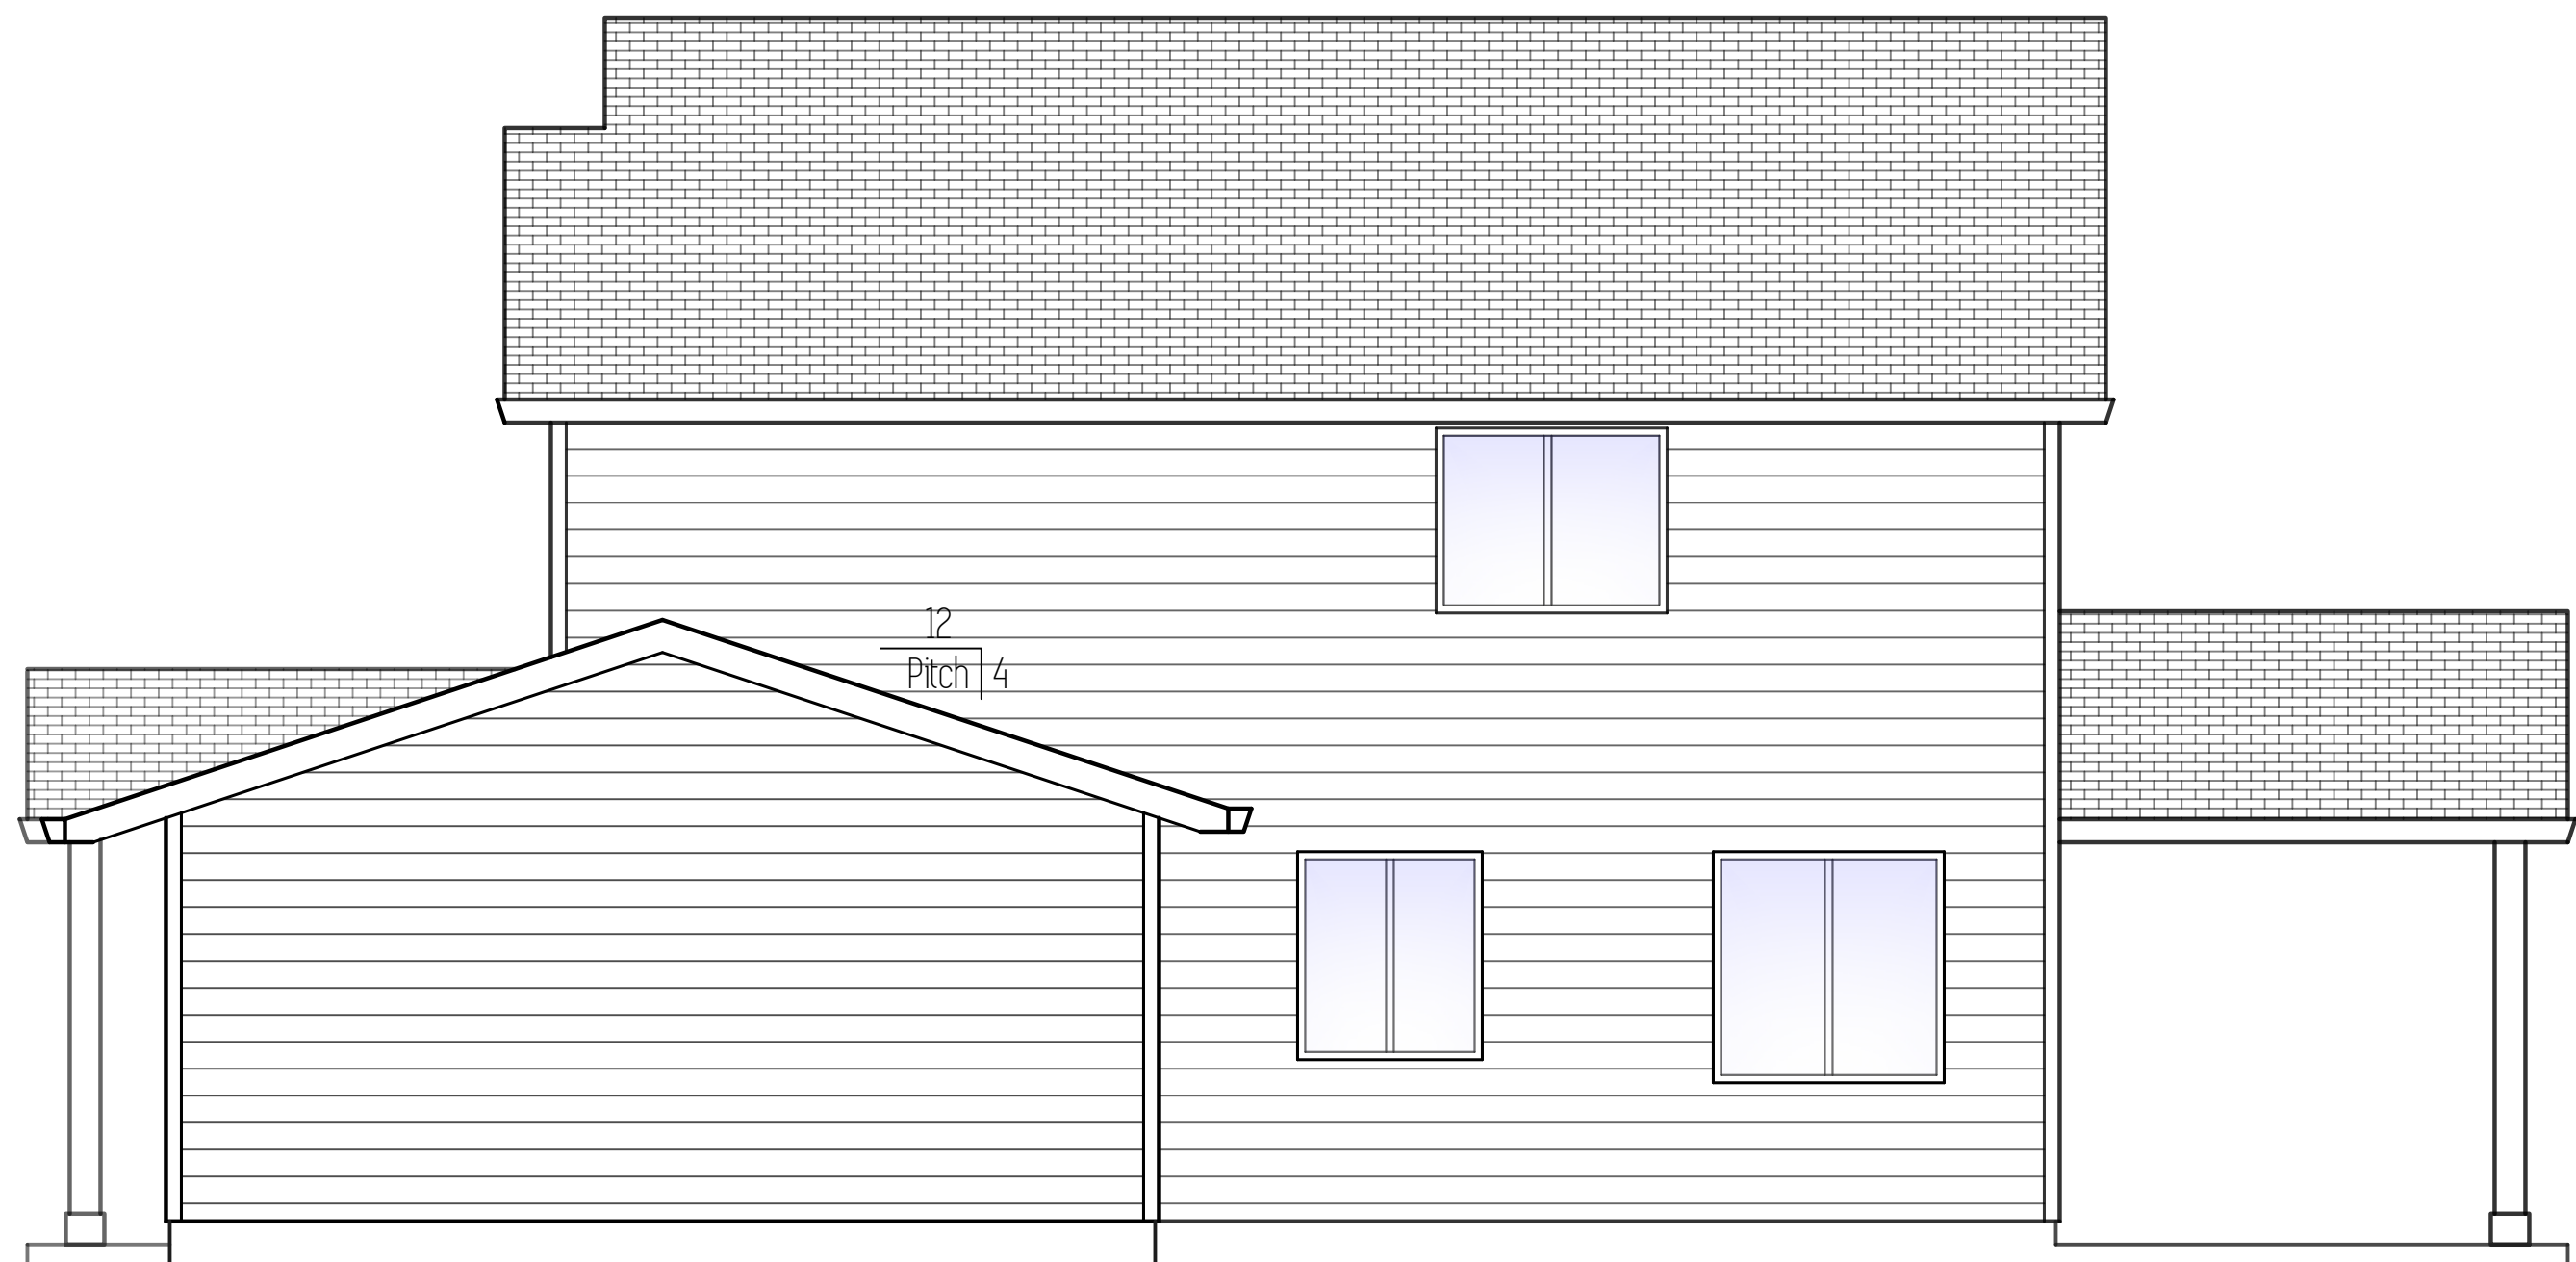

Right Elevation



Back Elevation

4" Window and Door Trim  
(Street facing facade)

P.T. 6x6: Wrapped & collared  
with cement board Trim

12  
Pitch 6

Cement board shake  
siding

10" Belly Band

Decorative Corbels

Cement board siding  
7" Lap

4" Corner boards

Stone Veneer on  
Garage wings 48" high


Plan Name	Tygun
Date	3/7/2019
Location	Lone Oak Estates Lot 119 Battle Ground, WA

Total SqFt = 1,615

# Floor Plan

Scale: 1/4" = 1'

This plan is property of:

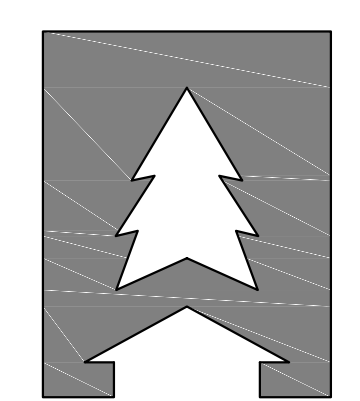


**CEDARRIDGE  
H O M E S**

© 2019 Cedar Ridge Homes

(P) 503-666-4240  
(F) 503-666-2408  
www.cedarridgehomes.us

Designed by:  
**TYSON GREY**  
tyson@cedarridgehomes.us


2

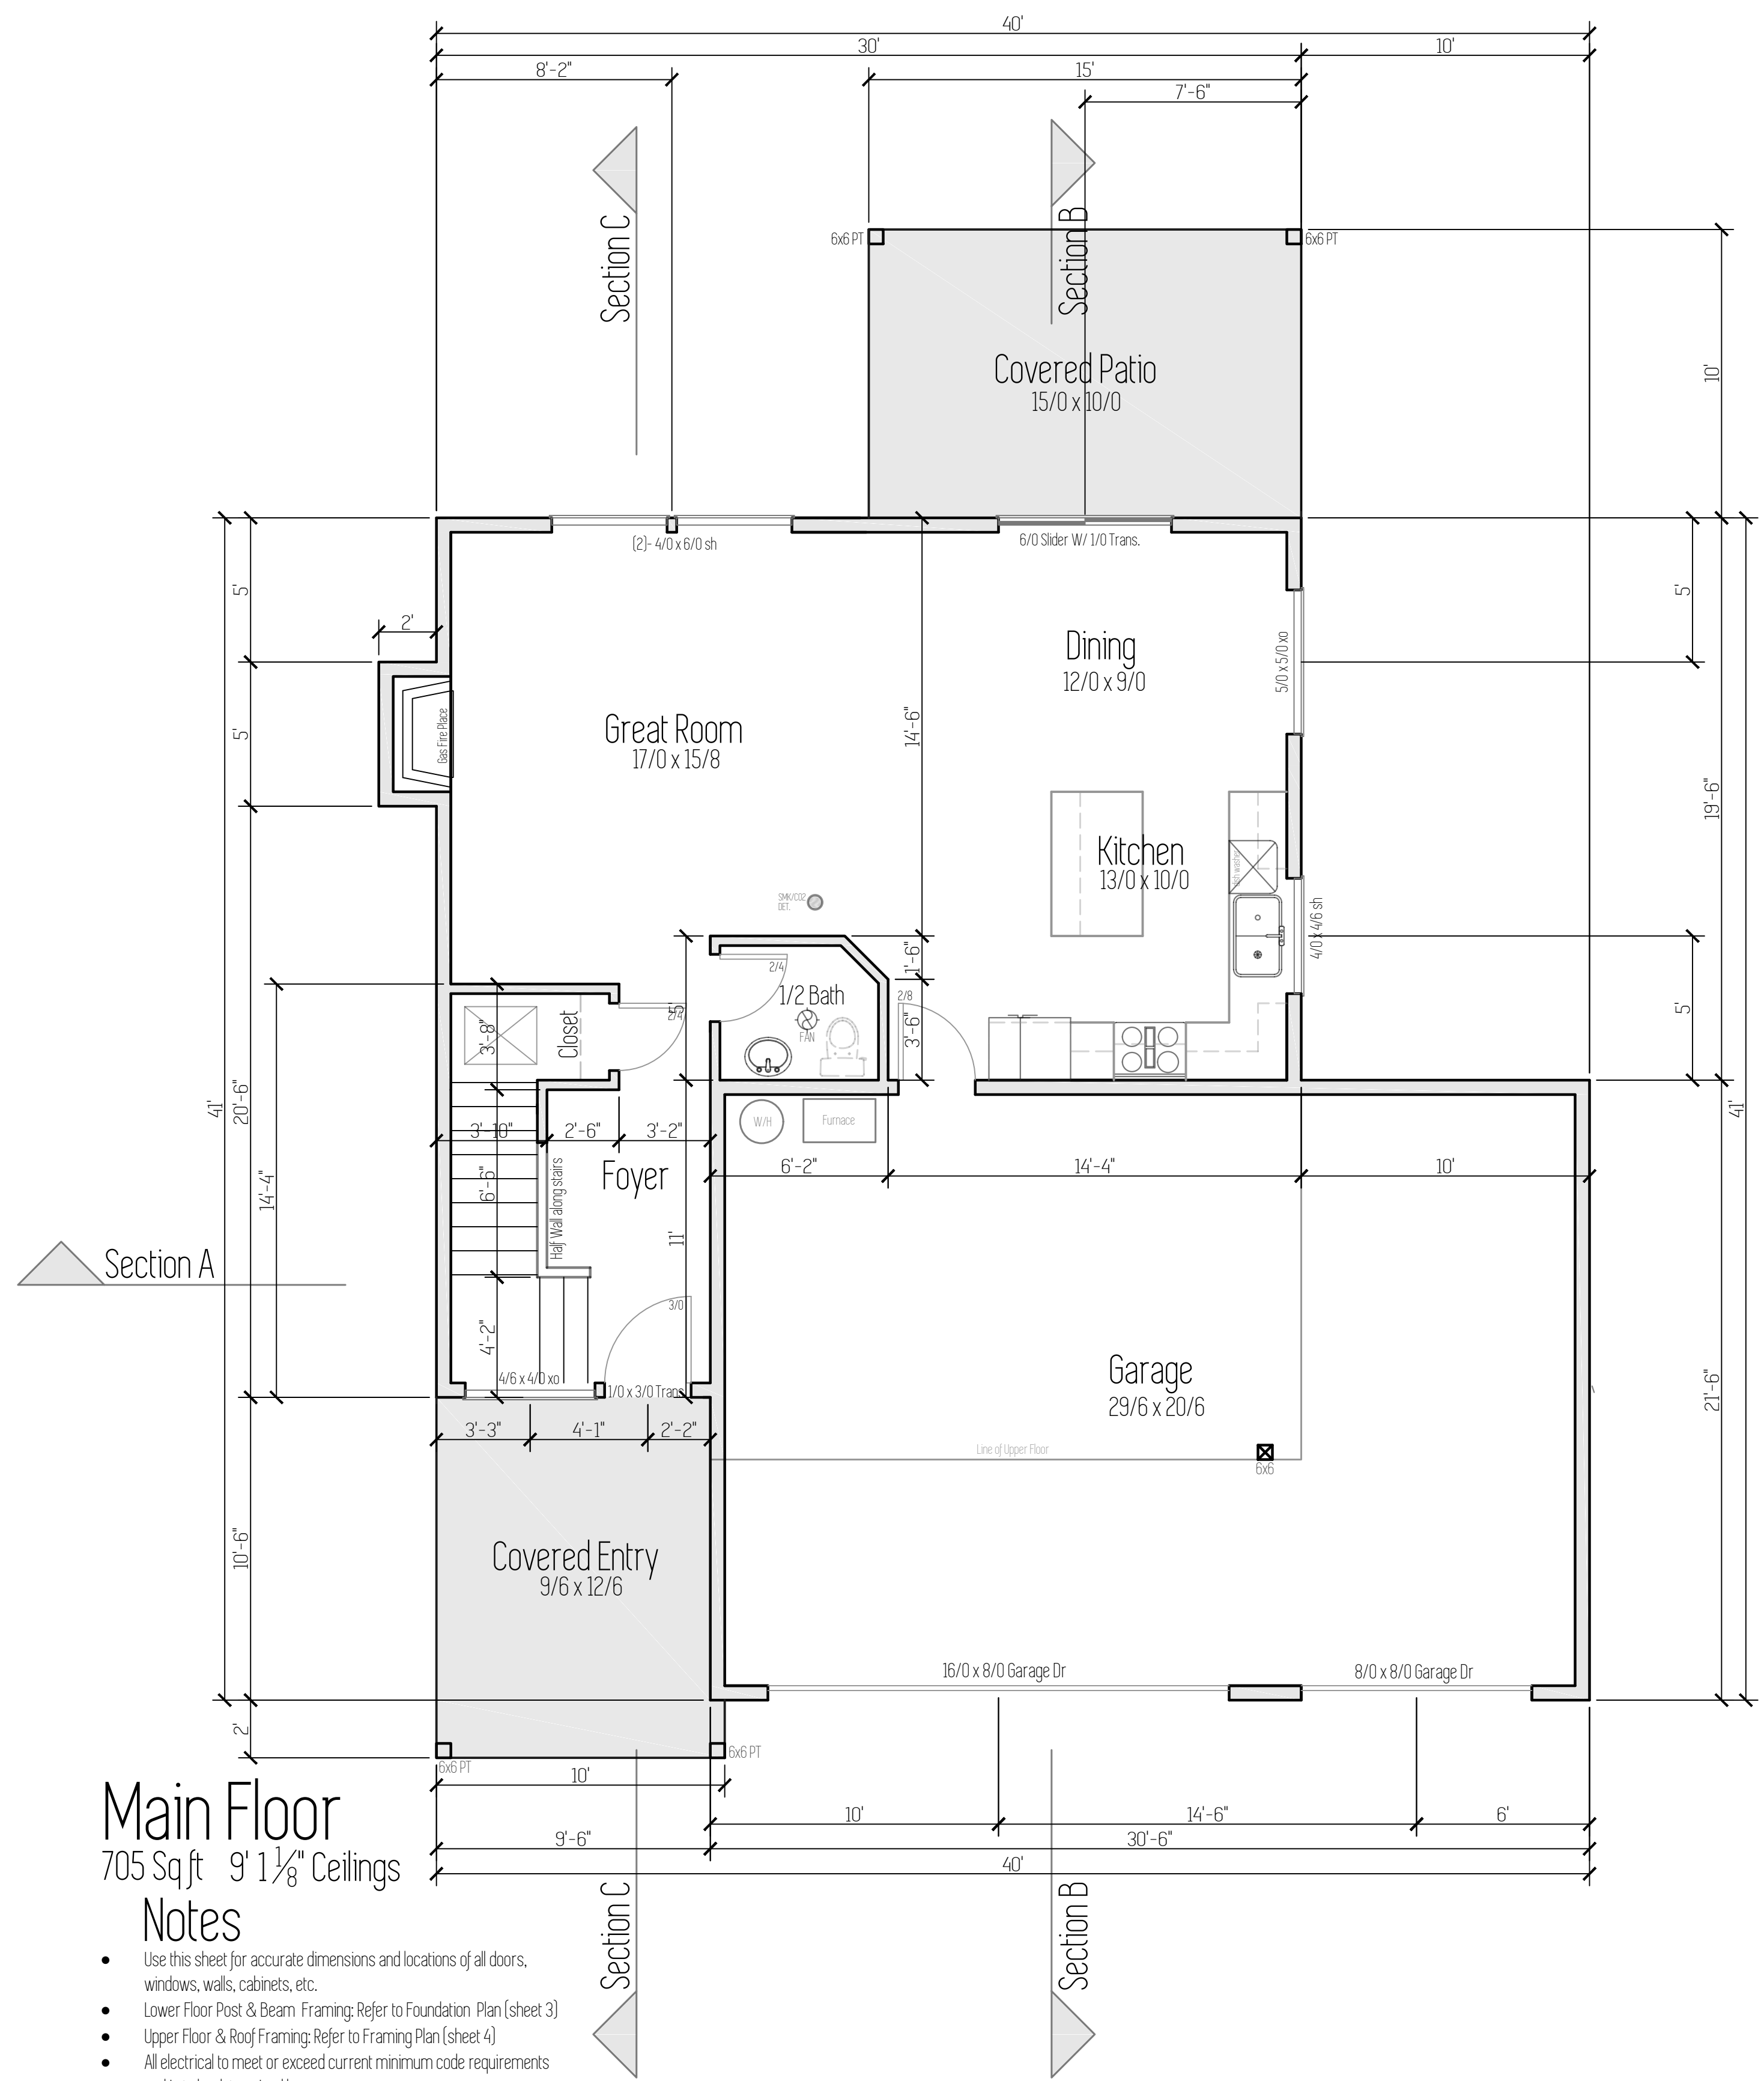


**Upper Floor**  
910 Sqft 8' 1 1/8" Ceilings

**Notes**

- Use this sheet for accurate dimensions and locations of all doors, windows, walls, cabinets, etc.
- Lower Floor Post & Beam Framing: Refer to Foundation Plan (sheet 3)
- Upper Floor & Roof Framing: Refer to Framing Plan (sheet 4)
- All electrical to meet or exceed current minimum code requirements and is to be determined by owner.
- All fans shall have a mechanical ventilation system designed to exhaust a minimum of 80 cfm intermittent or 20 cfm continuous. Mechanical ventilation control systems shall be connected to a dehumidistat, timer or similar automatic control

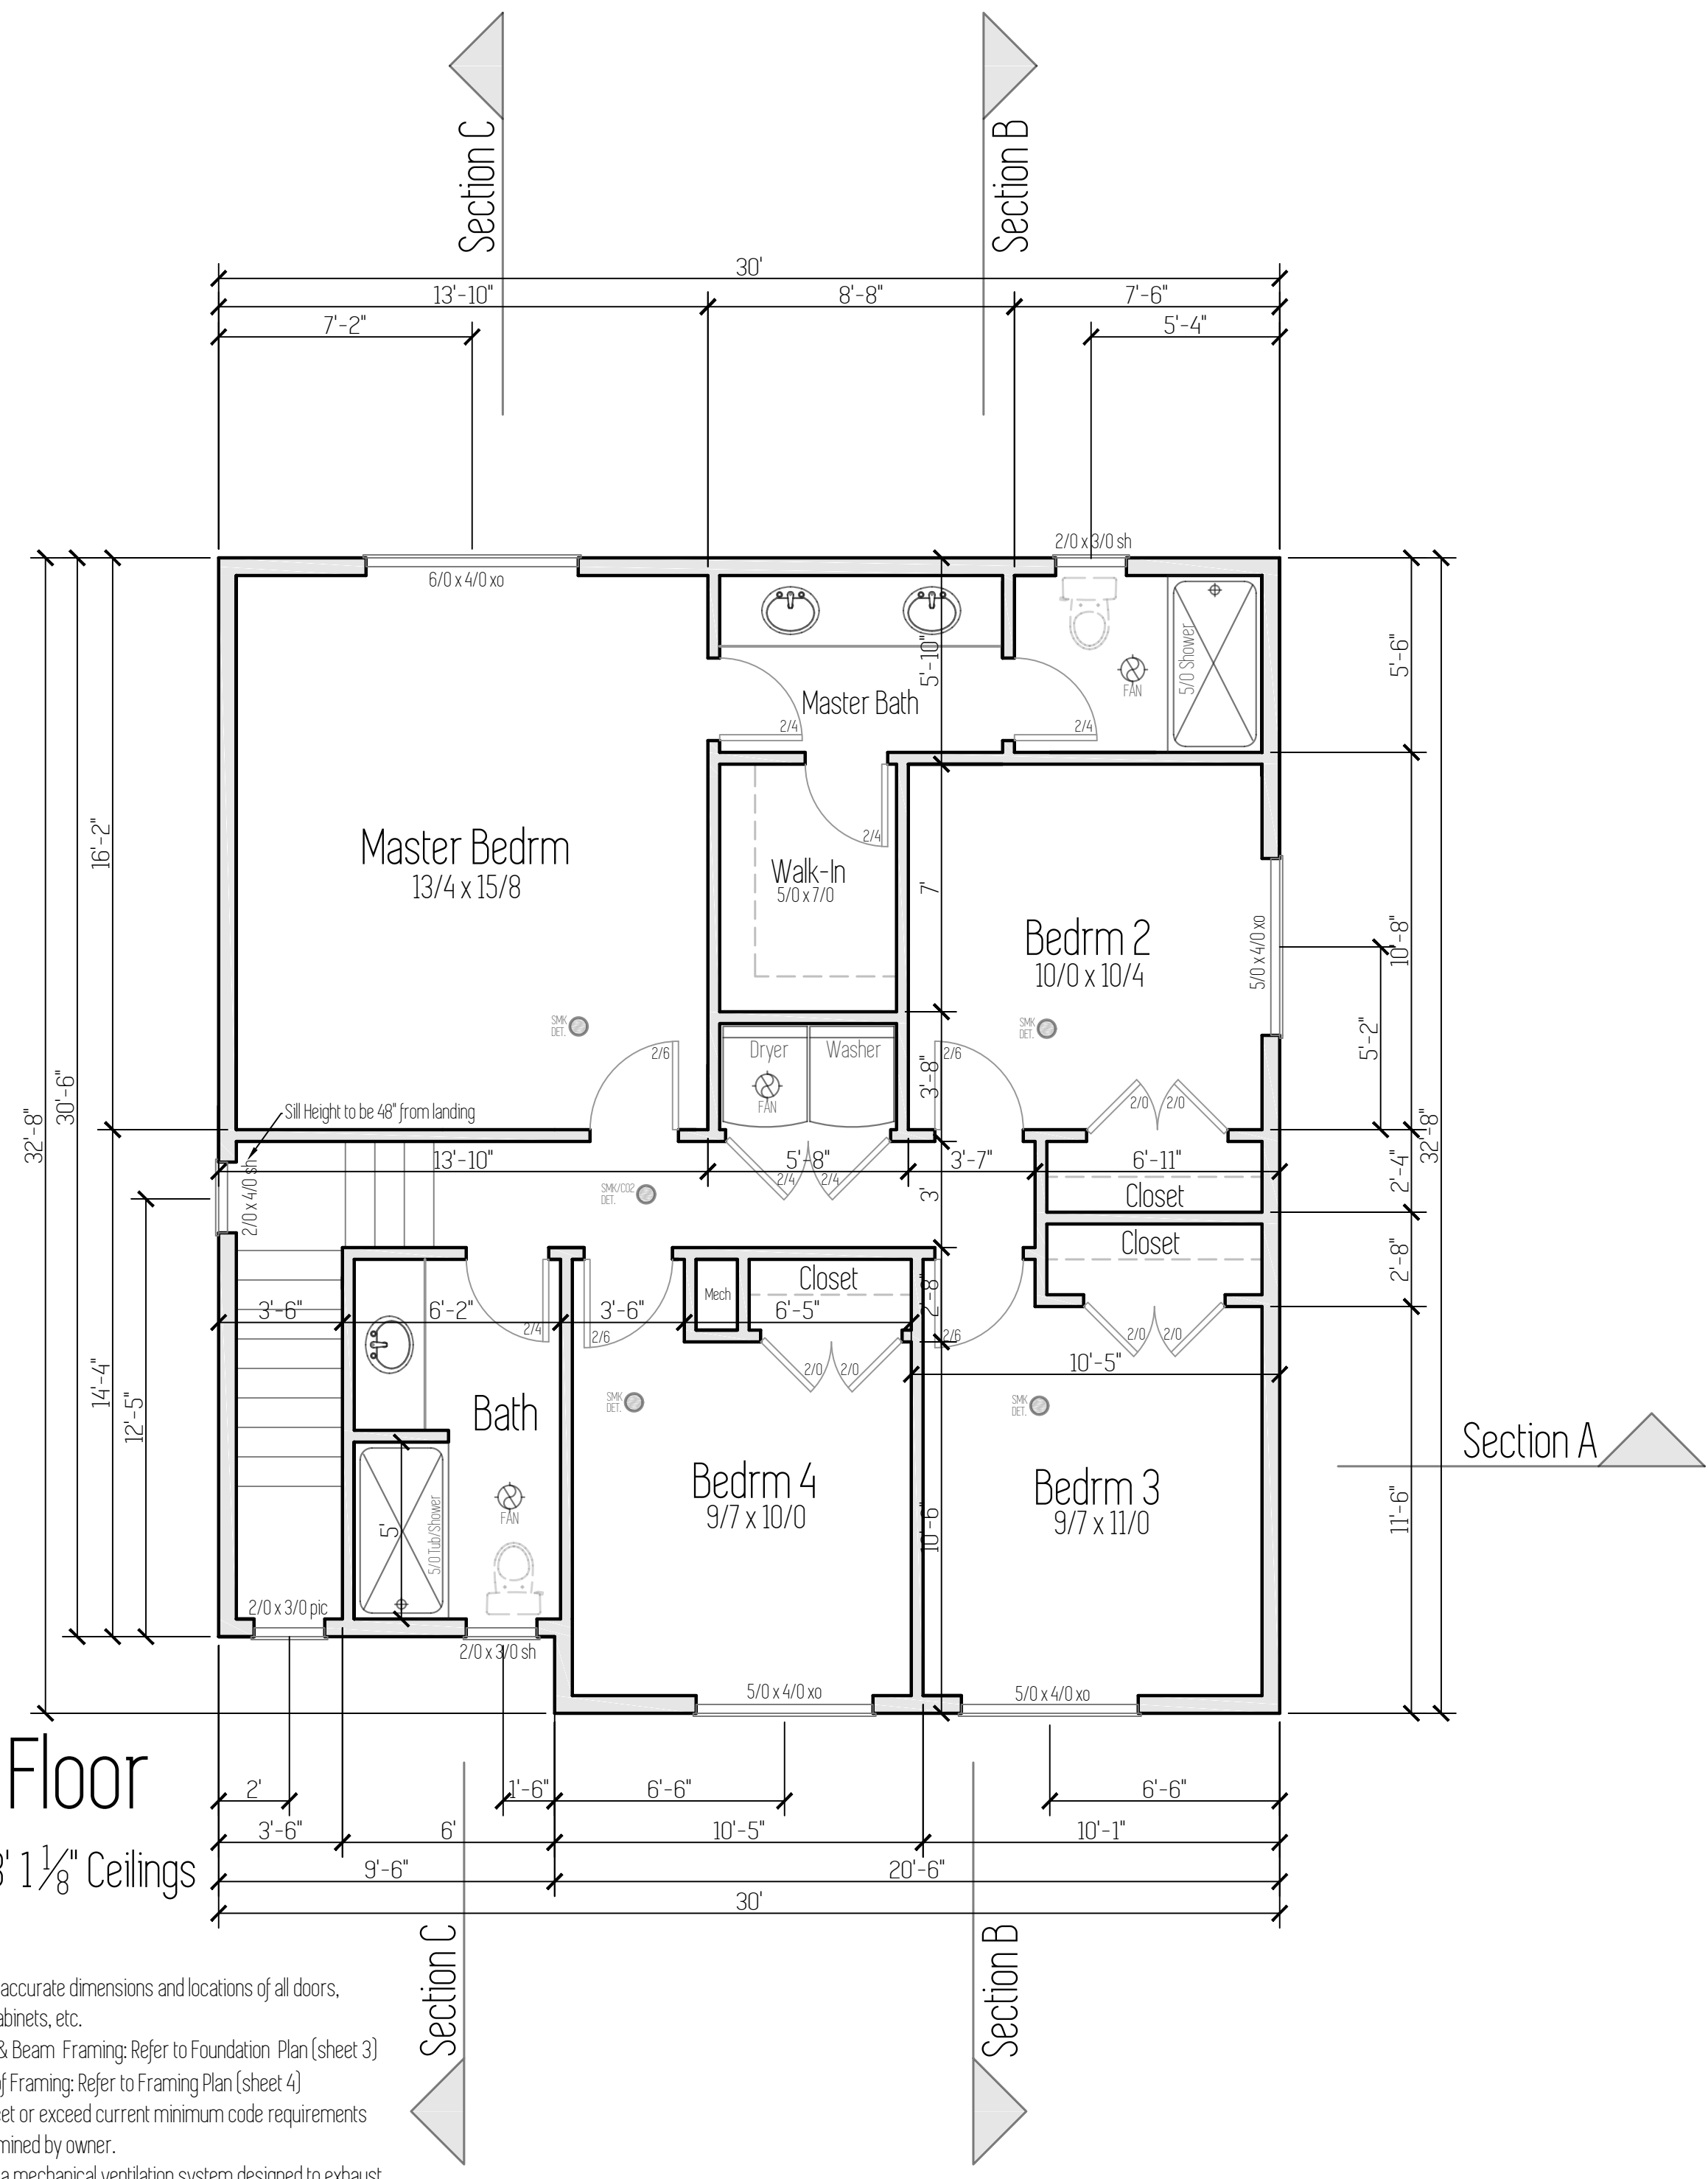


This plan is property of:

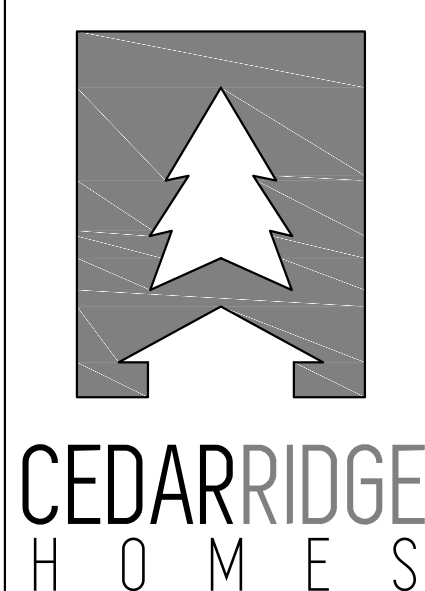


© 2019 Cedar Ridge Homes  
(P) 503-666-4240  
(F) 503-666-2408  
www.cedarridgehomes.us


Designed by:  
**TYSON GREY**  
tyson@cedarridgehomes.us

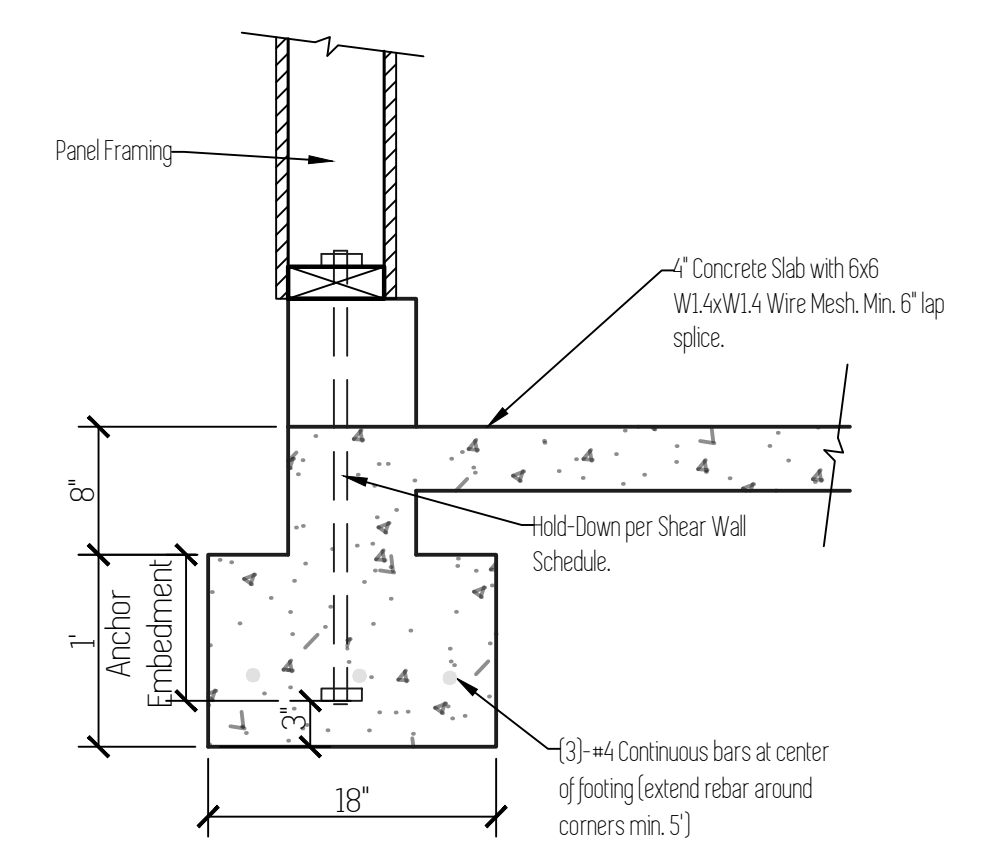

**1**  
S1.2  
**Footing Section** Scale: 1"=1'  
Note:  
1. Footing to be place on undisturbed, native soil.  
2. Refer to Shear Wall Schedule for sill bolt spacing at shear wall locations.  
3. Driveway surface not shown.

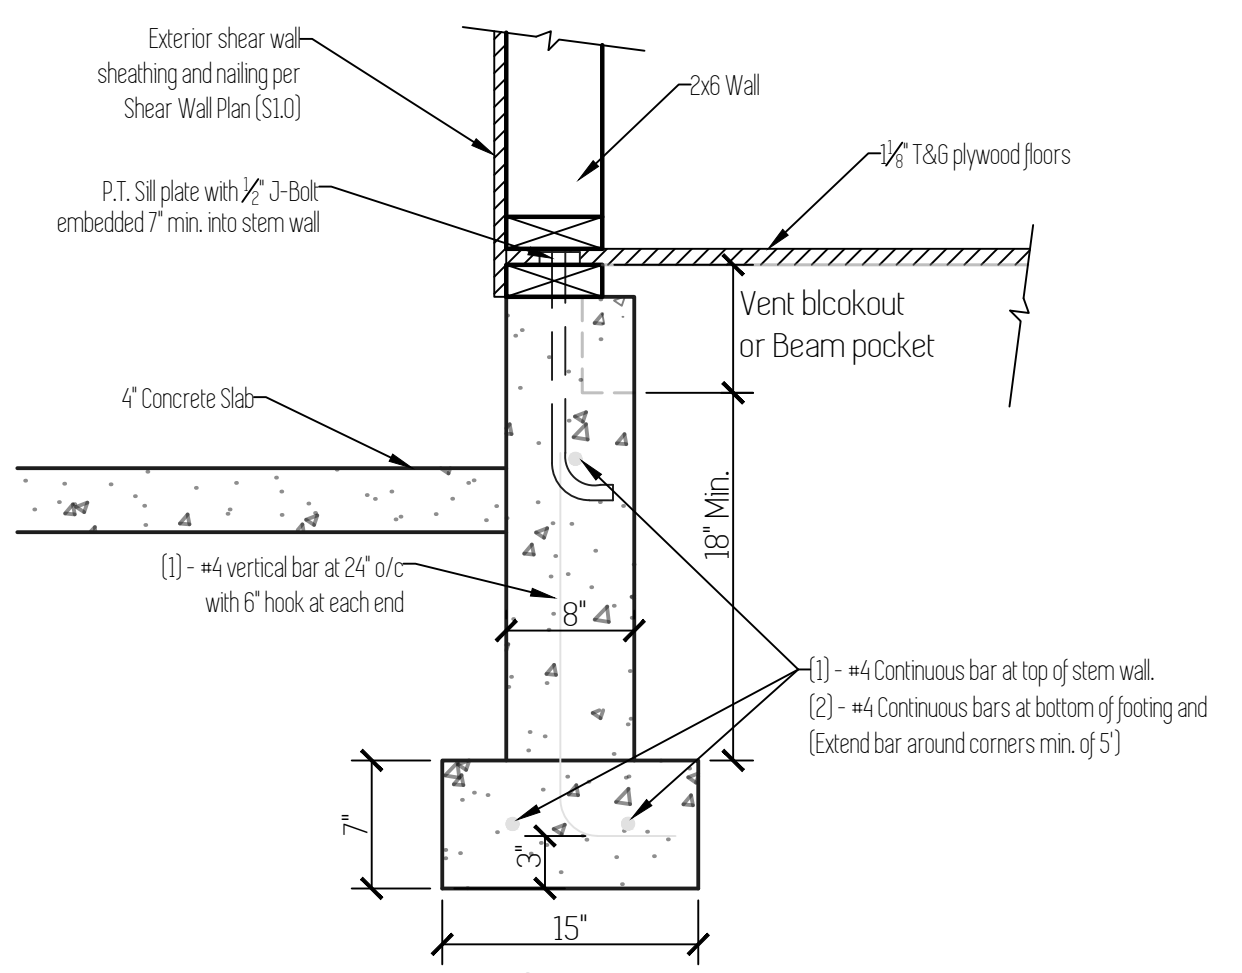

**2**  
S1.2  
**Footing Section** Scale: 1"=1'  
Note:  
1. Footing to be place on undisturbed, native soil.  
2. Refer to Shear Wall Schedule for sill bolt spacing at shear wall locations.

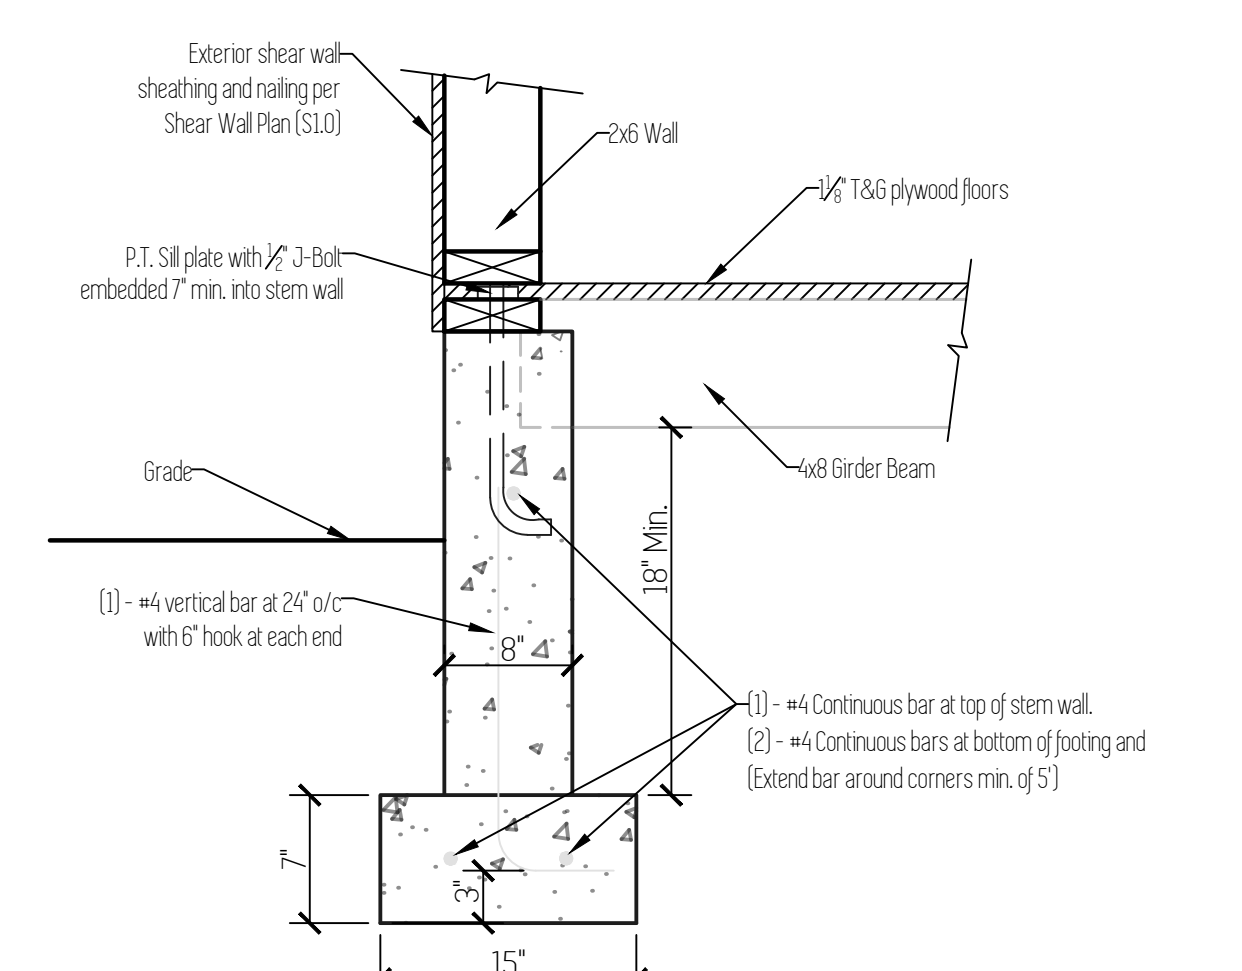

**3**  
S1.2  
**Footing Section** Scale: 1"=1'  
Note:  
1. Footing to be place on undisturbed, native soil.  
2. Refer to Shear Wall Schedule for sill bolt spacing at shear wall locations.

## Foundation Notes



- Concrete : Minimum 28 day concrete strength = 2500 psi.
- Grade beams, piers and spread footings shall be poured onto undisturbed, native soil which is free from any material that will adversely affect the soil bearing pressure.
- Footings are to be on undisturbed soil with an assumed 1500 PSF
- All slabs to be supported with a min. of 4" of compacted crushed rock fill.
- Beam pockets in concrete walls to have a min. 2" air space on sides, and min. 3" of bearing for all beams and girders.
- Typical pier pad to be 18" dia. x 8" concrete footing with 4x4 DF=2 post.
- Typical crawl space beam to be 4x8 DF=2. Single gusset plate to be used on both sides of attachment to post.
- Cover entire crawl space with 6 mil black visqueen vapor barrier.
- Excavate a min. of 18" below bottom of all beams.
- Install 15" x 7" closable FND vents in FND walls. Min 1 sq ft vented area for every 150 sq ft of crawl space.
- Refer to Shear Wall Schedule and Hold-Down Schedule for sill bolt spacing and hold-down size. (PAGE S1.0)

- ▨ Shear Wall Panel
- ▨ Interior Bearing Wall (above)
- HoldDown

Footing Schedule	
F1	24" x 24" x 8" Concrete footing with (2) #4 bars each way.
F3	30" x 30" x 8" Concrete footing with (3) #4 bars each way.
F5	36" x 36" x 8" Concrete footing with (3) #4 bars each way.

## Radon Passive System

**AF103.5.1.3 Vent Pipe**  
A plumbing tee or other approved connection shall be inserted horizontally beneath the sheathing and connected to a 3- or 4-inch-dia. fitting with a vertical vent pipe installed through the sheathing. The vent pipe shall be extended up through the building floors, terminate at least 12" above roof in a location at least 10' away from any window or other opening into the conditioned spaces of the building that is less than 2' below the exhaust point, and 10' from any window or other opening adjoining or adjacent buildings.

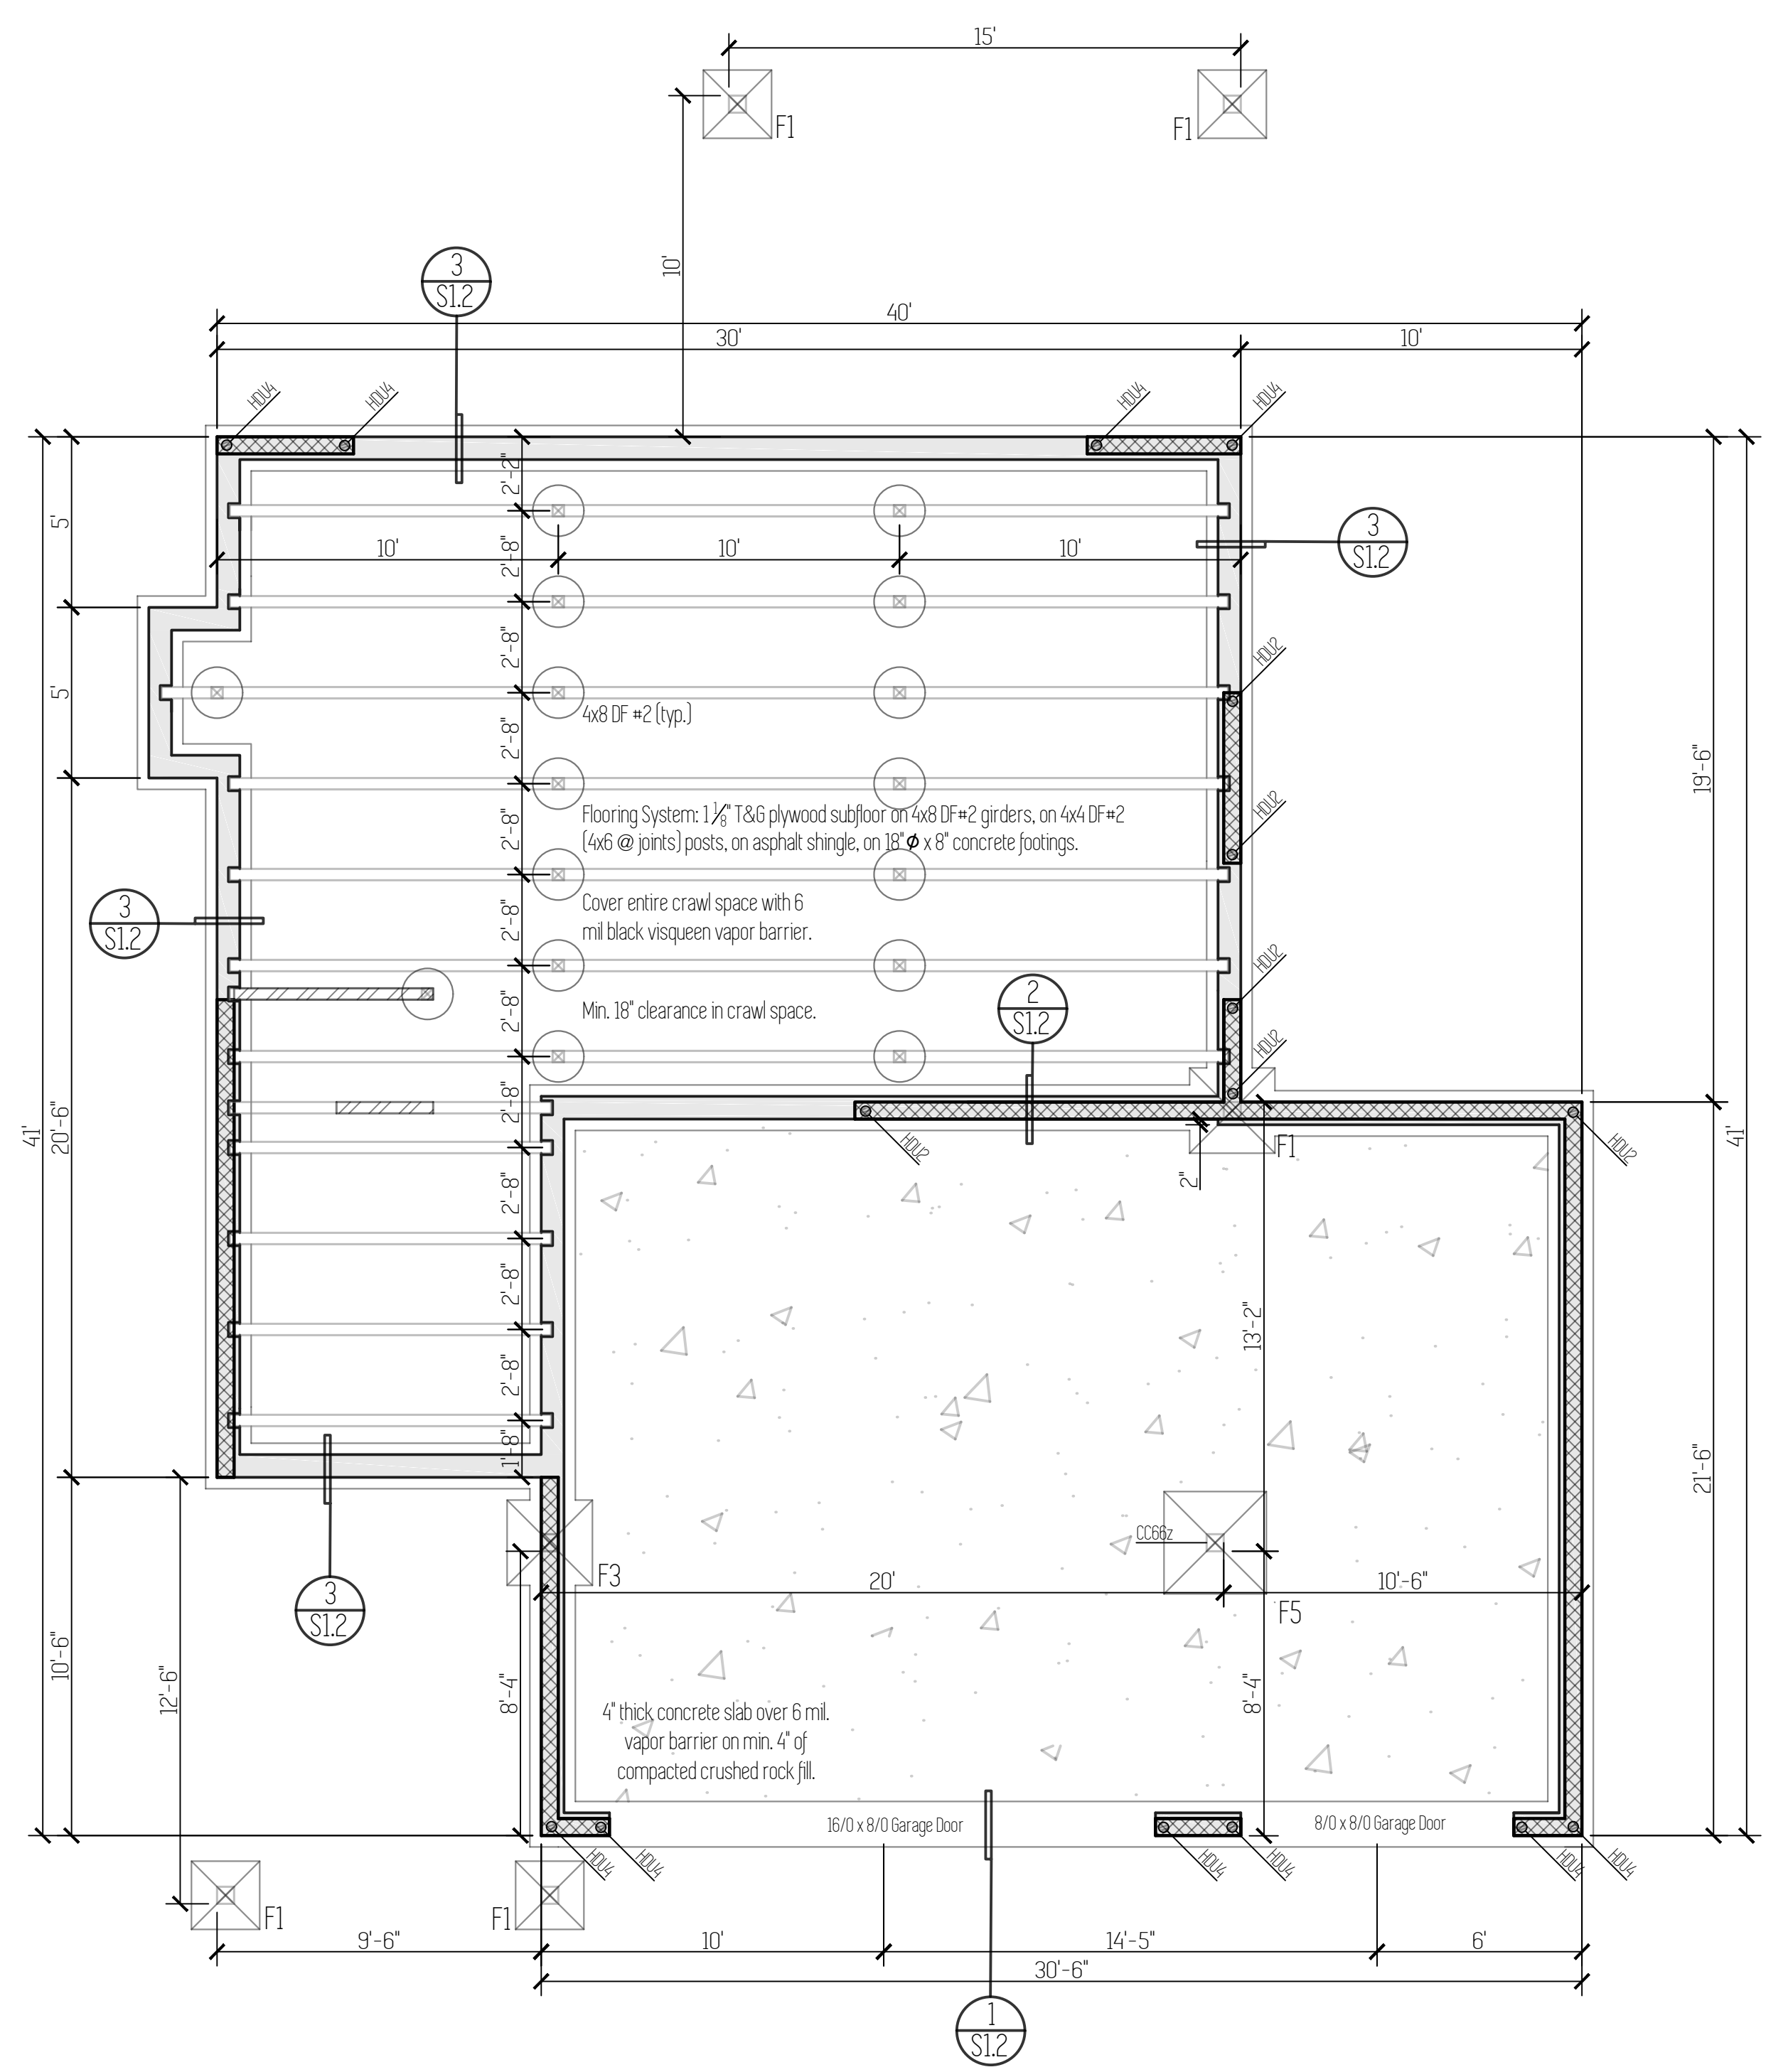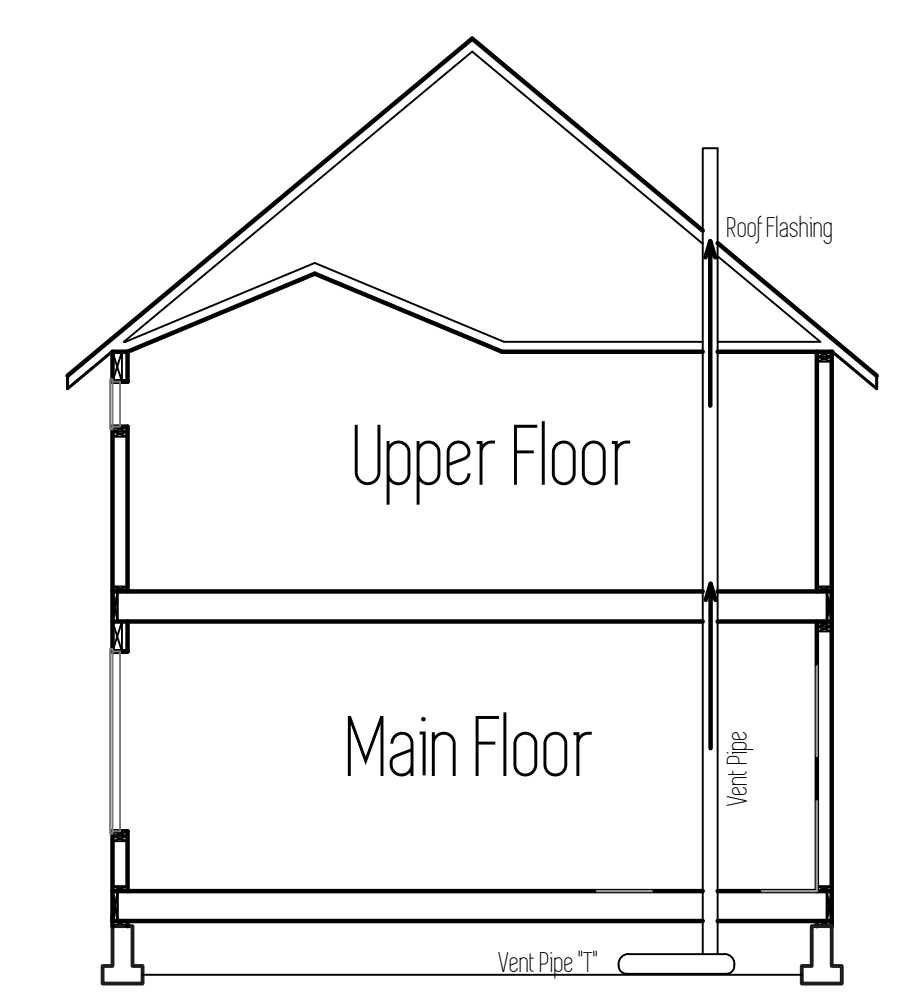


Plan Name	Tygun
Date	3/7/2019
Location	Lone Oak Estates Lot 119 Battle Ground, WA

# Framing Plan

Total SqFt = 1,615  
Scale: 1/4" = 1'

This plan is property of:

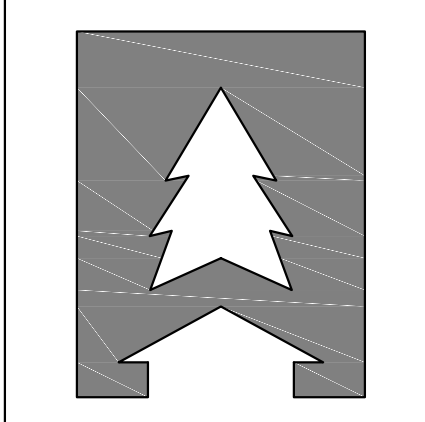

**CEDARRIDGE  
HOMES**


© 2019 Cedar Ridge Homes

(P) 503-666-4240  
(F) 503-666-2408  
www.cedarridgehomes.us

Designed by:

**TYSON GREY**  
tyson@cedarridgehomes.us


# 4

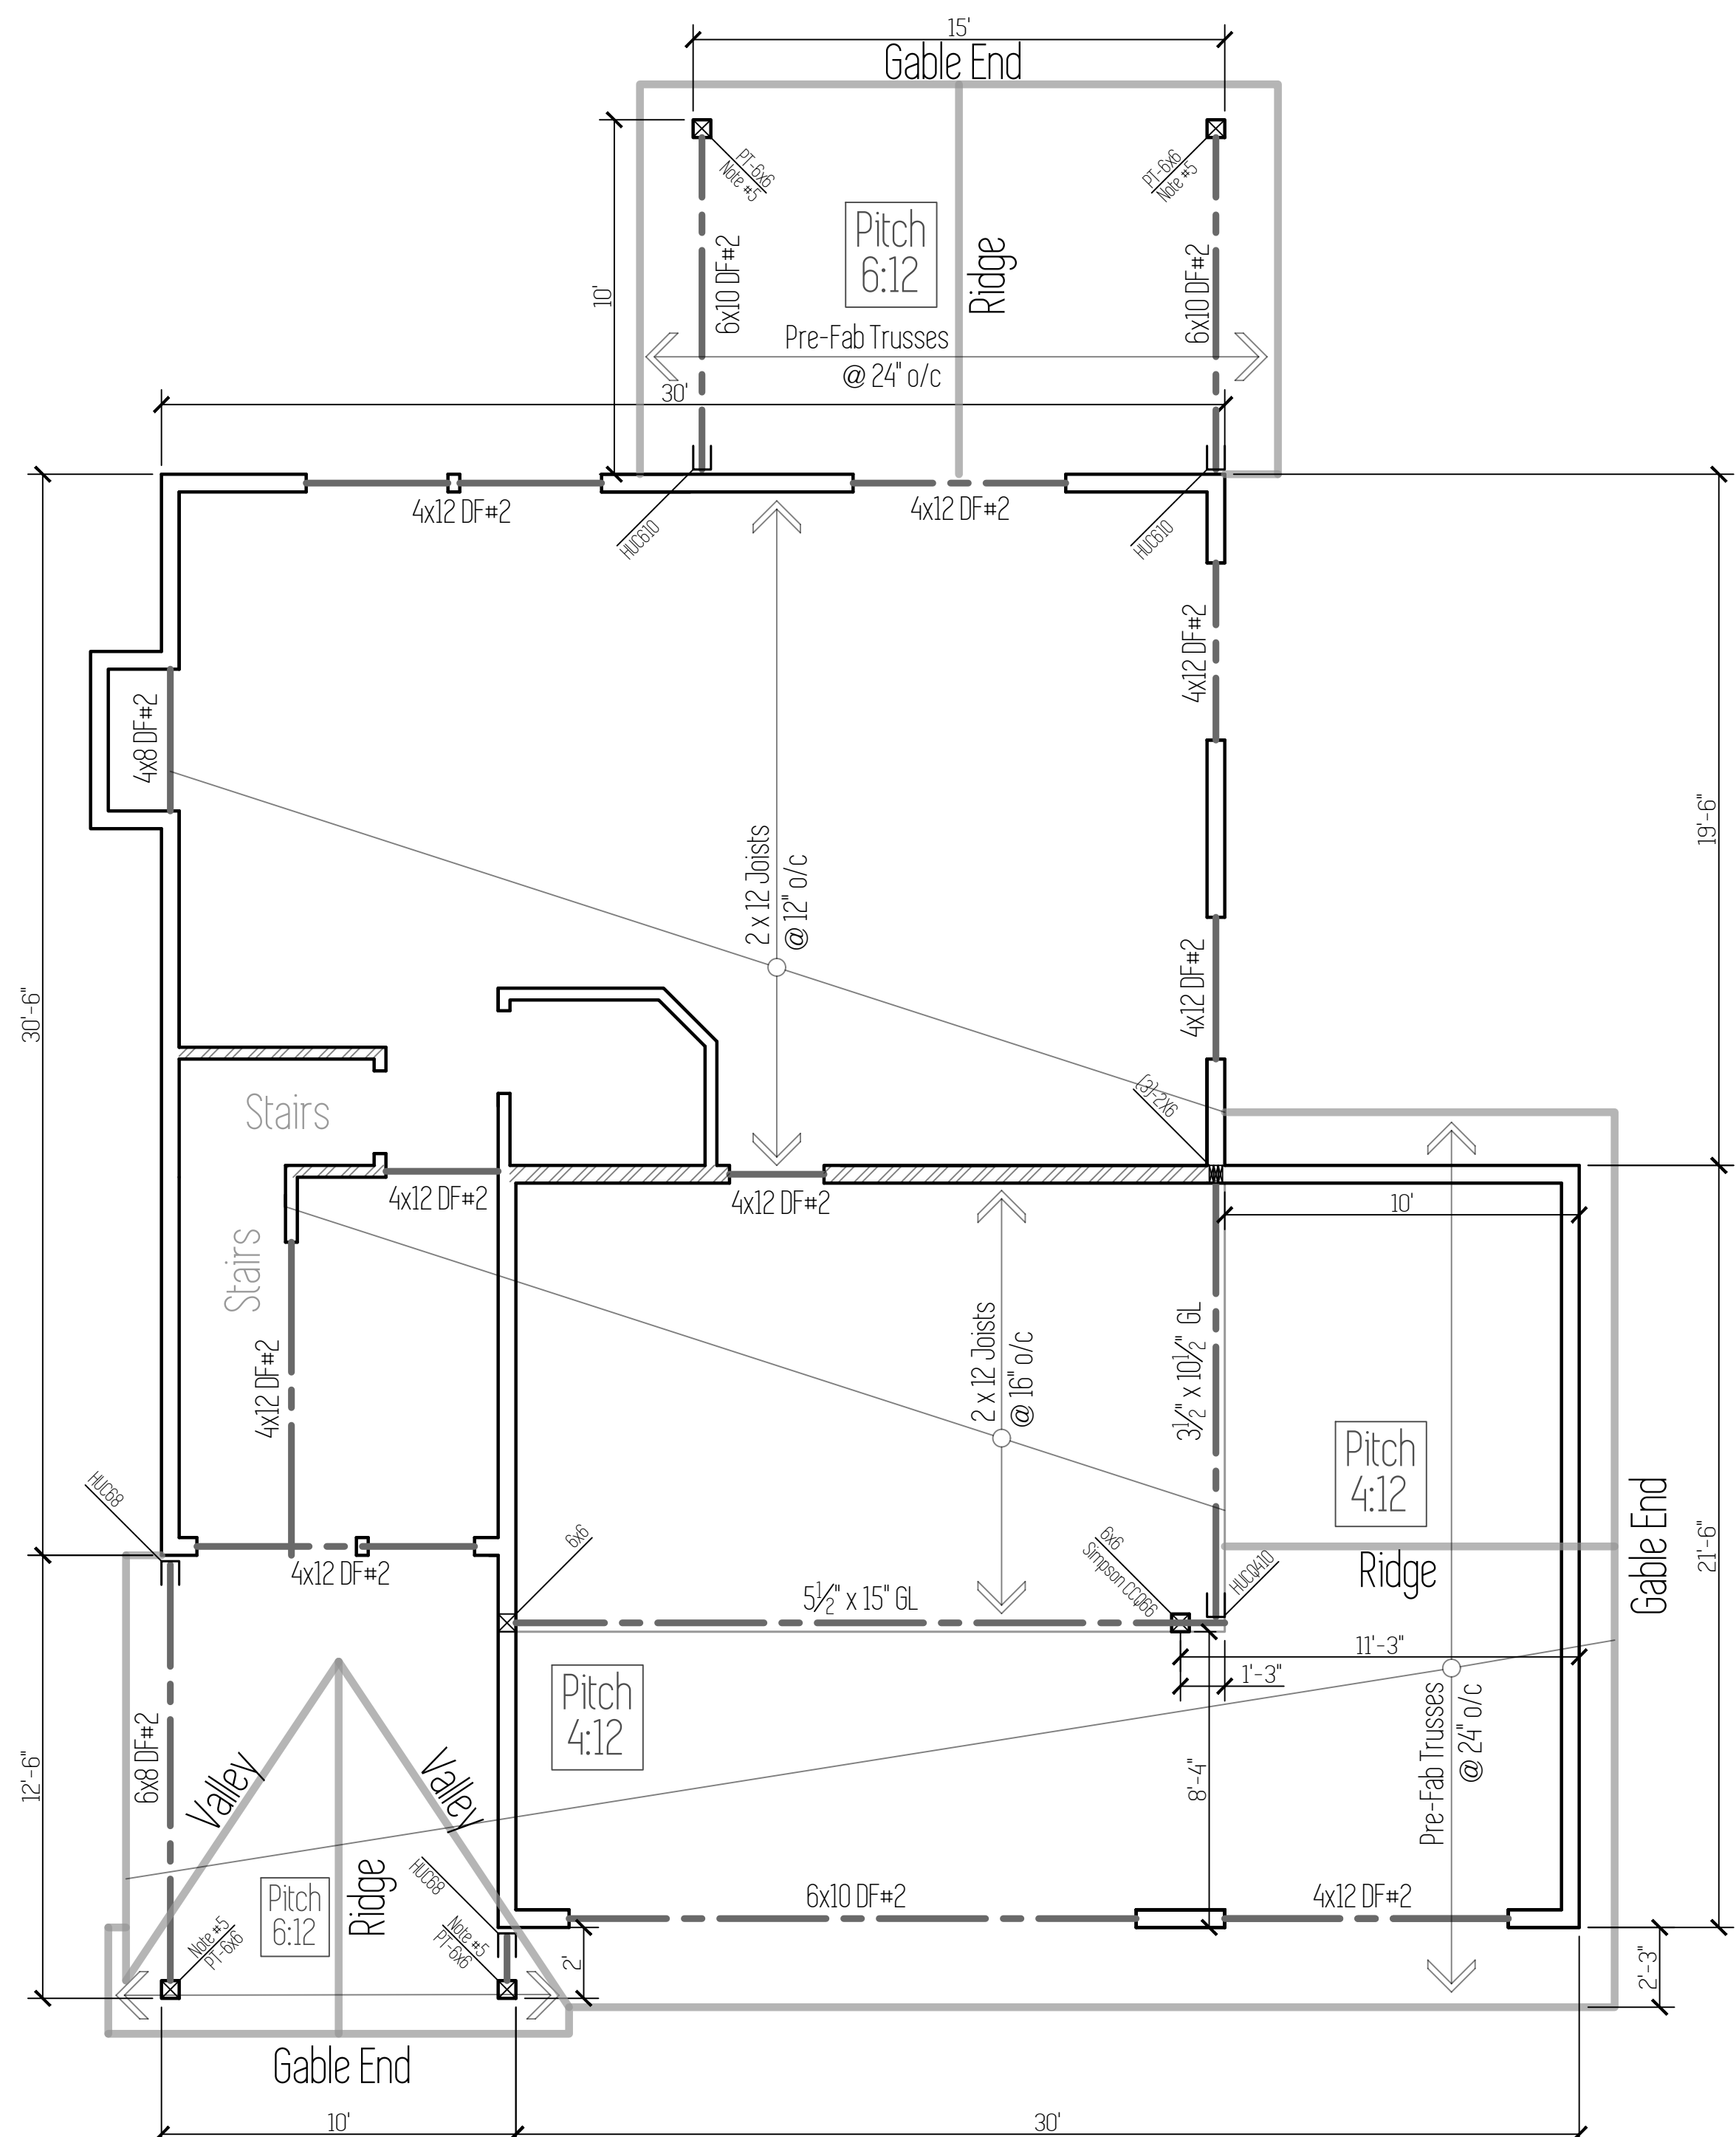

### Upper Floor & Lower Roof Framing Plan

1. Refer to sheet S1.0 for details on Shear Panels and Strapping.
2. Exterior Headers to be 4x8 DF#2 (max. span 5') U.N.O.
3. Interior Headers to be 4x8 DF#2 (max. span 4') U.N.O.
4. Typical exterior wall post to be (2)-2x6 DF#2 (bundled stud), fasten each stud together w/16d nails @ 12" o/c, typ. entire length of stud, u.n.o. Typical interior wall post to be (2)-2x4 DF#2 (bundled stud), fasten each stud together w/16d nails @ 12" o/c, typ. entire length of stud, u.n.o.
5. Exterior post caps to be Simpson "PC" or "EPC", if exposed condition coat per manufacture's specs with exterior exposed and P.T. material.

Interior Bearing Wall

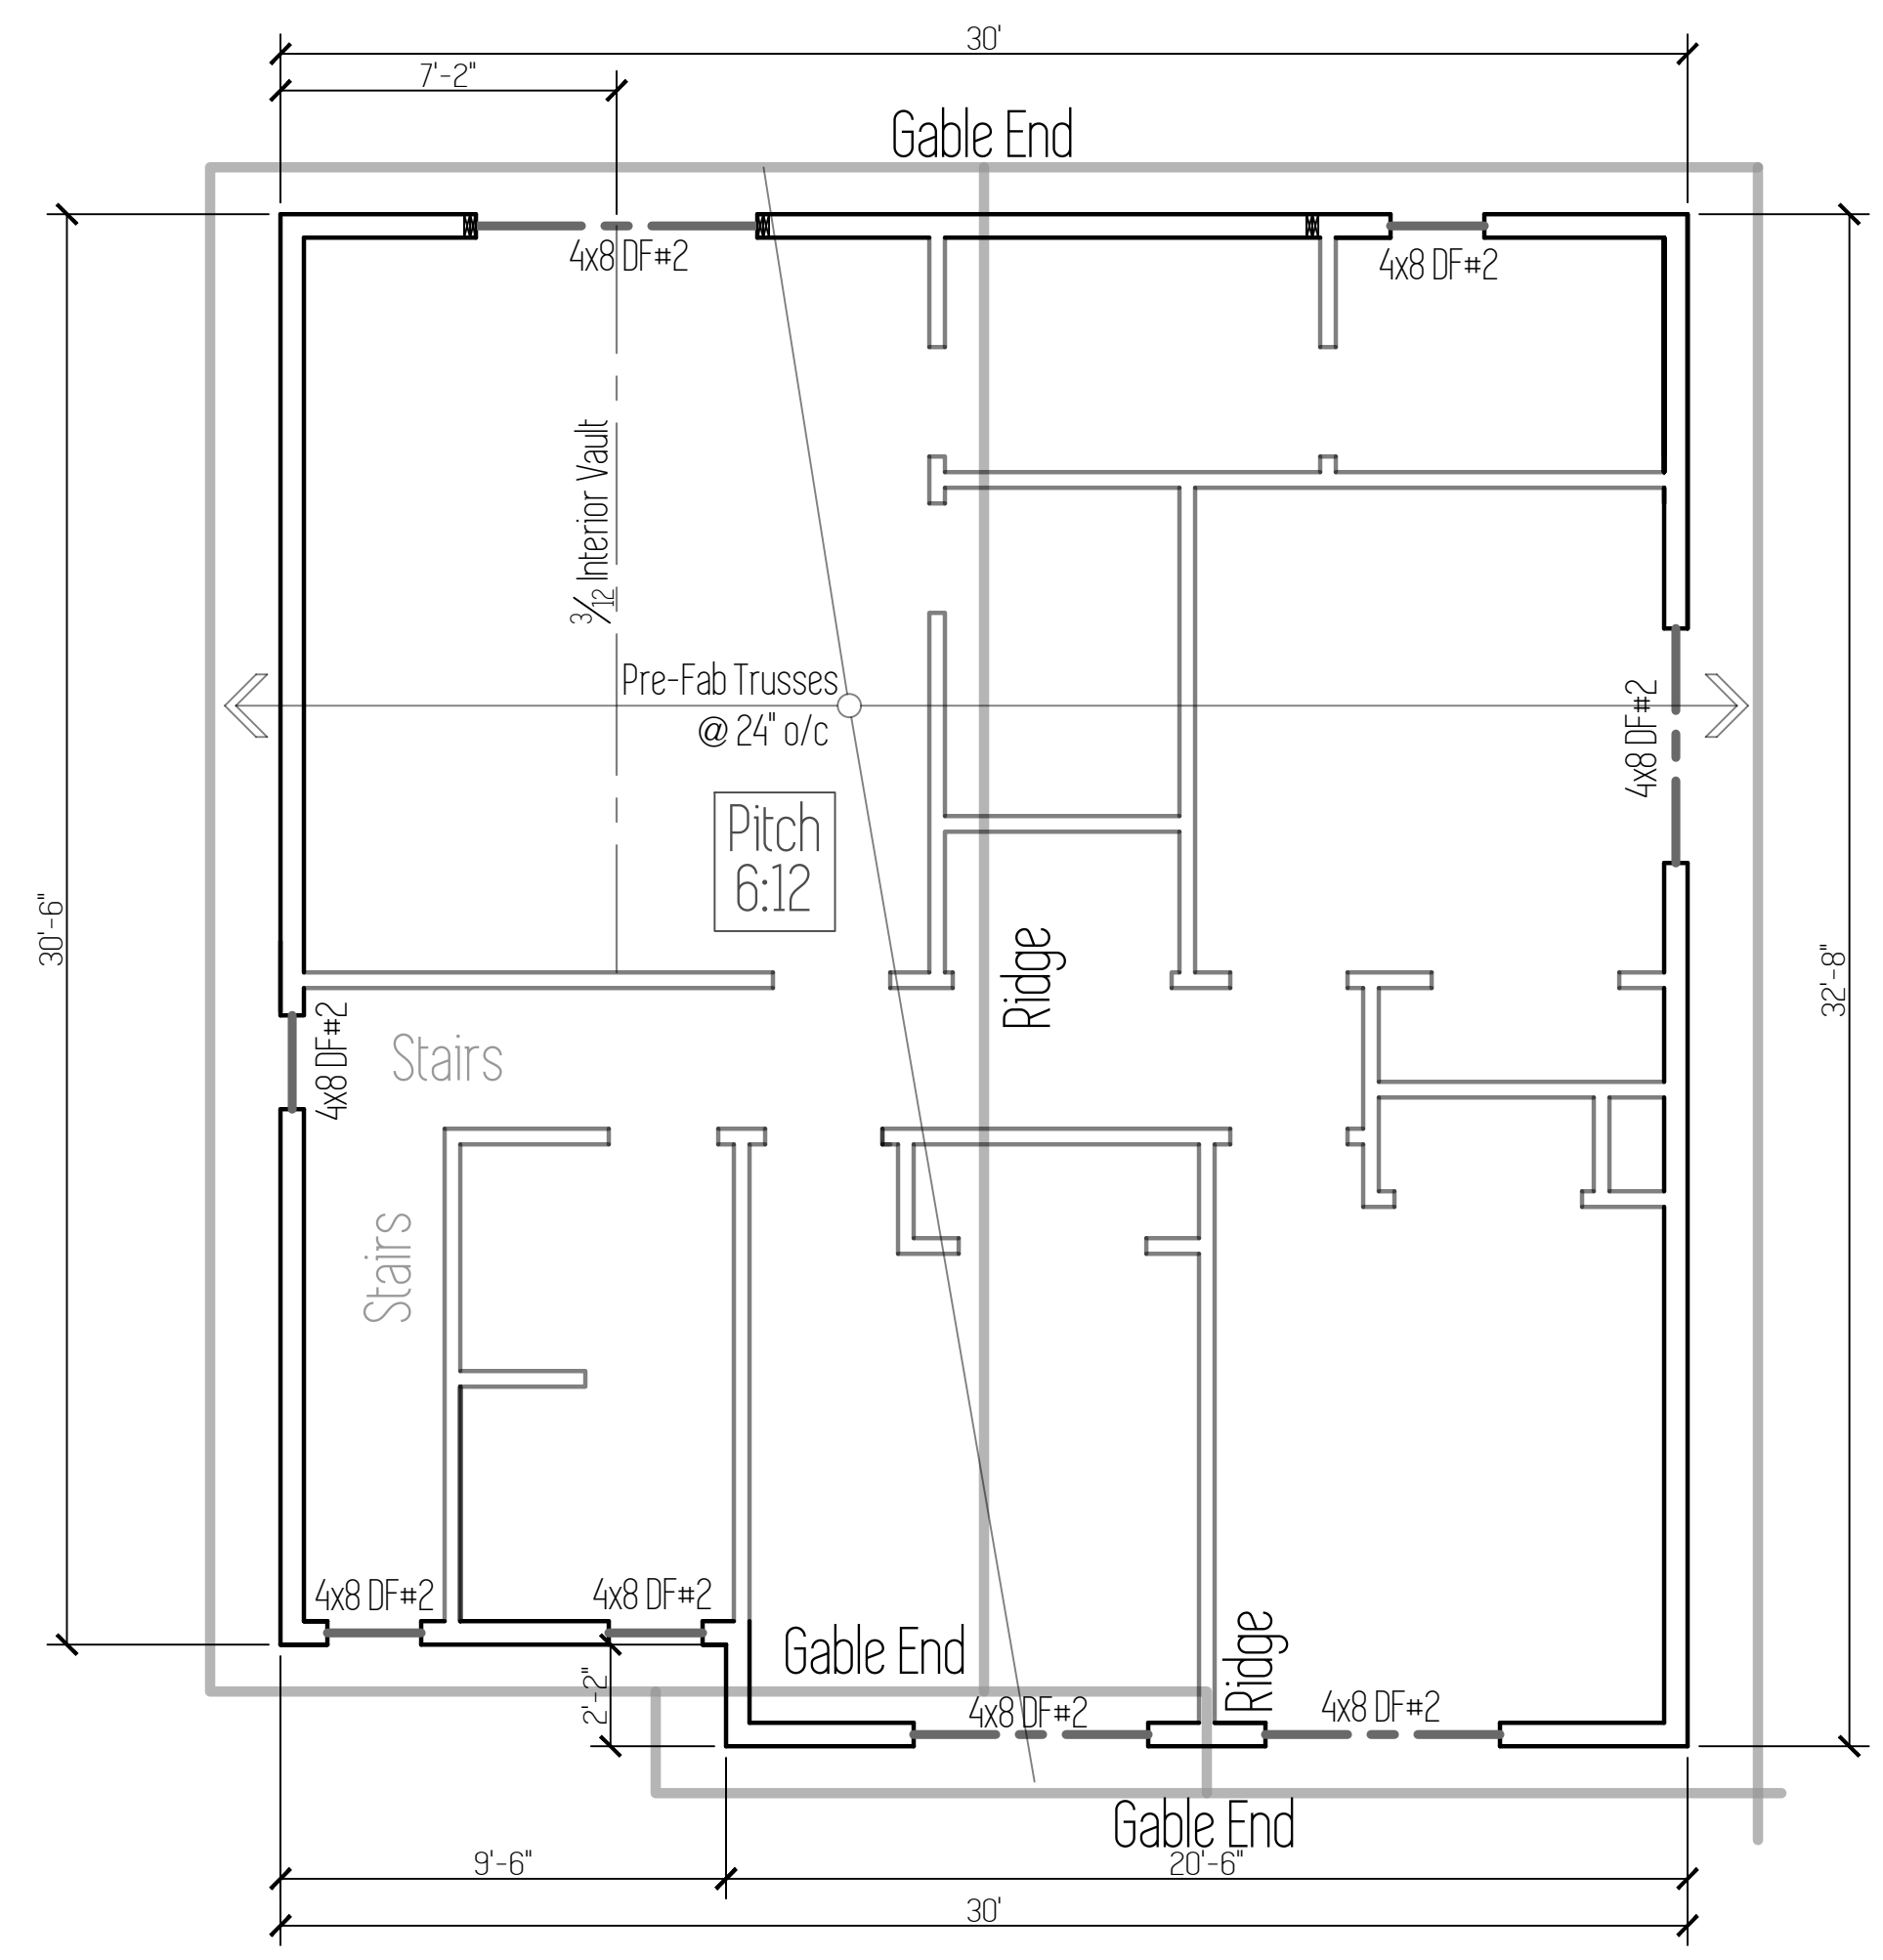


### Roof Framing Plan

#### Roofing Notes


- 18" overhang on all eaves.
- 12" overhang on all gable ends.
- Extend eaves on 1/2 Roof over garage.  
(To match eaves at 1/2 Gable over Entry)
- Install roof vents along ridge @ 4' o.c.

1. Refer to sheet S1.0 for details on Shear Panels and Strapping.
2. Exterior Headers to be 4x8 DF#2 (max. span 6') U.N.O.
3. Interior Headers to be 4x8 DF#2 (max. span 4') U.N.O.
4. Typical exterior wall post to be (2)-2x6 DF#2 (bundled stud), fasten each stud together w/16d nails @ 12" o/c, typ. entire length of stud, u.n.o. Typical interior wall post to be (2)-2x4 DF#2 (bundled stud), fasten each stud together w/16d nails @ 12" o/c, typ. entire length of stud, u.n.o.
5. Exterior post caps to be Simpson "PC" or "EPC", if exposed condition coat per manufacture's specs with exterior exposed and P.T. material.


Plan Name	Tygun
Date	3/7/2019
Location	Lone Oak Estates Lot 119 Battle Ground, WA

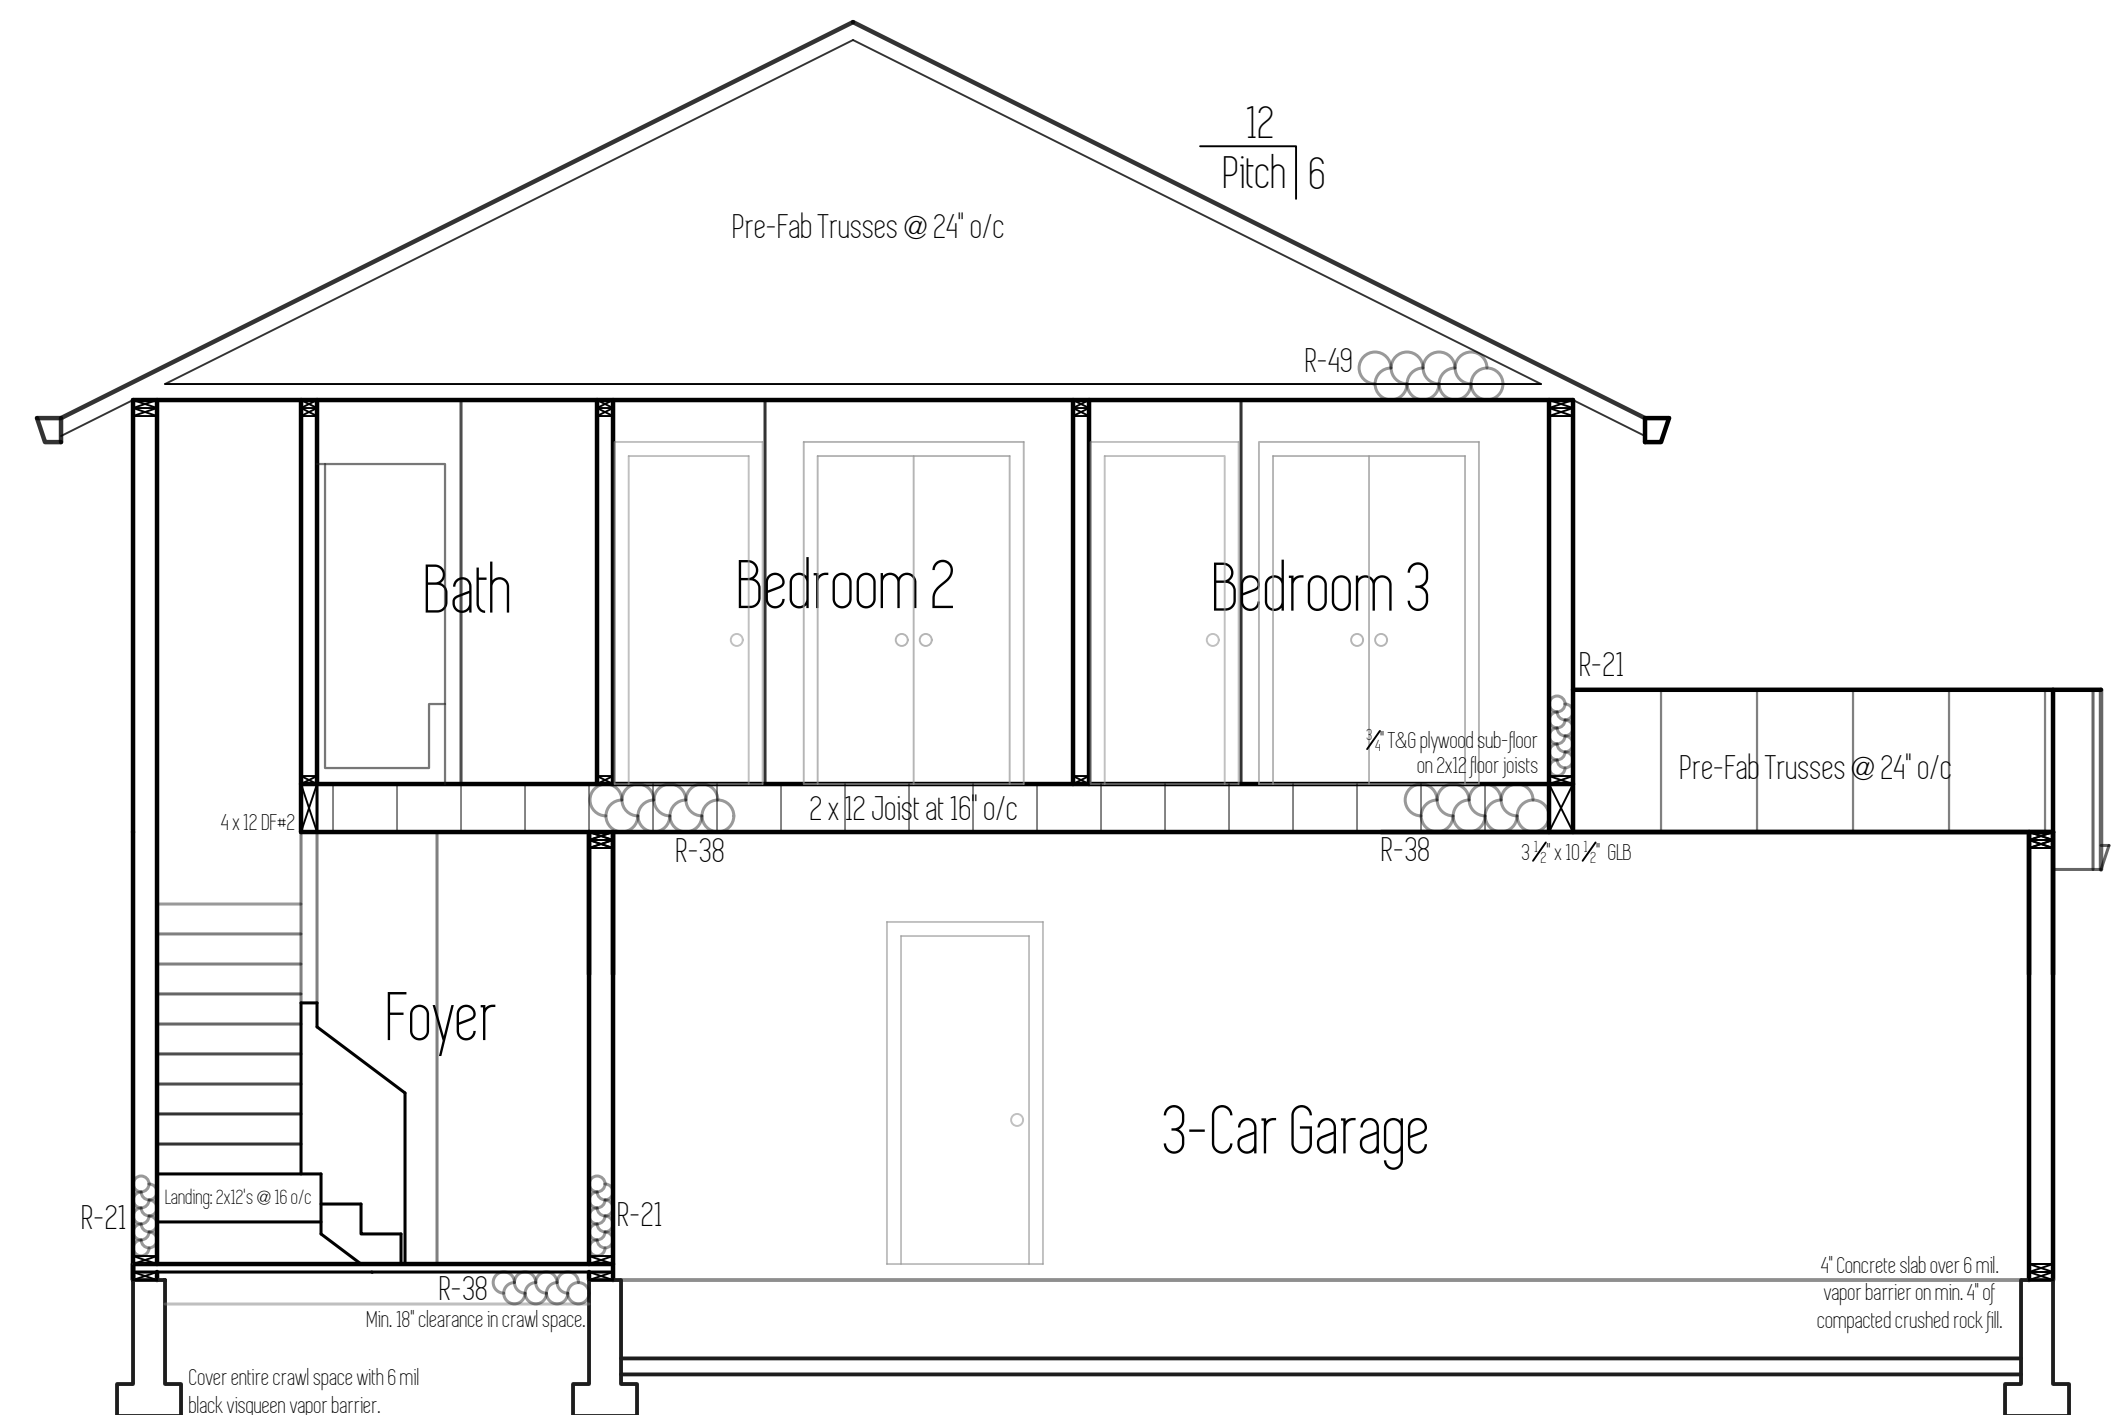


Section A

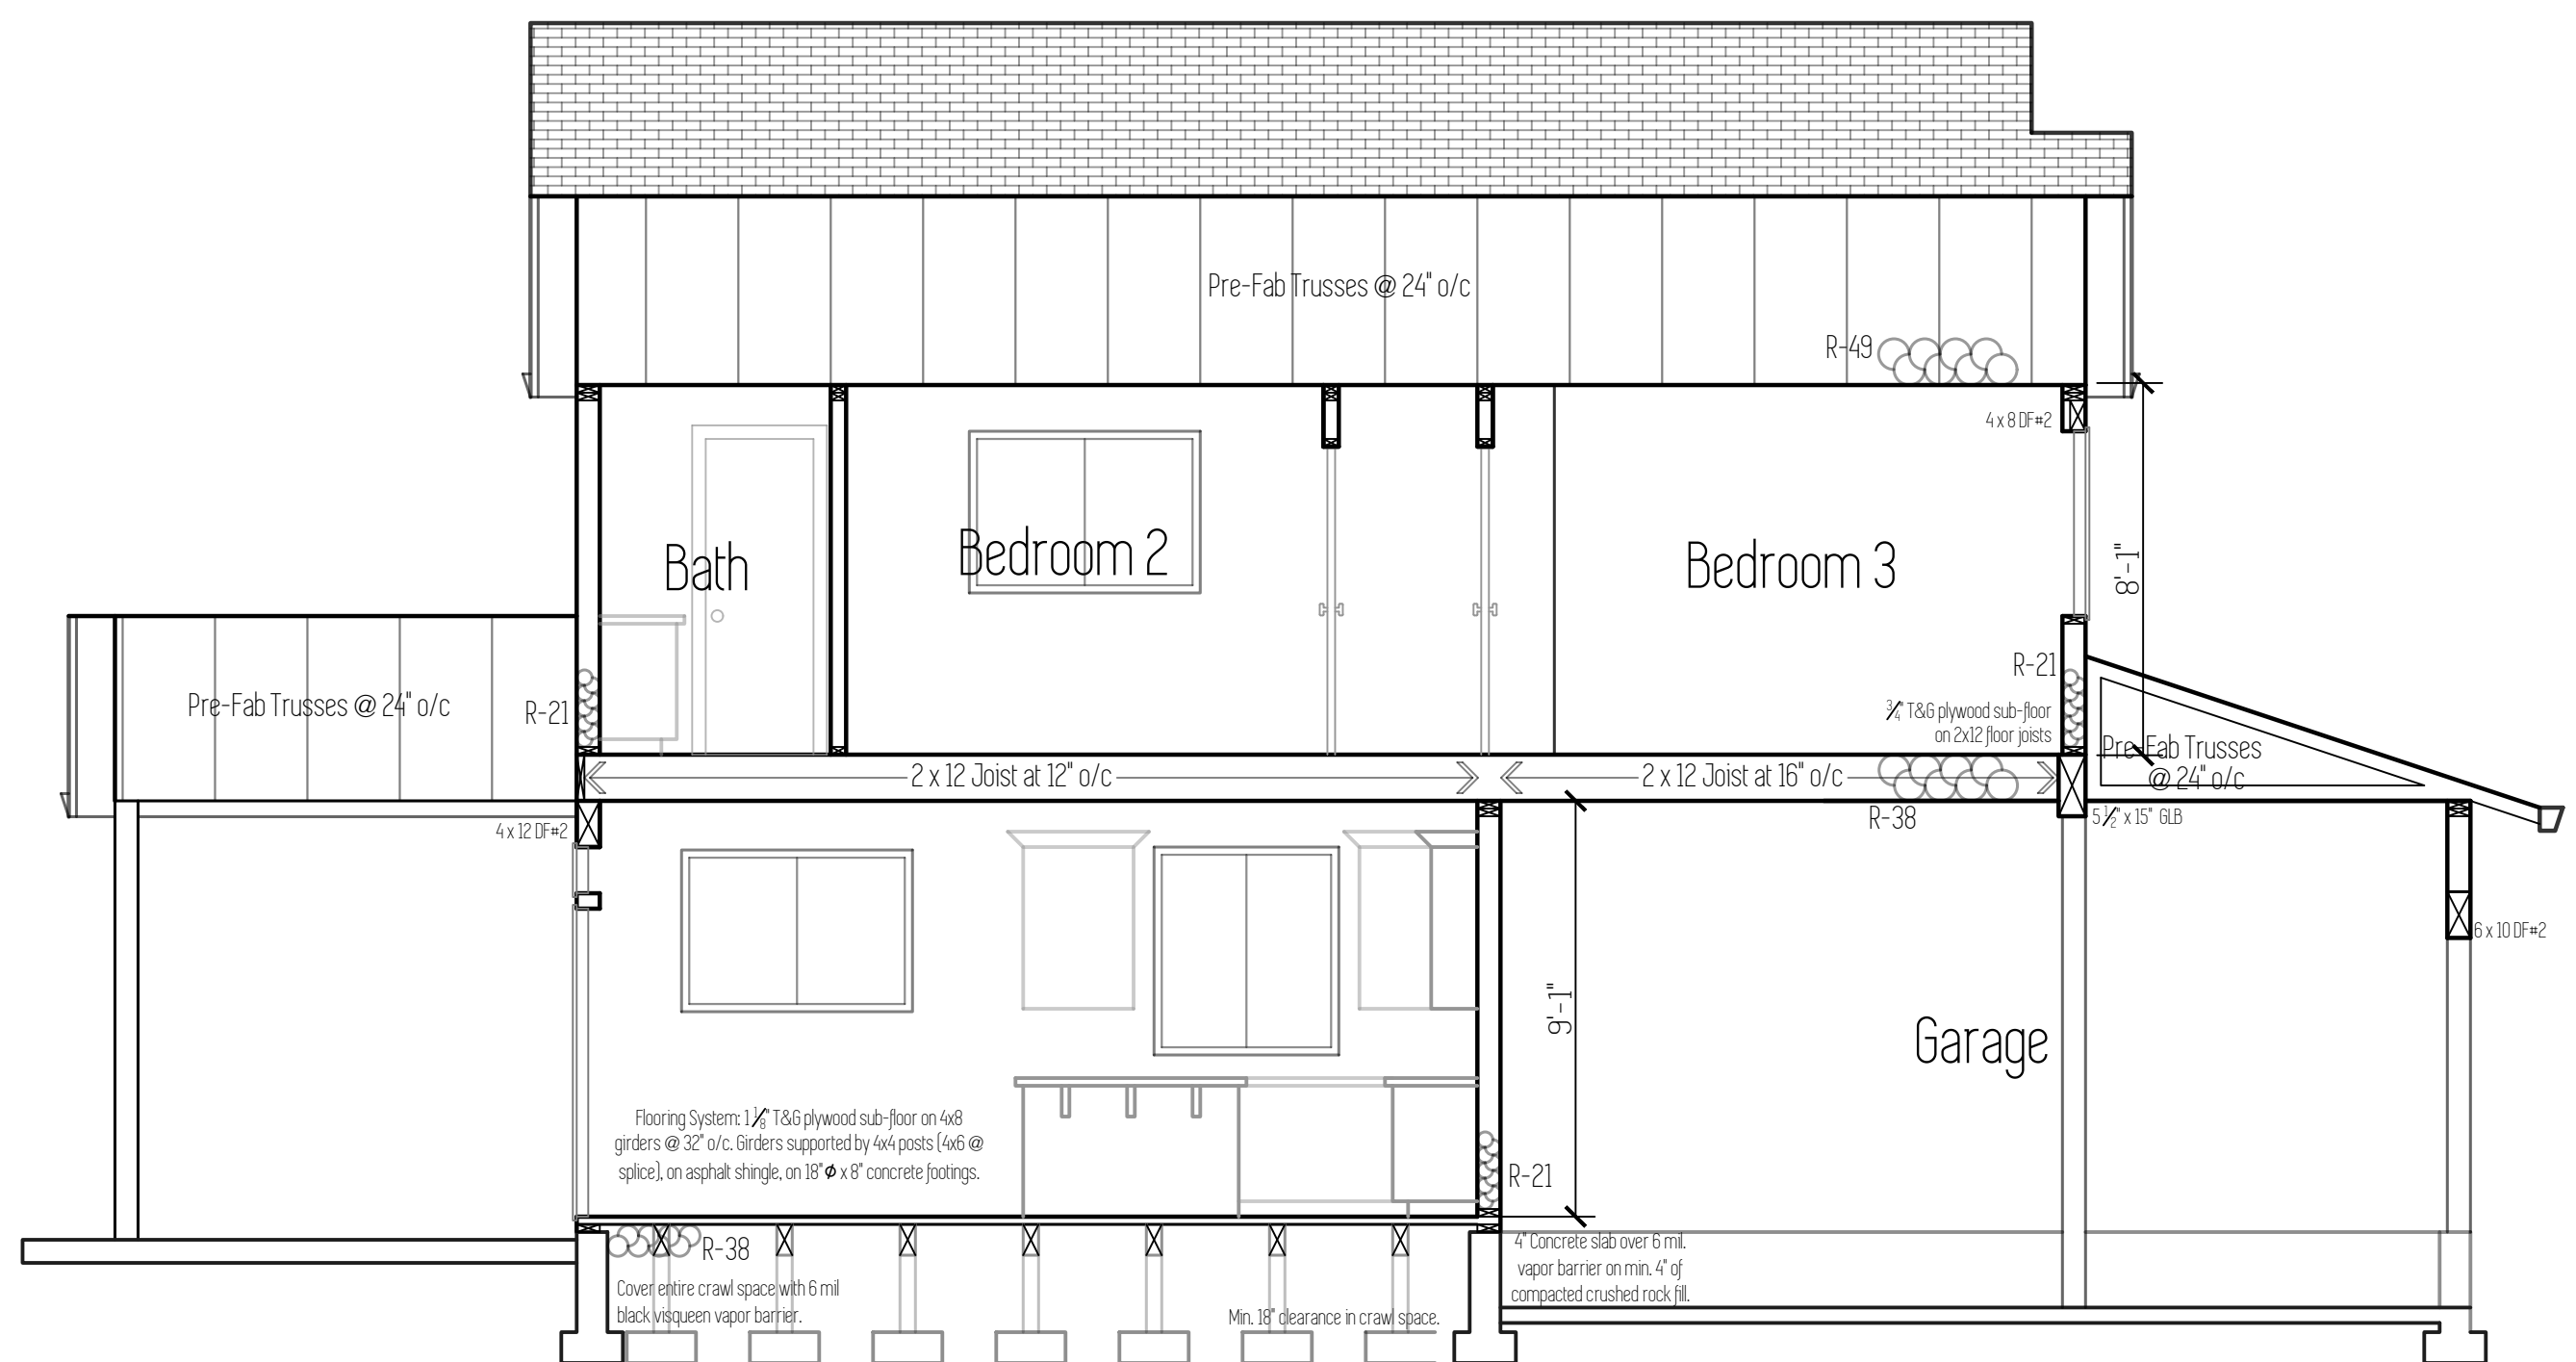

Section B

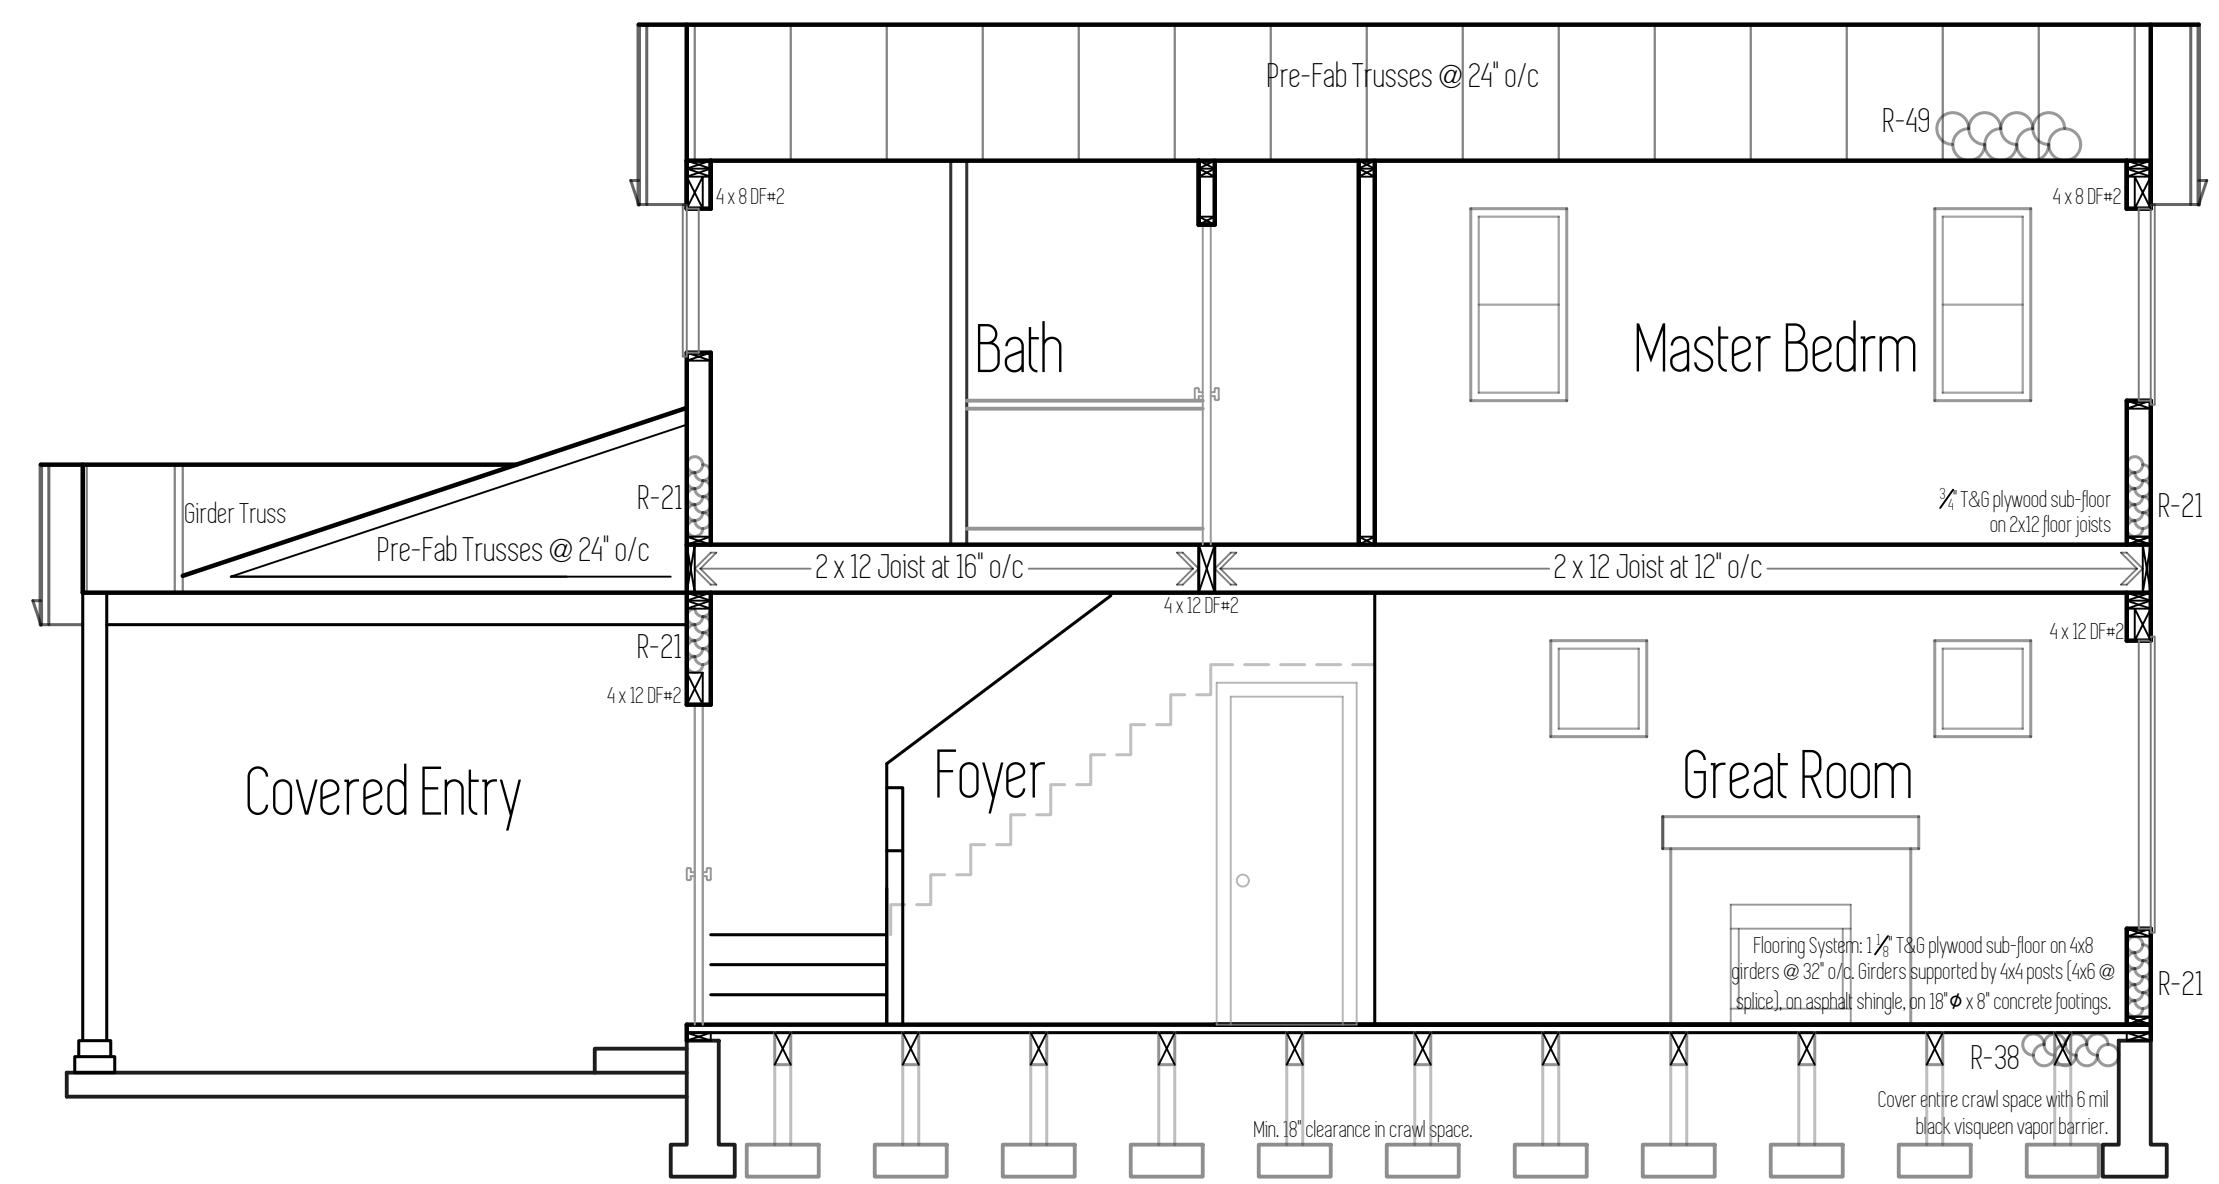


Section C

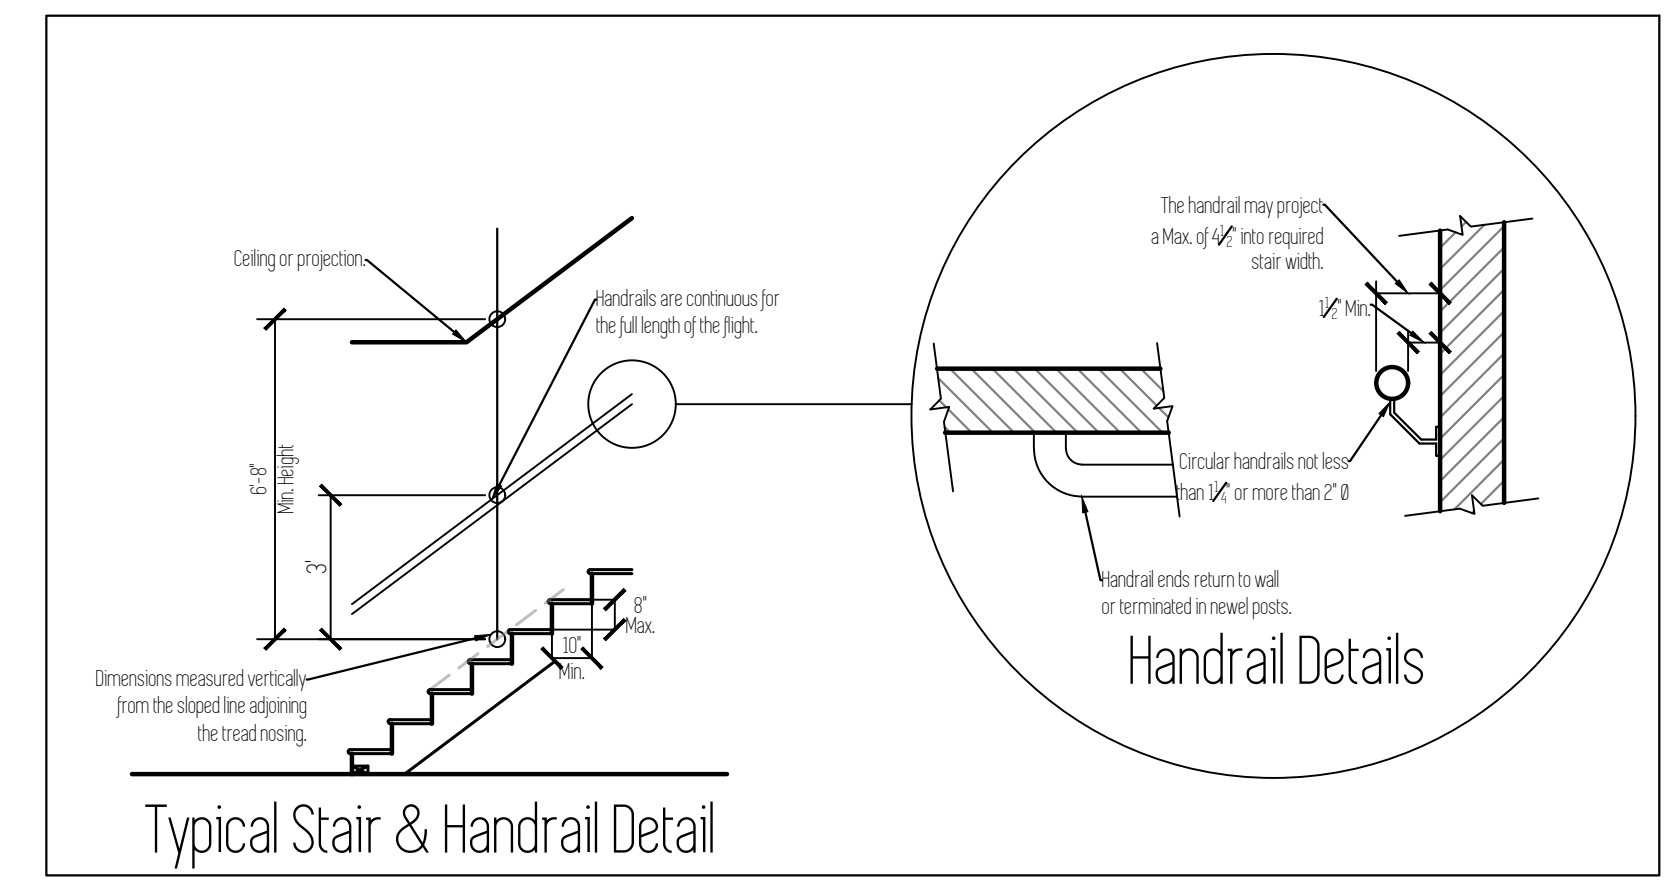

Total Sq Ft = 1,615  
Scale: 1/4\"/>

# Sections

This plan is property of:

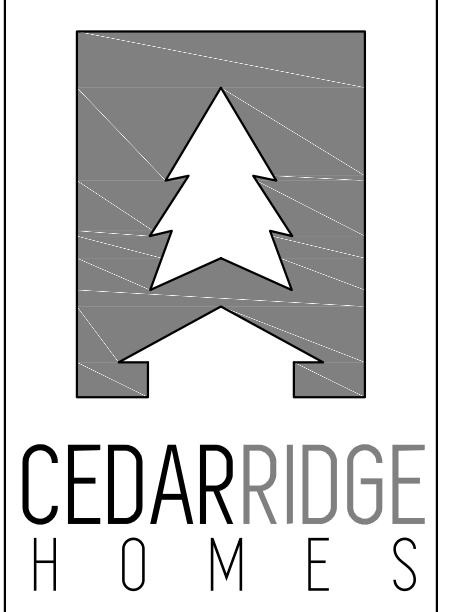

© 2019 Cedar Ridge Homes  
(P) 503-666-4240  
(F) 503-666-2408  
www.cedarridgehomes.us

Designed by:  
**TYSON GREY**  
tyson@cedarridgehomes.us



# SUMMARY OF WORK:

LOCATION: LOAN OAK ESTATES LOT 119 BATTLE GROUND, OREGON  
STRUCTURAL ANALYSIS AND DESIGN FOR SINGLE FAMILY RESIDENCE

## DESIGN LOADS:

CODE: 2015 IBC  
USE OR OCCUPANCY OF BUILDINGS AND STRUCTURES RISK CATEGORY (ASCE TABLE 1.5-1): II  
WIND SPEED Valt: 135 MPH EXPOSURE 'B', Vasd = 105 MPH (IBC EQUATION 16-33)  
SEISMIC DESIGN CATEGORY: 'D'  
GROUND SNOW LOAD: 25 PSF (ROOF SNOW LOAD: 25 PSF)  
ROOF DEAD LOAD: 15 PSF  
FLOOR LIVE LOAD: 40 PSF  
FLOOR DEAD LOAD: 10 PSF  
SOIL BEARING PRESSURE: 1500 PSF  
SOIL PASSIVE SOIL PRESSURE: 200 PSF

## FRAMING REQUIREMENTS:

- WALL STUDS TO BE 2X6 DFL-#2 @ 16" O.C., TYPICAL U.N.O.
- ROOF SHEATHING TO BE 1/2" APA RATED CDX SHEATHING OR OSB. INSTALL PANELS HORIZONTALLY. SPACE 84 NAILS MAXIMUM 6" O.C. ALONG PANEL EDGES. FOR OTHER CONDITIONS, SPACE 84 NAILS MAXIMUM 12" O.C. ON INTERMEDIATE SUPPORTS.
- TYPICAL WALL SHEATHING (FSN) TO BE 1/2" APA RATED CDX SHEATHING OR OSB. ALL PANEL EDGES TO BE BACKED WITH 2-INCH NOMINAL OR WIDER FRAMING. INSTALL PANELS HORIZONTALLY OR VERTICALLY. SPACE 84 NAILS MAXIMUM 6" O.C. ALONG PANEL EDGES. FOR OTHER CONDITIONS AND PANEL THICKNESSES, SPACE 84 NAILS MAXIMUM 12" O.C. ON INTERMEDIATE SUPPORTS.
- FLOOR SHEATHING TO BE 1/2" APA RATED CDX SHEATHING OR OSB. SPACE 84 NAILS MAXIMUM 6" O.C. ALONG PANEL EDGES. FOR OTHER CONDITIONS, SPACE 84 NAILS MAXIMUM 12" O.C. ON INTERMEDIATE SUPPORTS.
- SILL PLATE TO BE 2X P.T. U.N.O. (REFER TO SILL BOLT SPACING IN SCHEDULE BELOW).
- FOR NAIL SIZES REFER TO BELOW.

### SHEAR WALL SCHEDULE:

PANEL NOTATION	SHEATHING THICKNESS (IN.)	NAILS/SPACING	DBL. STUD CONN. (FACE NAIL)	SILL BOLT <sup>(1)</sup> SPACING	SHEAR CAPACITY (SEISMIC)	SHEAR CAPACITY (WIND)
D6	1/2"	8d @ 6" O/C	16d @ 9" O/C	1/2" Ø @ 36" O/C	260 PLF	365 PLF
D4	1/2"	8d @ 4" O/C	16d @ 6" O/C	1/2" Ø @ 24" O/C	380 PLF	532 PLF
D3	1/2"	8d @ 3" O/C	16d @ 4" O/C	1/2" Ø @ 18" O/C	490 PLF	685 PLF
D2	1/2"	8d @ 2" O/C	16d @ 3" O/C	1/2" Ø @ 16" O/C	640 PLF	895 PLF
E2	1/2"	10d @ 2" O/C	N/A	1/2" Ø @ 14" O/C	770 PLF	1077 PLF



**NOTES:**  
 (1) SHEATHING TO BE APA RATED SHEATHING OR OSB (GRADE C-C OR C-D STRUCTURAL II OR BETTER).  
 (2) ALL PANEL EDGES TO BE BACKED WITH 2-INCH NOMINAL OR WIDER FRAMING (DFL-#2). INSTALL PANELS EITHER HORIZONTALLY OR VERTICALLY. SPACE NAILS MAXIMUM 6" O.C. ALONG PANEL EDGES FOR STUDS SPACED 24" O.C. FOR OTHER CONDITIONS AND PANEL THICKNESSES, SPACE NAILS MAXIMUM 12" O.C. ON INTERMEDIATE SUPPORTS.  
 (3) FRAMING AT ADJOINING PANEL EDGES SHALL BE A SINGLE 2-INCH NOMINAL MEMBER OR (2) 2-INCH NOMINAL MEMBER FASTENED TOGETHER WITH 16d NAILS (SPACING ABOVE) TYPICAL ENTIRE HEIGHT OF DBL. STUD. NAILS SHALL BE STAGGERED WHERE NAILS ARE SPACED 2" O.C.  
 (4) AT SHEAR WALL LOCATIONS, REFER RW/S1 AND FF/S1 FOR ROOF TO WALL AND FLOOR TO FLOOR FRAMING.  
 (5) INSTALL 3" SQUARE X 1/2" STEEL PLATE WASHER.  
 (6) FRAMING AT ADJOINING PANEL EDGES SHALL BE SINGLE 3X NOMINAL FRAMING MEMBERS AT EACH END OF THE PANEL. NAILS SHALL BE STAGGERED WHERE NAILS ARE SPACED 2" O.C. INSTALL MIN. 3X P.T. SILL PLATE, U.N.O.  
 (7) PLYWOOD TO BE INSTALLED ON BOTH SIDES OF PANEL.  
 (8) IF 1/2" NOMINAL THICK PLYWOOD OR OSB IS USED, STUDS TO BE SPACED AT 1'-4" O.C. TYPICAL.  
 (9) GALVANIZED NAILS SHALL BE HOT-DIPPED OR TUMBLED.

### HOLD-DOWN SCHEDULE:


HOLDOWN NOTATION	'SIMPSON' HOLDOWN TYPE	INSTALLATION INSTRUCTIONS
2	HDU2 (3075#)	STD. SB 1/2" X 24" MIN. 18" EMBEDMENT (6) CONCRETE. ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF (2) 2X6 DFL-#2 WALL STUDS (MIN. 2X" EDGE DISTANCE). FASTEN STUDS TOGETHER WITH 16d NAILS @ 6" O/C ENTIRE HEIGHT OF STUD. INSTALL HOLDOWN PER MANUFACTURER'S SPECIFICATIONS.
4	HDU4 (4565#)	STD. SB 1/2" X 24" MIN. 18" EMBEDMENT (6) CONCRETE. ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF (2) 2X6 DFL-#2 WALL STUDS (MIN. 2X" EDGE DISTANCE). FASTEN STUDS TOGETHER WITH 16d NAILS @ 6" O/C ENTIRE HEIGHT OF STUD. INSTALL HOLDOWN PER MANUFACTURER'S SPECIFICATIONS.
5	HDU5 (5645#)	STD. SB 1/2" X 24" MIN. 18" EMBEDMENT (6) CONCRETE. ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF (2) 2X6 DFL-#2 WALL STUDS (MIN. 2X" EDGE DISTANCE). FASTEN STUDS TOGETHER WITH 16d NAILS @ 6" O/C ENTIRE HEIGHT OF STUD. INSTALL HOLDOWN PER MANUFACTURER'S SPECIFICATIONS.
8	HDU8 (59804, 6970#, 7870#)	STD. SB 1/2" X 24" MIN. 18" EMBEDMENT (6) CONCRETE. ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF (2) 2X6 DFL-#2 WALL STUDS (MIN. 2X" EDGE DISTANCE). FASTEN STUDS TOGETHER WITH 16d NAILS @ 6" O/C ENTIRE HEIGHT OF STUD. INSTALL HOLDOWN PER MANUFACTURER'S SPECIFICATIONS.
28	MSTC28	INSTALL STRAP ACROSS FLOOR LINE. INSTALL MIN. (8) 16d NAILS INTO DOUBLE WALL STUDS ABOVE FLOOR AND INTO DOUBLE WALL STUDS BELOW. CENTER STRAP ON STUDS TO INSTALL NAILS INTO MIDDLE THIRD OF STUD.
40	MSTC40	INSTALL STRAP ACROSS FLOOR LINE. INSTALL MIN. (24) 16d NAILS INTO DOUBLE WALL STUDS ABOVE FLOOR AND INTO DOUBLE WALL STUDS BELOW. CENTER STRAP ON STUDS TO INSTALL NAILS INTO MIDDLE THIRD OF STUD.
52	MSTC52	INSTALL STRAP ACROSS FLOOR LINE. INSTALL MIN. (24) 16d NAILS INTO DOUBLE WALL STUDS ABOVE FLOOR AND INTO DOUBLE WALL STUDS BELOW. CENTER STRAP ON STUDS TO INSTALL NAILS INTO MIDDLE THIRD OF STUD.

**NOTES:**  
 (1) IN LIEU OF SIMPSON SSTB BOLTS ANCHOR BOLTS TO BE A307 OR A306 THREADED ROD WITH STD. NUT AND 2" X 2" X 1/2" STEEL PLATE WASHER ON BOTTOM OF ROD.  
 (2) HOLDOWNS TO BE FASTENED TO DOUBLE STUDS (CONTINUOUS FROM SILL PLATE TO DOUBLE TOP PLATE) AT PANEL ENDS. WALL STUDS SHOULD HAVE PANEL NAILING FROM SHEAR WALL SHEATHING.  
 (3) IF HOLDOWNS 2, 4, 6, AND 8 ARE INSTALLED FROM FLOOR TO FLOOR, REFER TO DETAIL FF/S1.  
 (4) U.N.O. INSTALL (1) #4 CONTINUOUS HORIZONTAL TOP BAR 3" DOWN FROM TOP OF WALL AT ALL HOLDOWN ANCHORS. EXTEND BAR MIN. 5'-0" FAST HOLDOWN IN BOTH DIRECTIONS (BEND BAR AROUND AT CORNER CONDITION). FOR THIS 10'-0" SECTION INSTALL (1) #4 VERTICAL BAR @ 24" O.C. THE HOLDOWN ANCHOR TO HORIZONTAL TOP BAR.


### SHEAR WALL / HOLDOWN NOTATION DIAGRAM

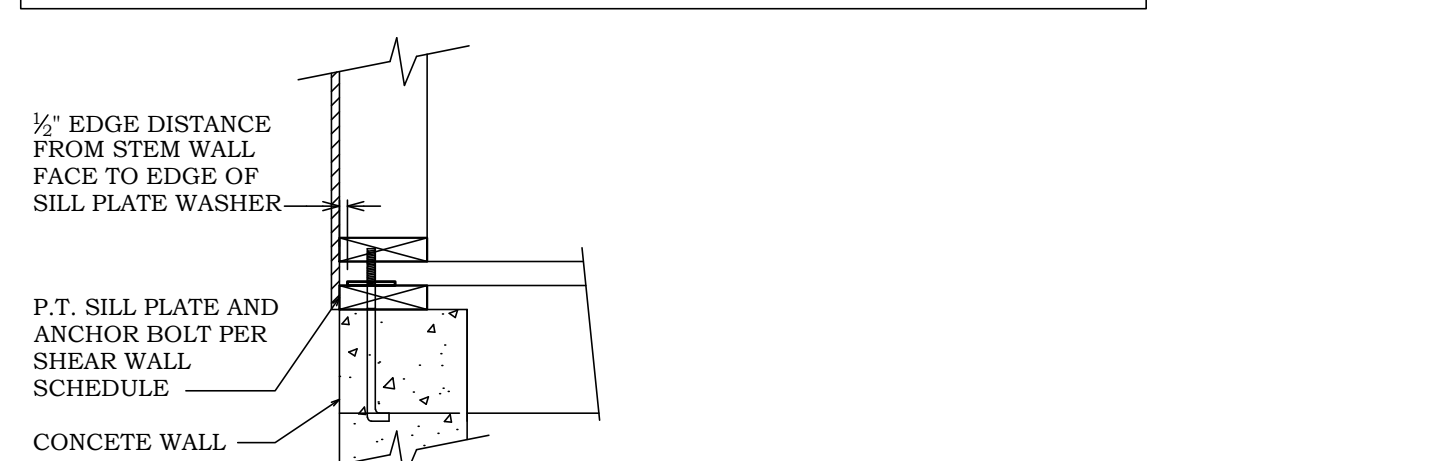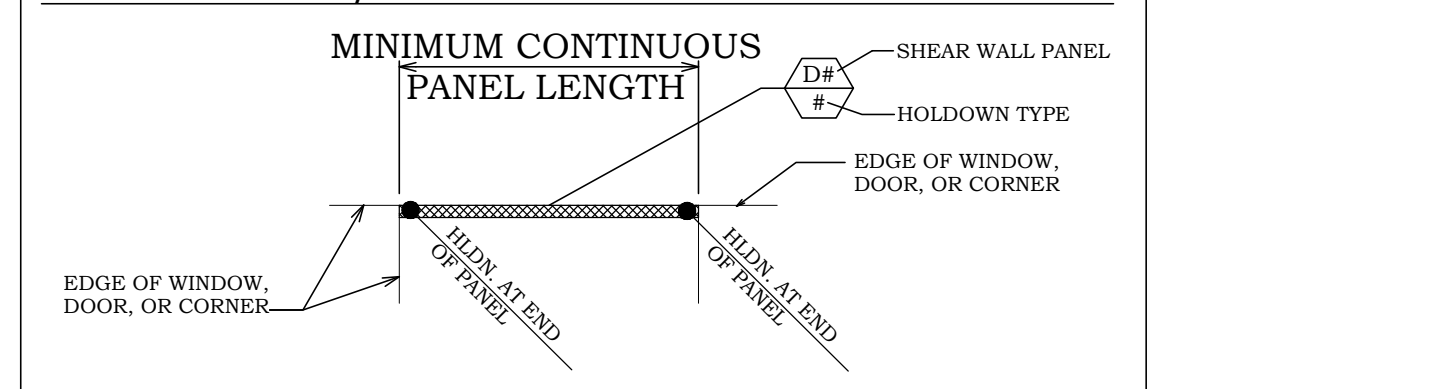

FSP FDN. SILL PLATE SECTION  
S1

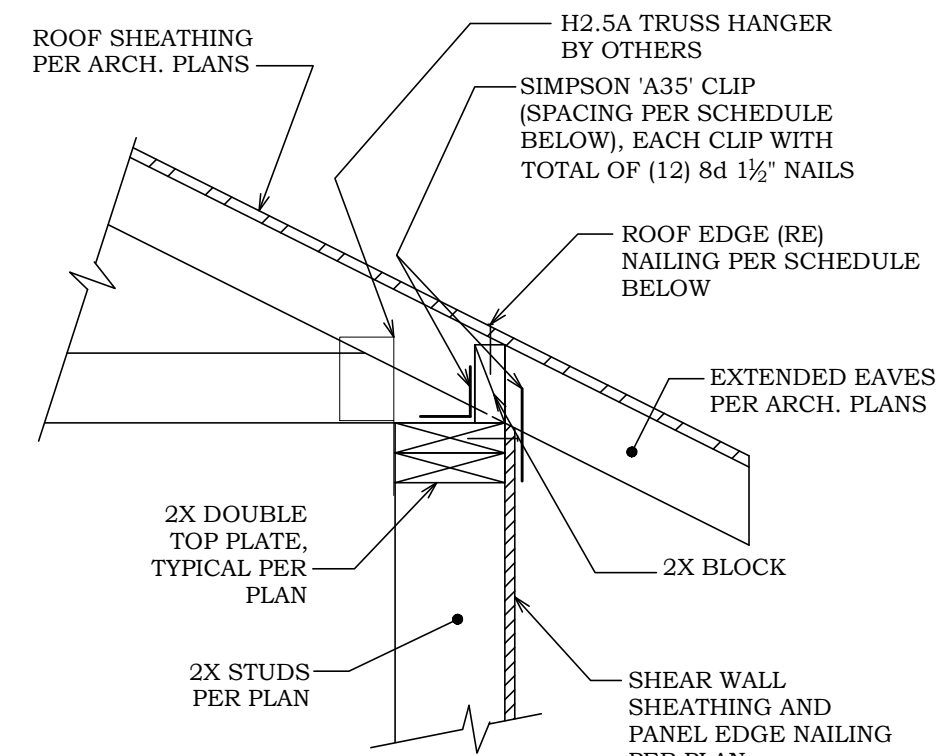


RW/S1 ROOF TO SHEAR WALL SECTION

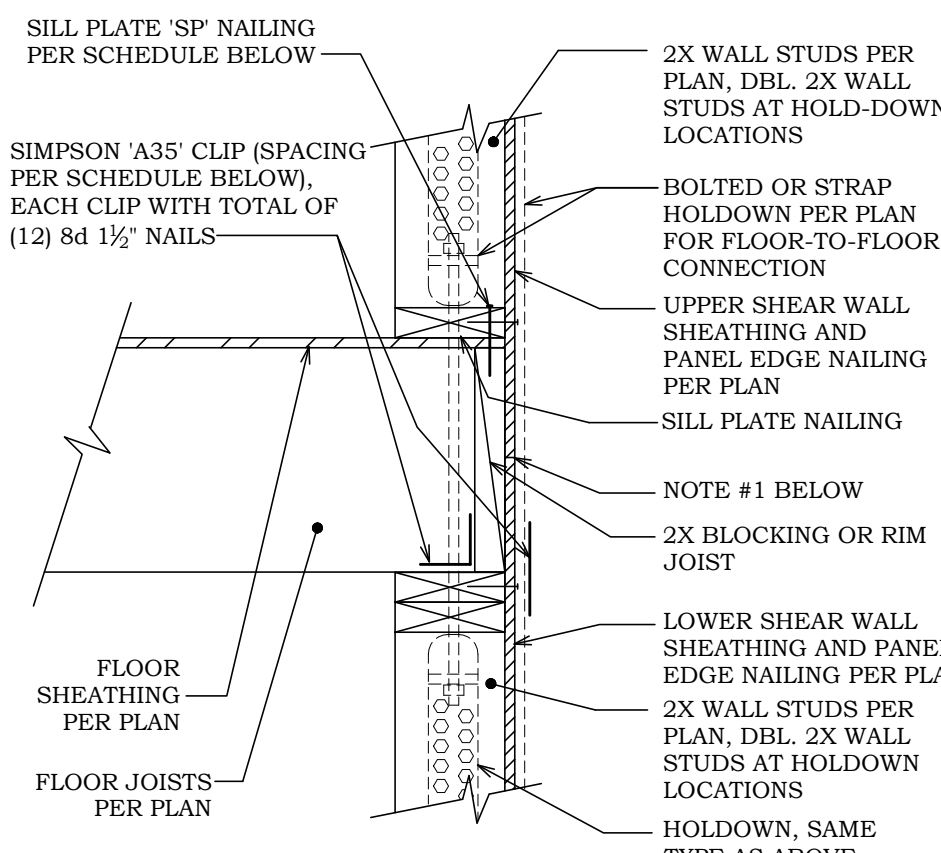


FF/S1 FLOOR TO FLOOR SECTION AT SHEAR WALL



PANEL TYPE	'SP' NAIL SPACING	SIMPSON CLIP SPACING	'RE' NAIL SPACING
D6	16d @ 8" O.C.	1'-8" O.C.	8d @ 8" O.C.
D4	16d @ 4" O.C.	1'-2" O.C.	8d @ 4" O.C.
D3	16d @ 3" O.C.	0'-11" O.C.	8d @ 3" O.C.
D2	16d @ 3" O.C.	8" O.C.	8d @ 2 1/2" O.C.
E2	16d @ 2" O.C.	7" O.C.	8d @ 2" O.C.

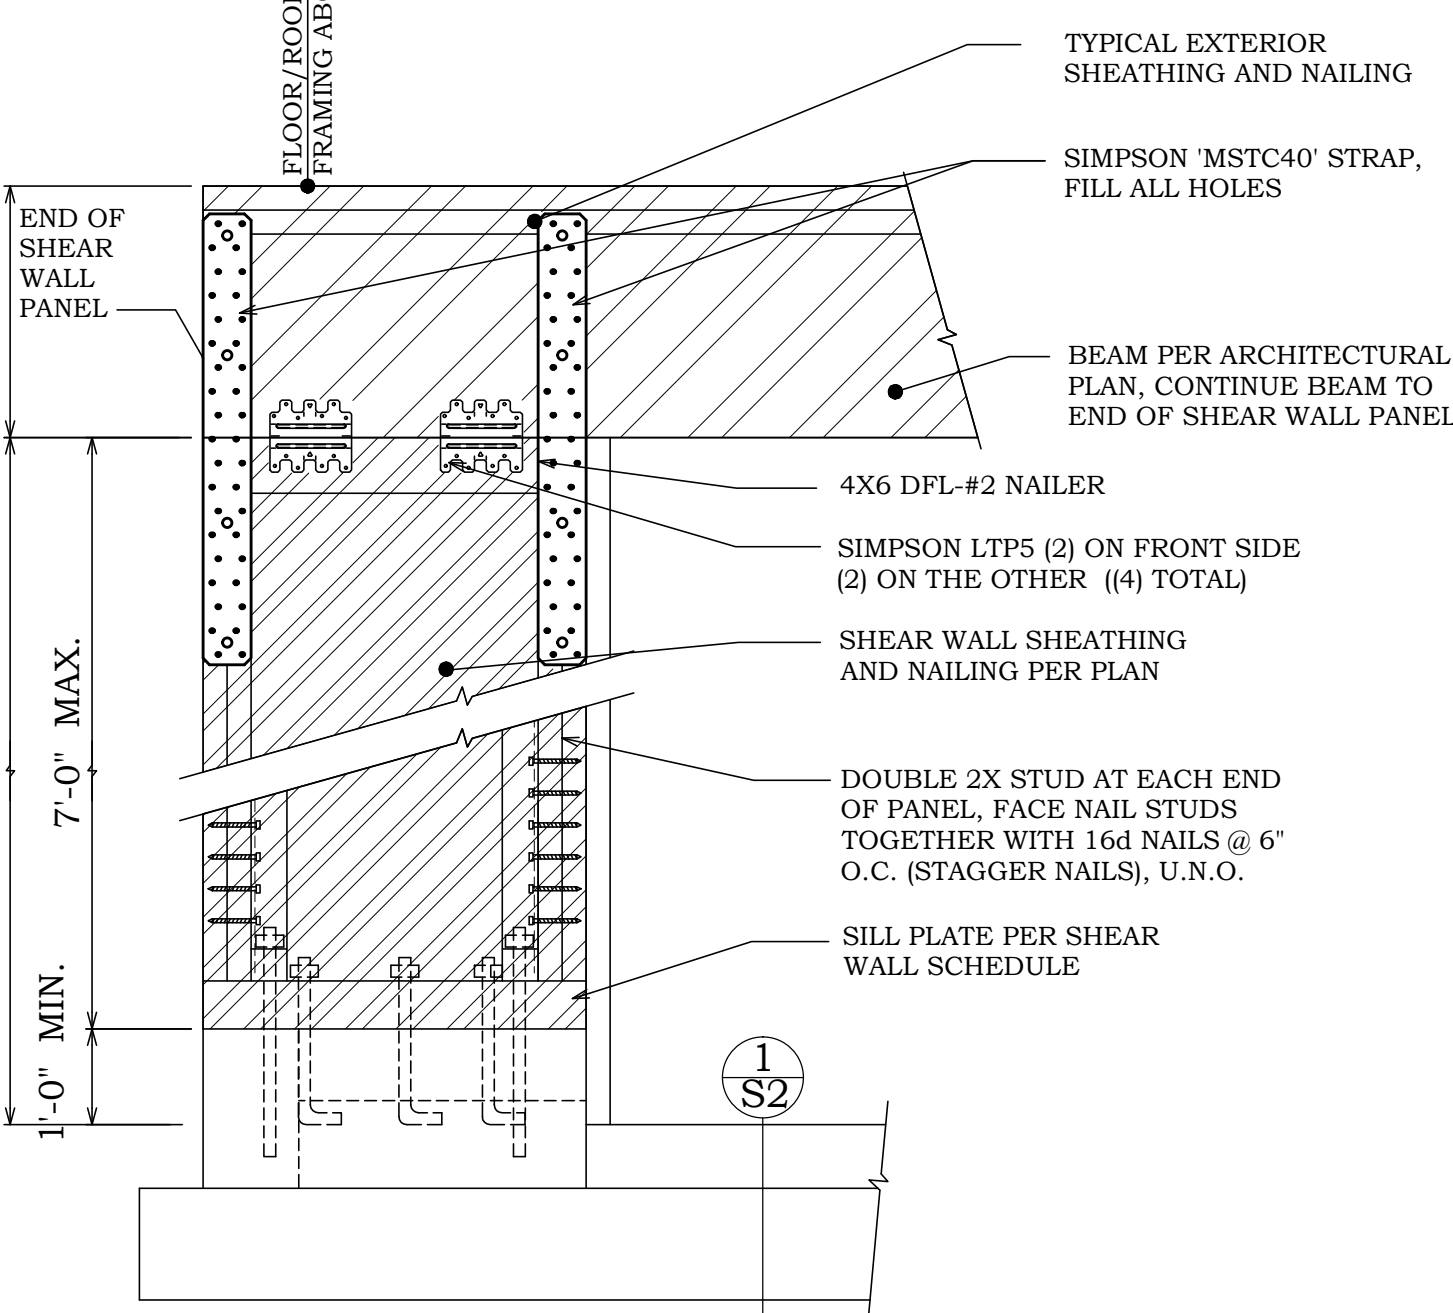


1 SHEAR WALL ELEVATION  
S1.0 SCALE: NONE

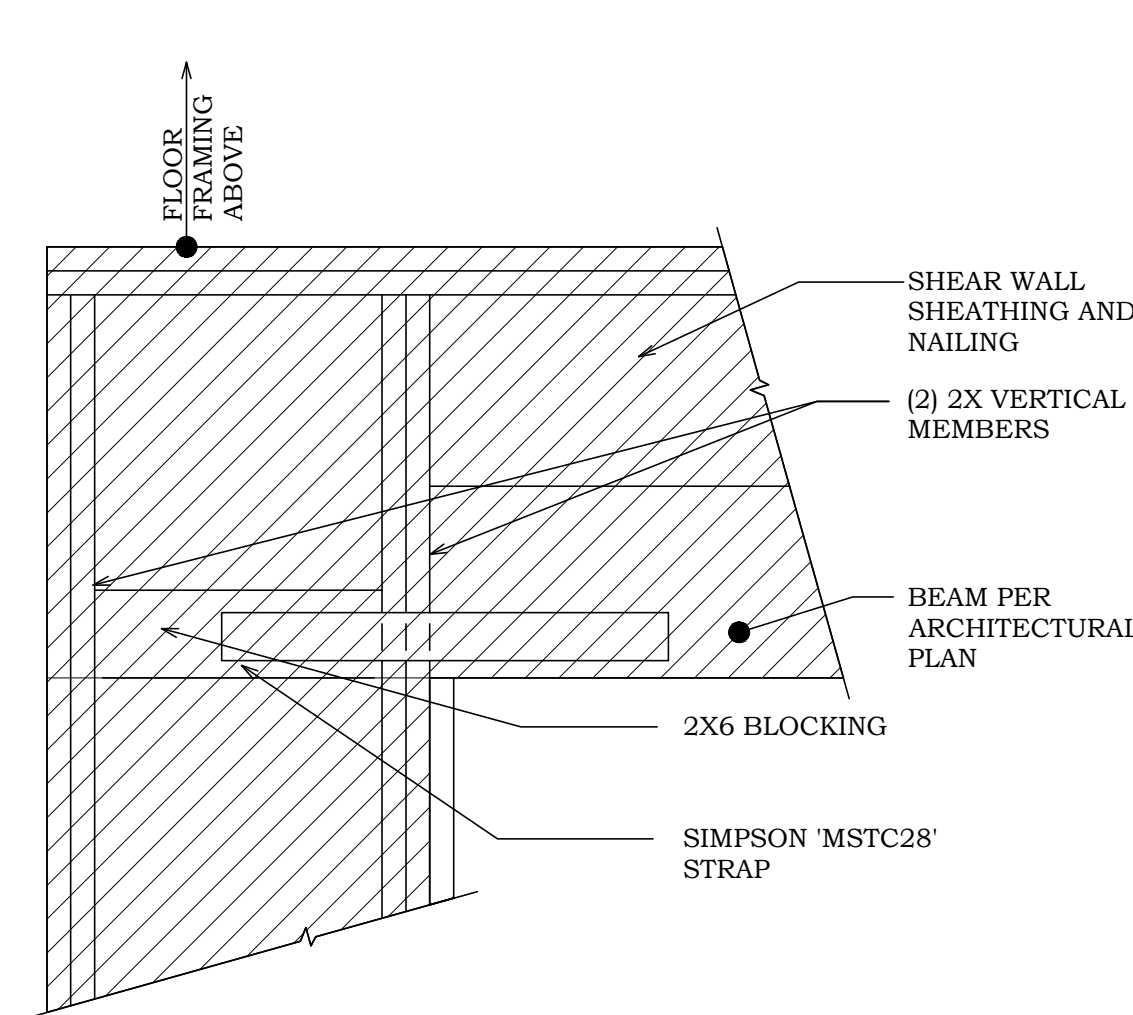


4 SHEAR WALL ELEVATION  
S1.0 SCALE: NONE

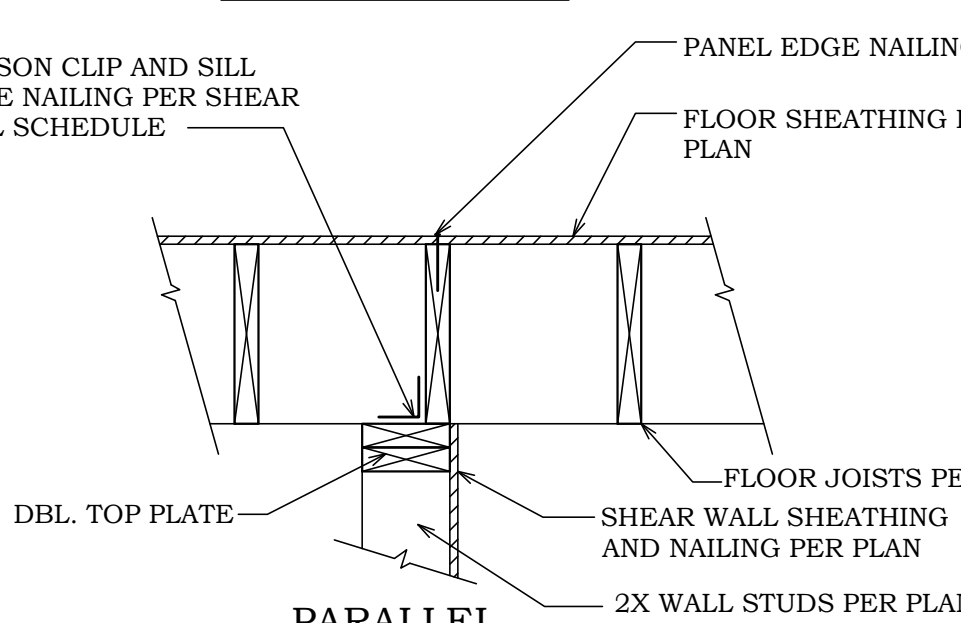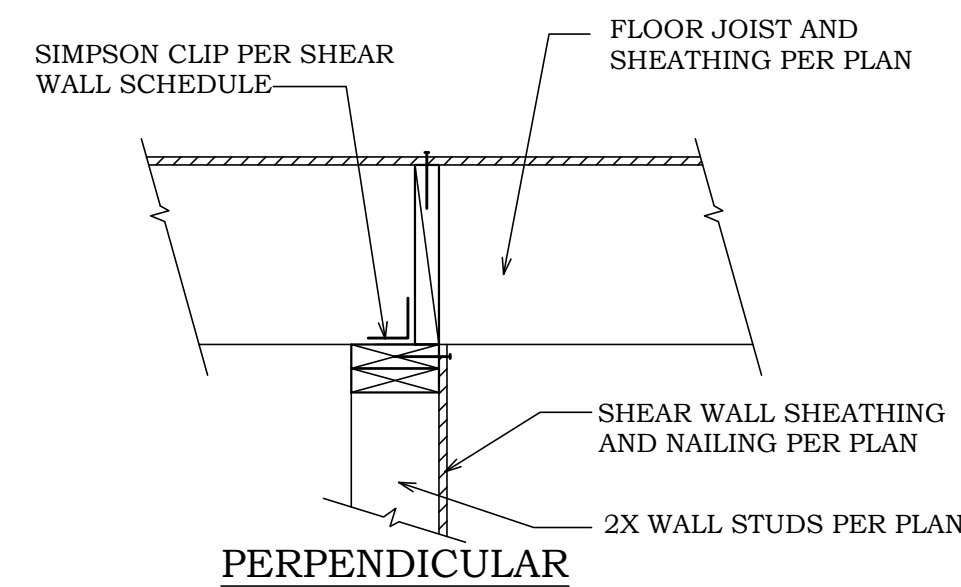

3 FLOOR SECTION  
S1.0 SCALE: NONE

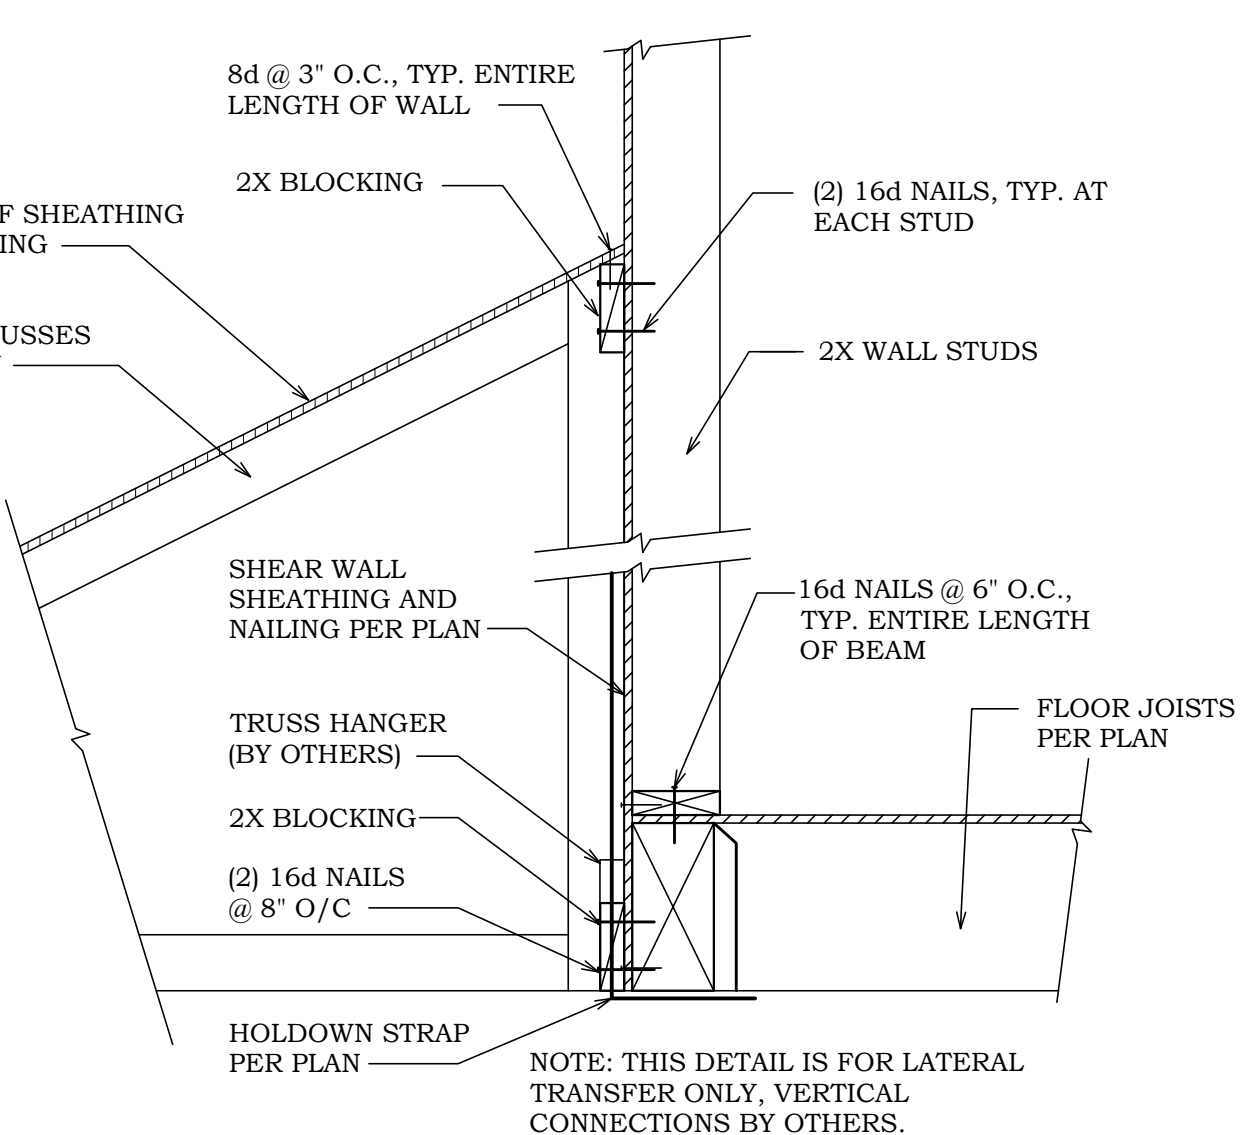


2 LOWER ROOF SECTION  
S1.0 SCALE: 1" = 1'-0"

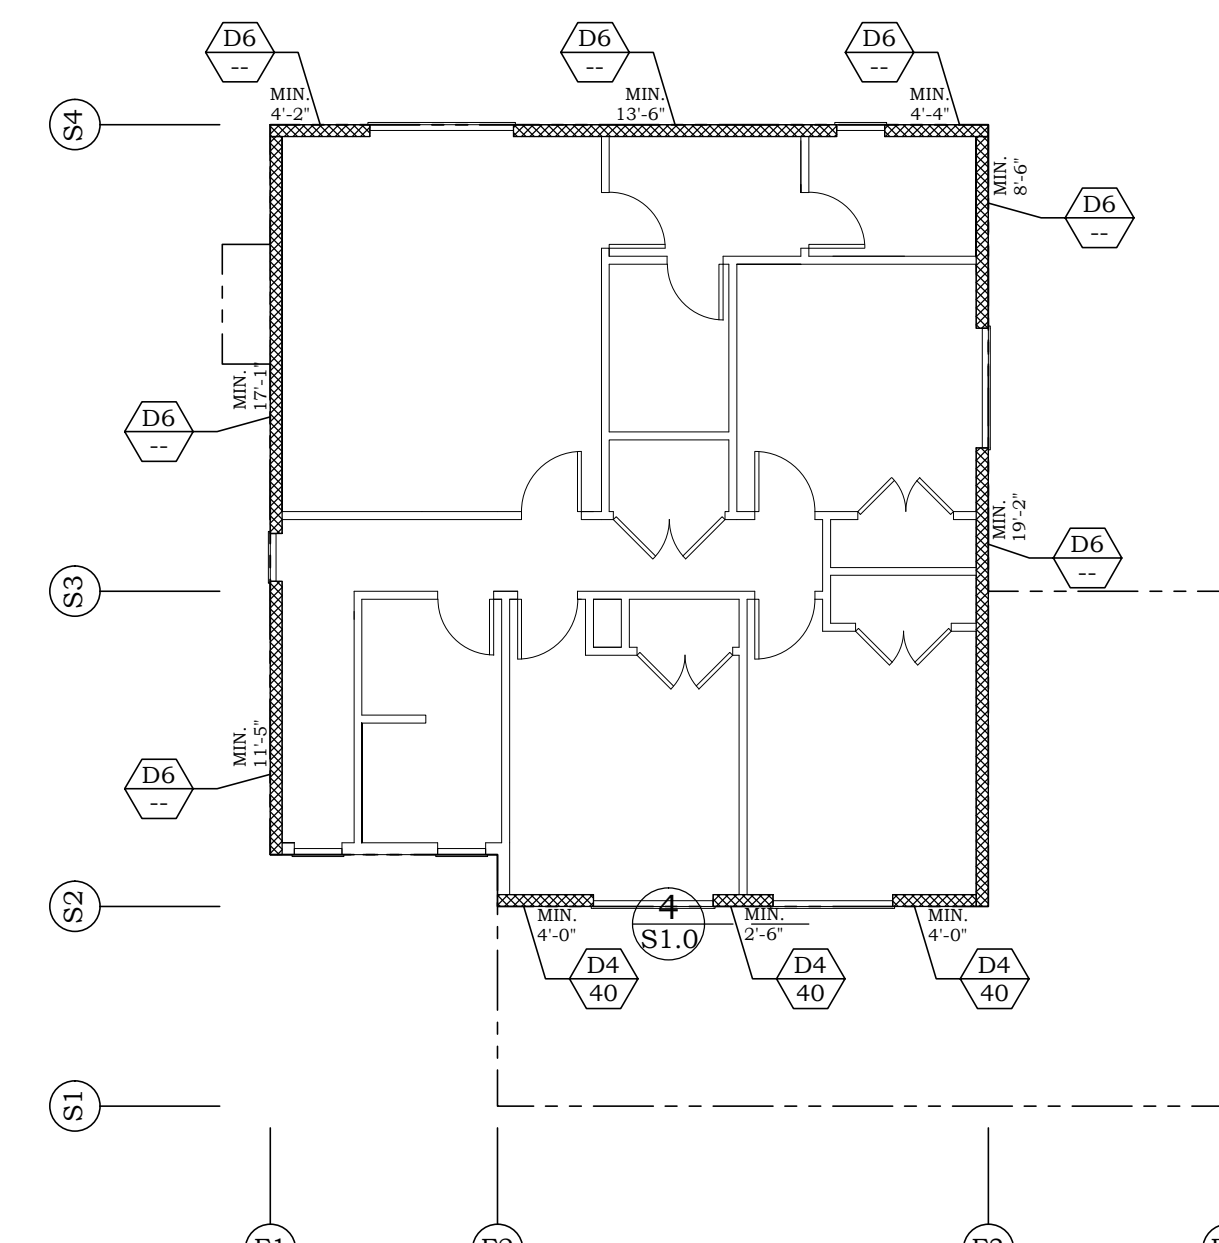

UPPER FLOOR SHEARWALL PLAN

**NOTE:**  
 1. REFER TO FRAMING REQUIREMENTS FOR TYPICAL EXTERIOR SHEATHING AND NAILING, ROOF SHEATHING AND NAILING AND FLOOR SHEATHING AND NAILING REQUIREMENTS.

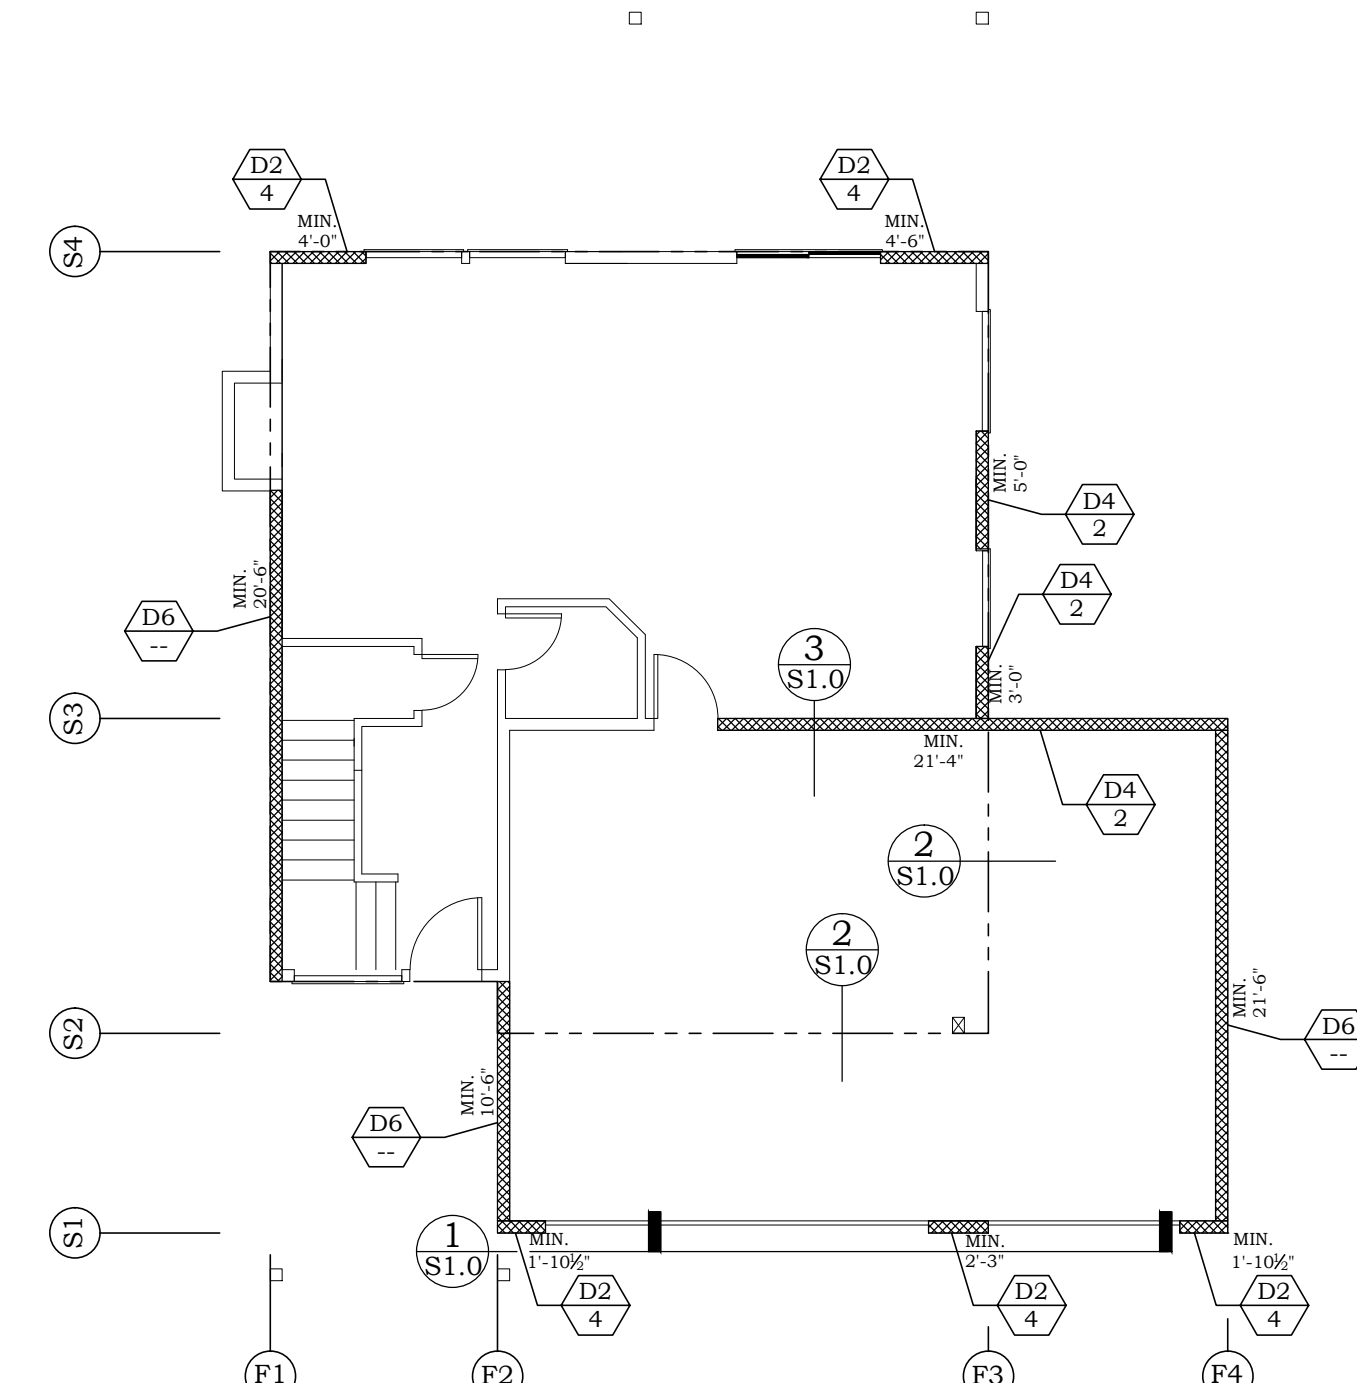

MAIN FLOOR SHEARWALL PLAN

**NOTE:**  
 1. REFER TO FRAMING REQUIREMENTS FOR TYPICAL EXTERIOR SHEATHING AND NAILING, ROOF SHEATHING AND NAILING AND FLOOR SHEATHING AND NAILING REQUIREMENTS.

PROJECT NAME	LOE L119 SHEAR WALL AND HOLDOWN SCHEDULE SHEAR WALL PLANS
PROJECT NO.	R19135
DATE	03/07/19
ISSUE	CD
DESIGNED BY	RJT
DRAWN BY	RJT
CHECKED BY	RJT
DATE	03/07/19
PROJECT NO.	R19135
SHEET NO.	S1.0

TURNER ENGINEERING & DESIGN  
 11220 WESTERN AVENUE  
 EAGLE CREEK, OREGON 97022  
 OFFICE: (503) 970-8807  
 EMAIL: turner.engr@gmail.com

REGISTERED PROFESSIONAL ENGINEER  
 STATE OF OREGON  
 NO. 11220  
 EXPIRES OCT 20, 2019