



Left Elevation



Front Elevation

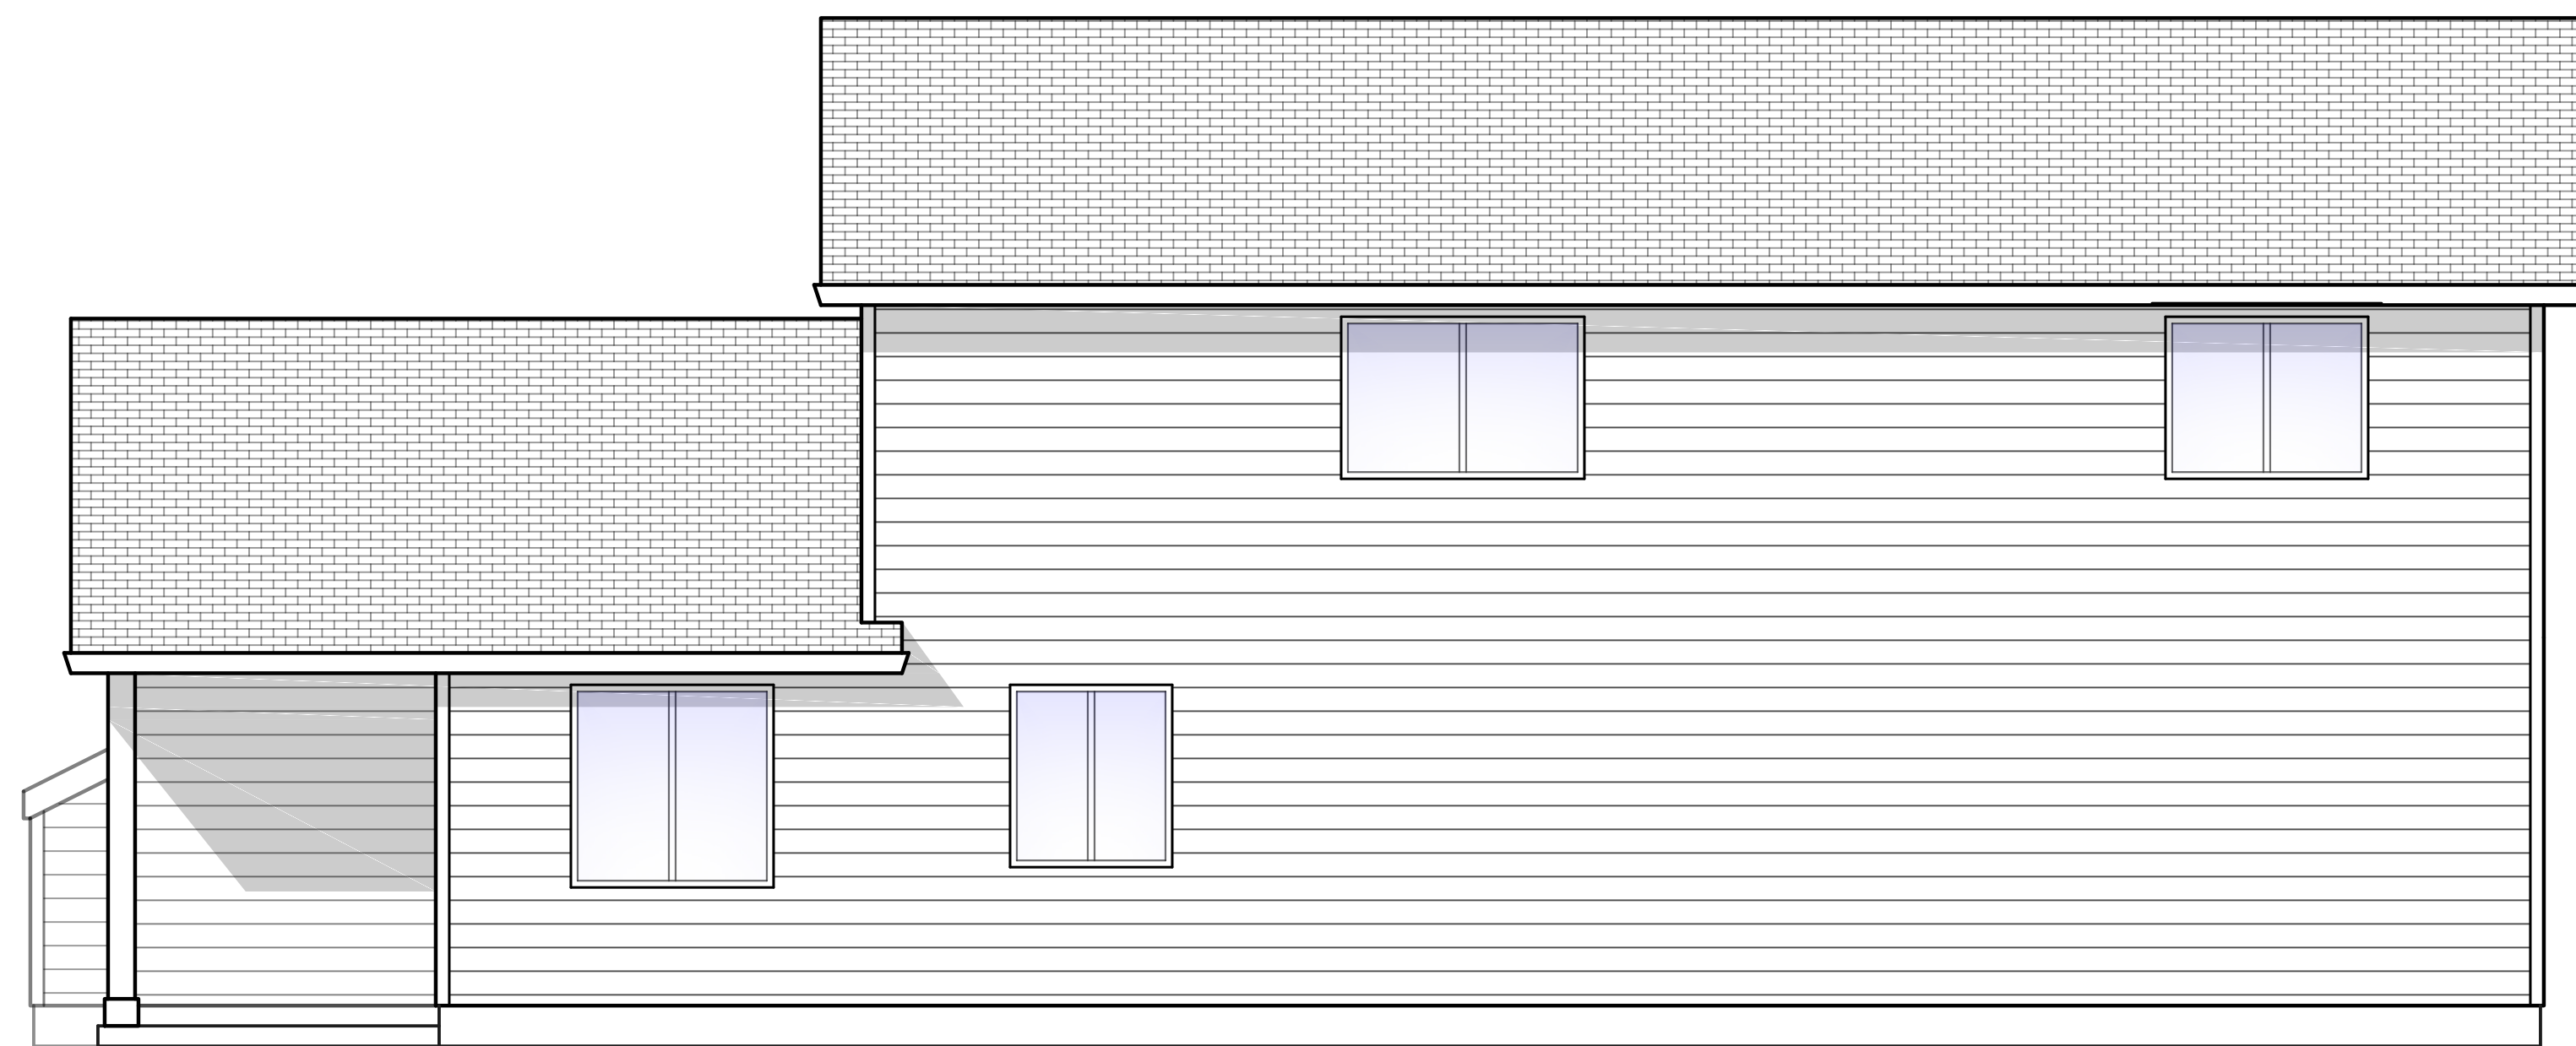

Back Elevation

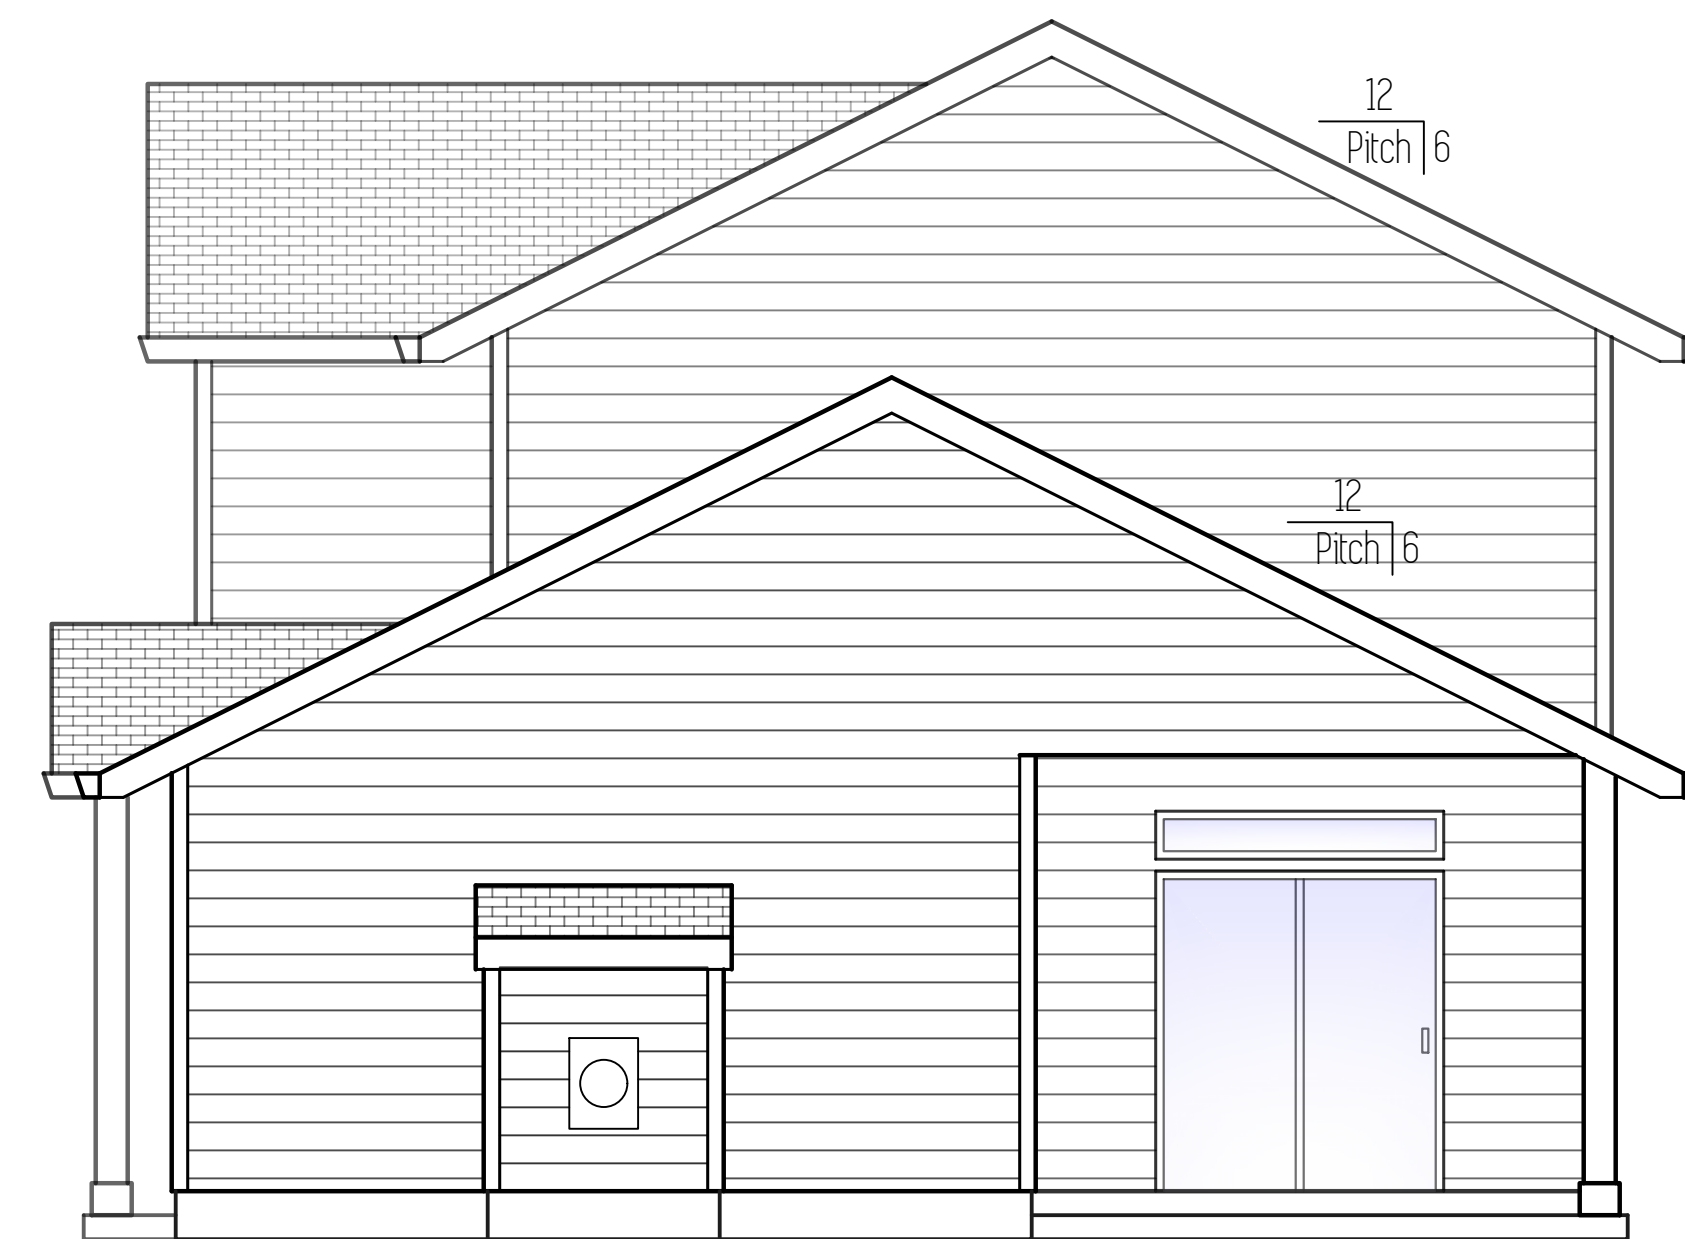

Right Elevation


Plan Name	Skamania
Date	2/11/2020
Location	Lone Oak Estates Lot 4 Battle Ground, WA

Total Sq Ft = 2,069

Elevations

Scale: 1/4" = 1'

This plan is property of:

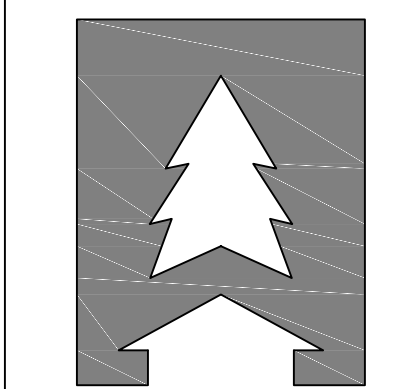


CEDARRIDGE
H O M E S

© 2020 Cedar Ridge Homes


(P) 503-666-4240
(F) 503-666-2408
www.cedarridgehomes.us

Designed by:
TYSON GREY
tyson@cedarridgehomes.us

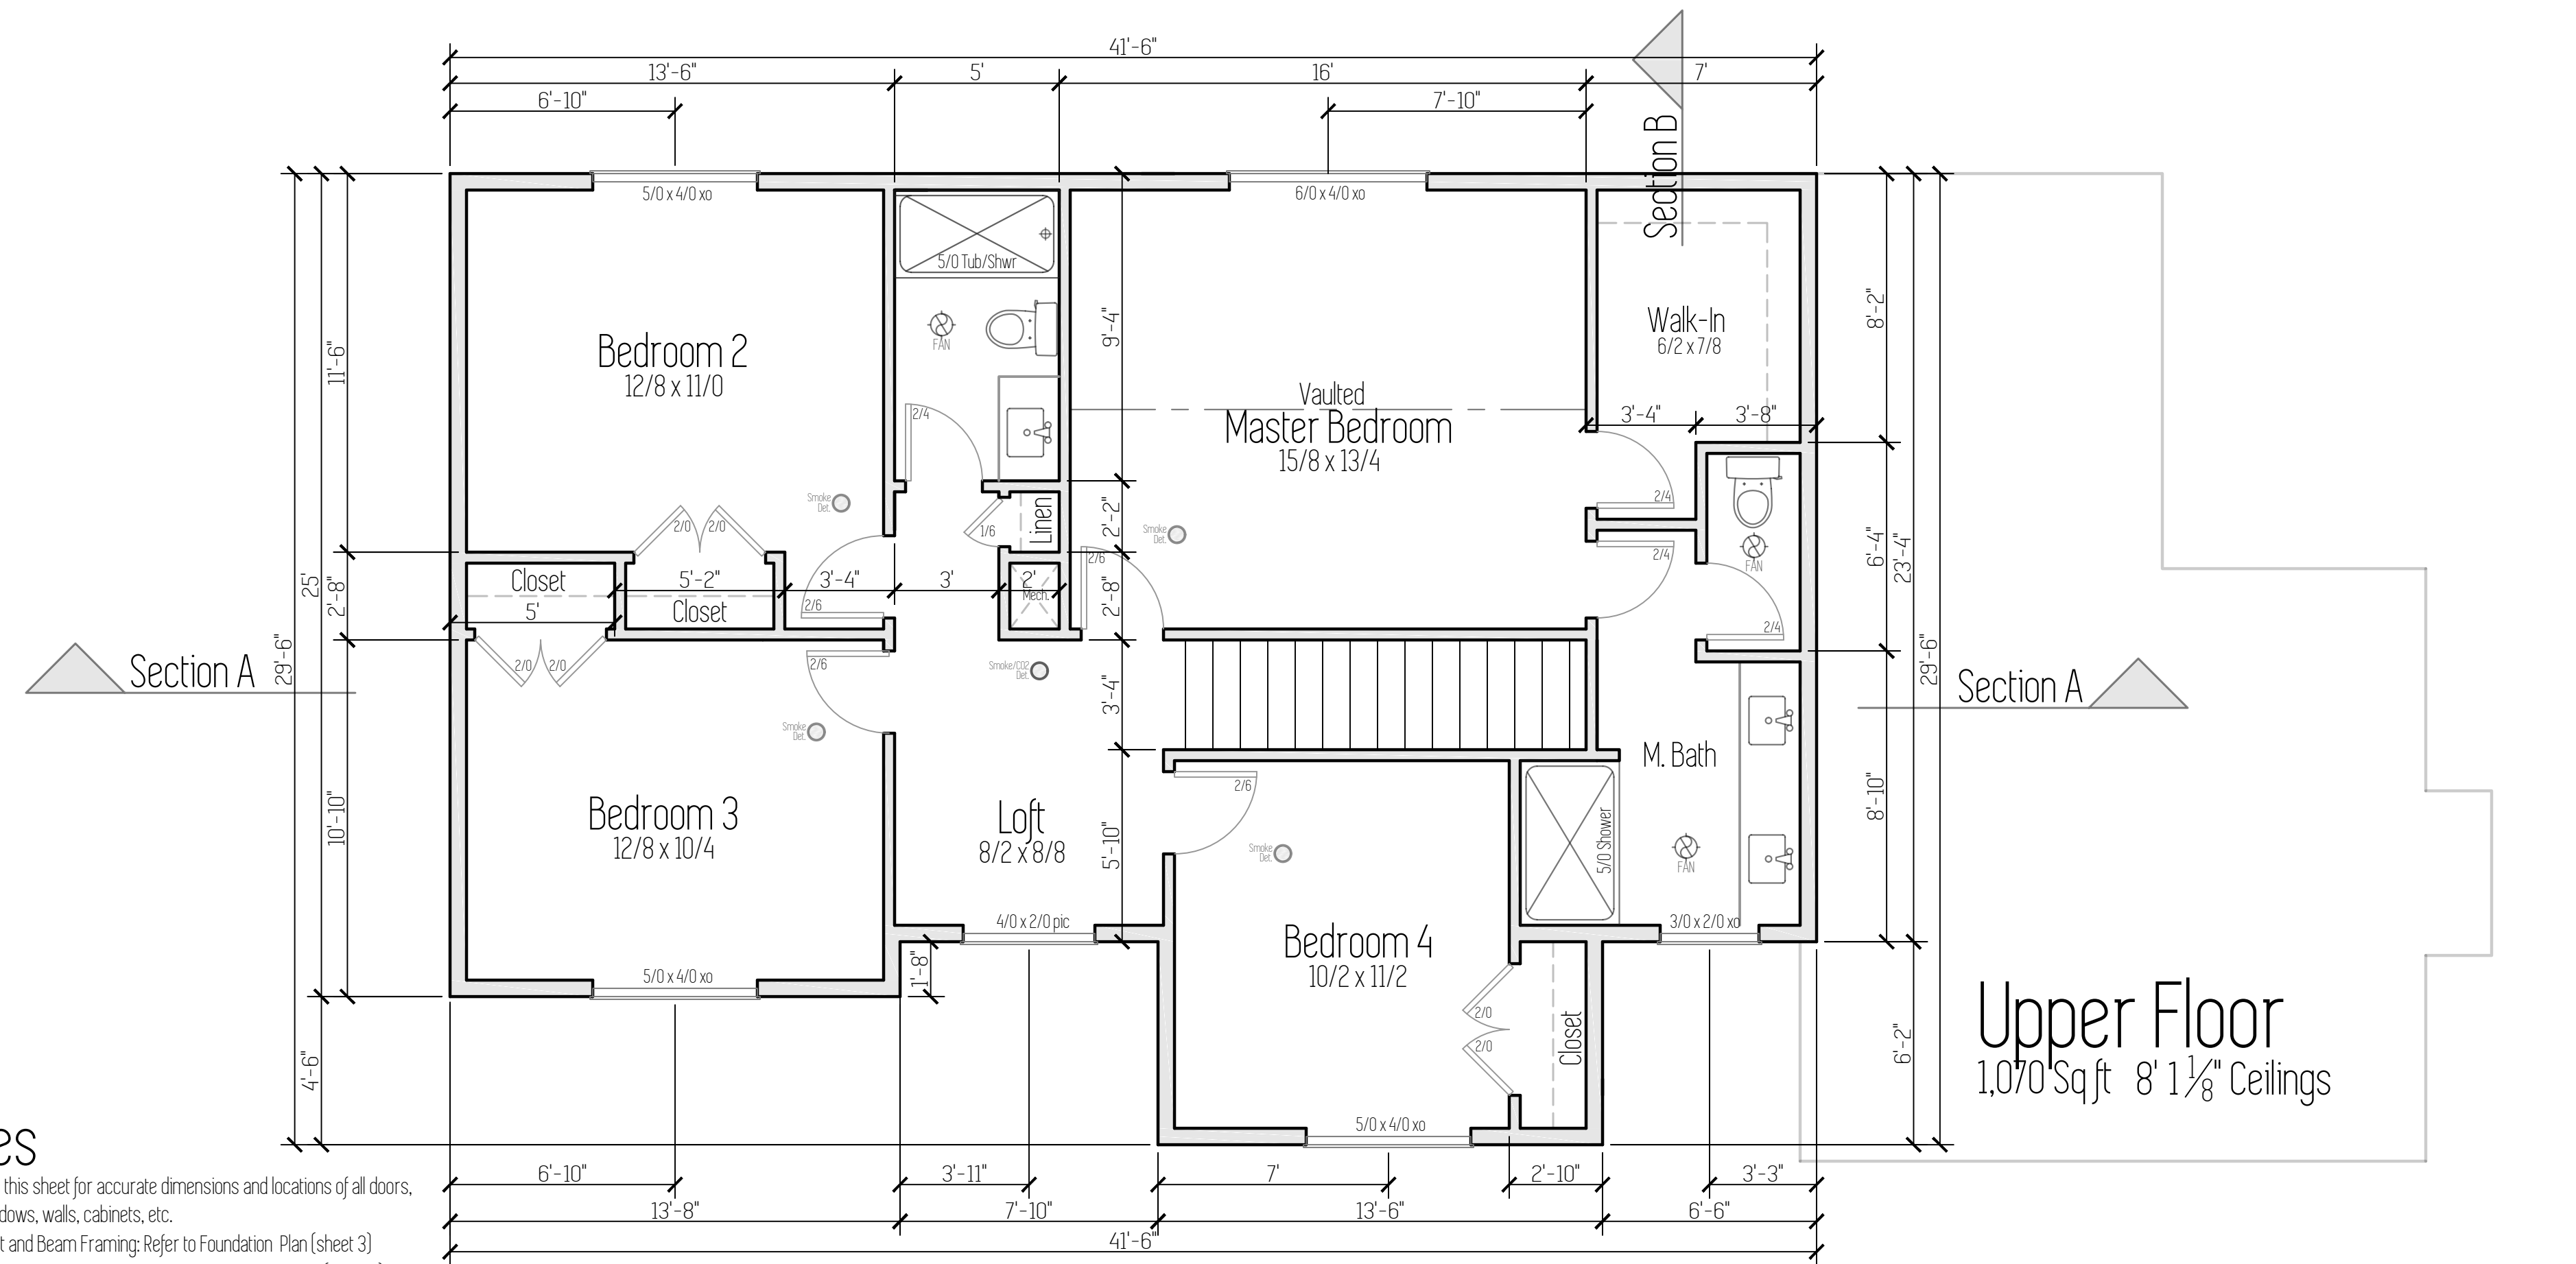

Notes

- Use this sheet for accurate dimensions and locations of all doors, windows, walls, cabinets, etc.
- Post and Beam Framing: Refer to Foundation Plan (sheet 3)
- Upper floor and Roof Framing: Refer to Framing Plan (sheet 4)
- All electrical to meet or exceed current minimum code requirements and is to be determined by owner.
- All fans shall have a mechanical ventilation system designed to exhaust a minimum of 80 cfm intermittent or 20 cfm continuous. Mechanical ventilation control systems shall be connected to a dehumidistat, timer or similar automatic control

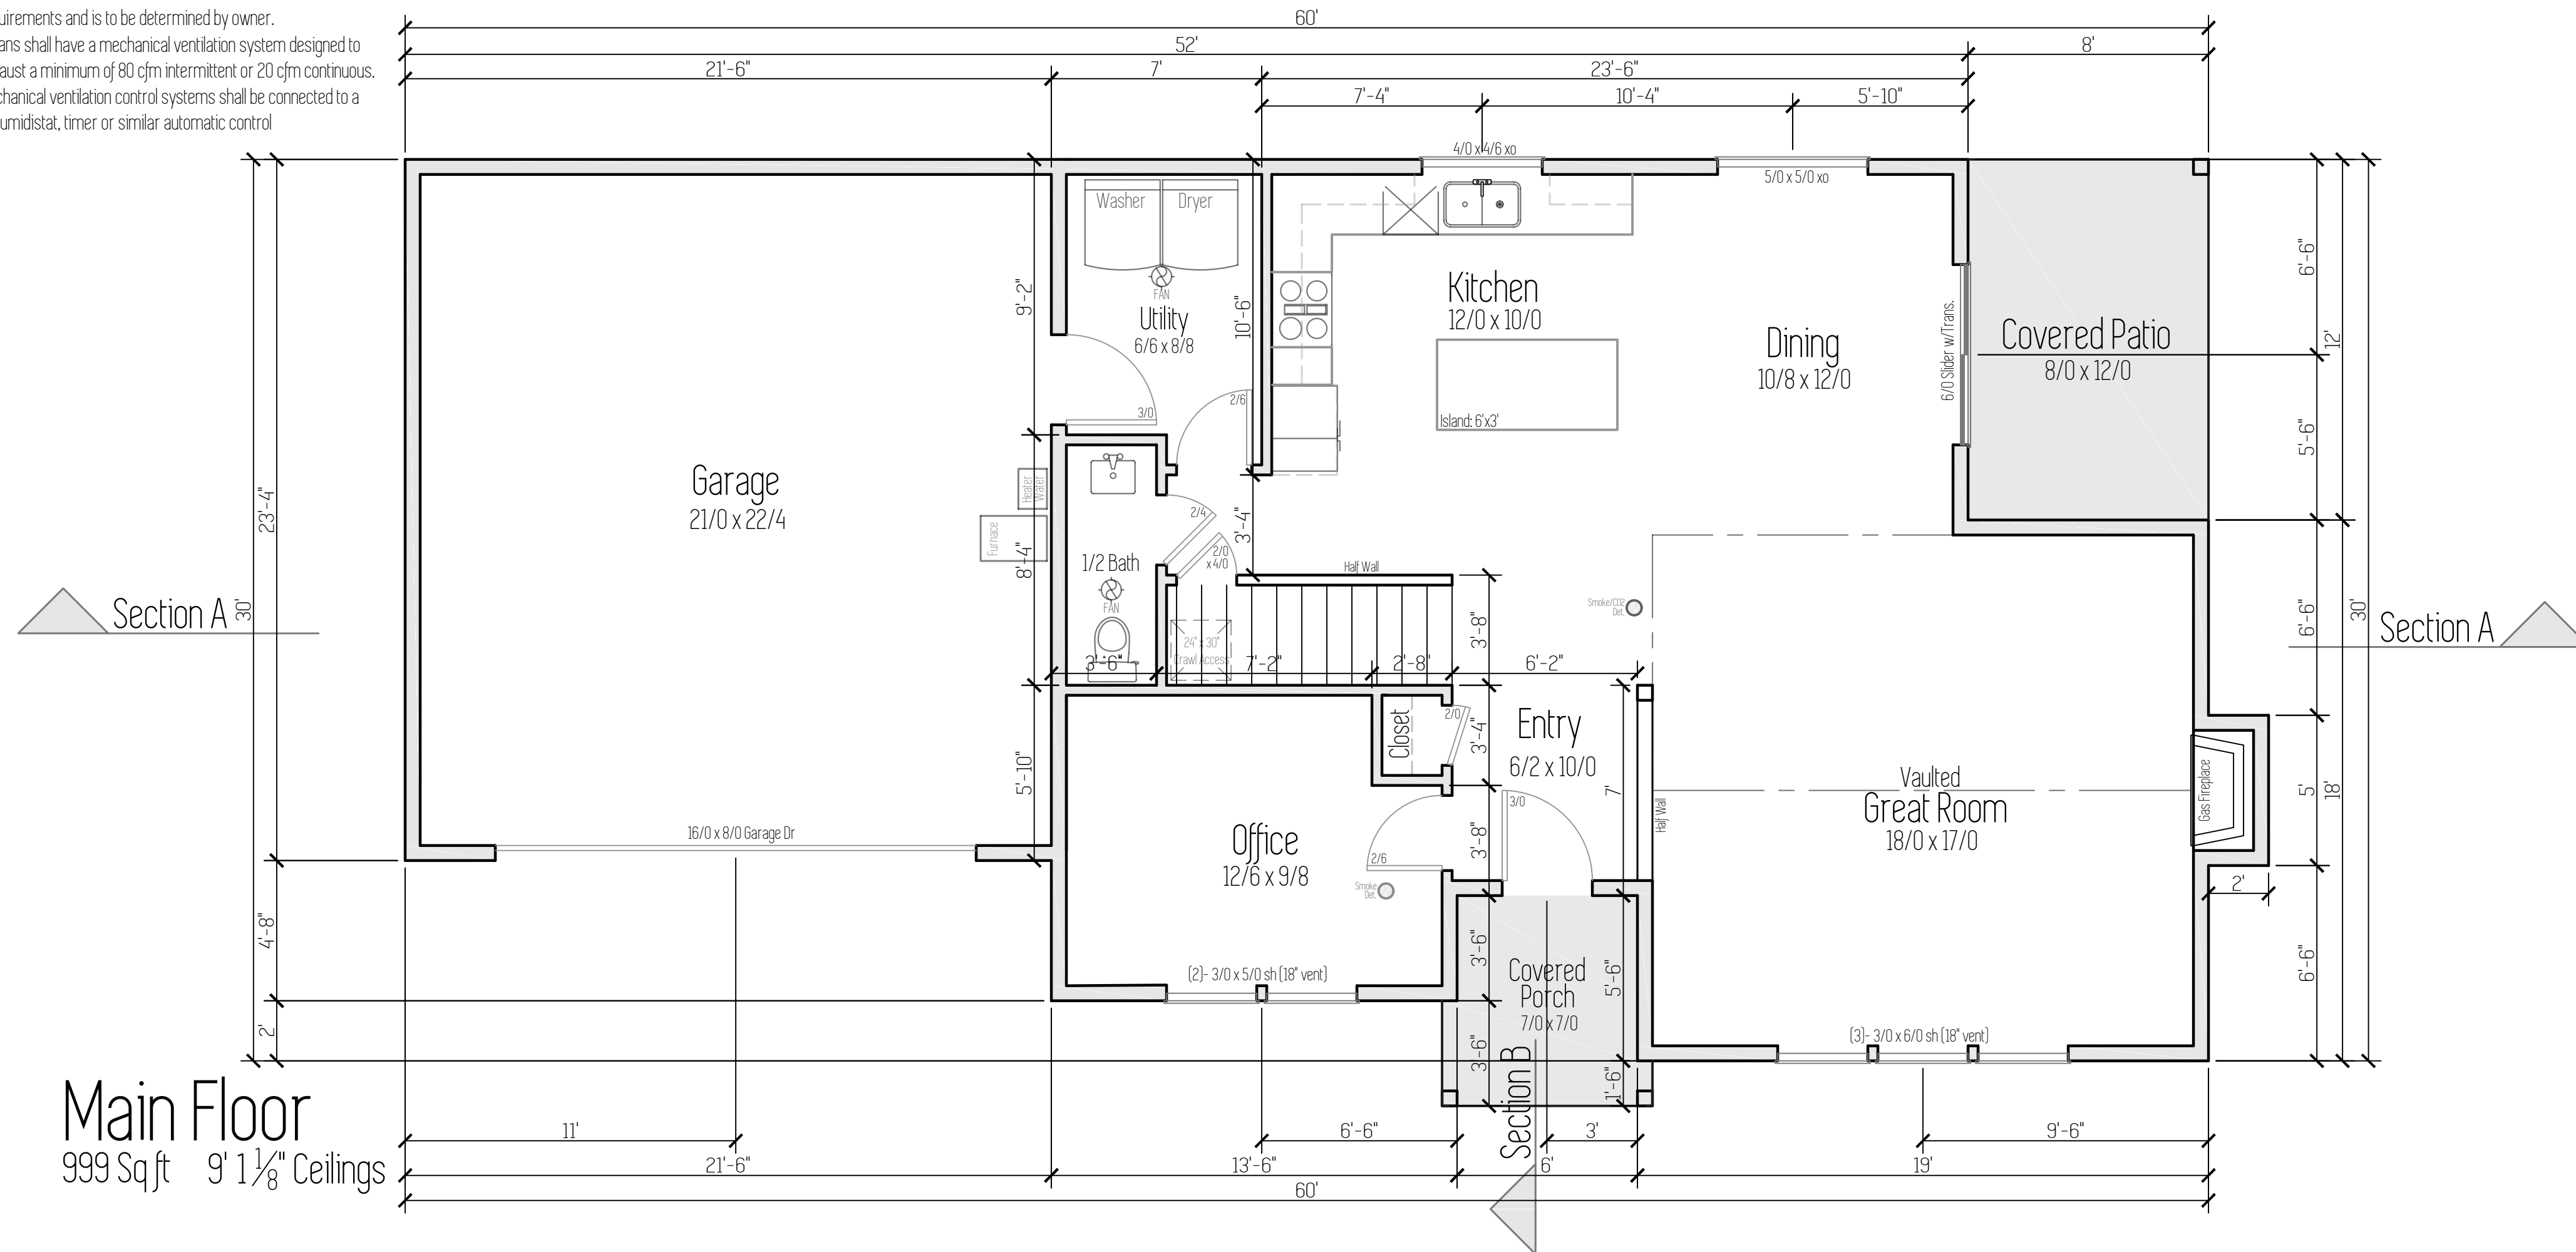


Plan Name	Skamania
Date	2/11/2020
Location	Lone Oak Estates Lot 4 Battle Ground, WA

Total Sq Ft = 2,069

Floor Plan

Scale : 1/4" = 1'

This plan is property of:

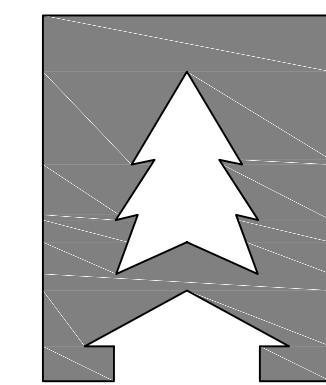

**CEDARRIDGE
HOMES**

© 2020 Cedar Ridge Homes

(P) 503-666-4240
(F) 503-666-2408
www.cedarridgehomes.us

Designed by:
TYSON GREY
tyson@cedarridgehomes.us


2

Plan Name	Skamania
Date	2/11/2020
Location	Lone Oak Estates Lot 4 Battle Ground, WA

Total Sq Ft = 2,069

Foundation Plan

This plan is property of:

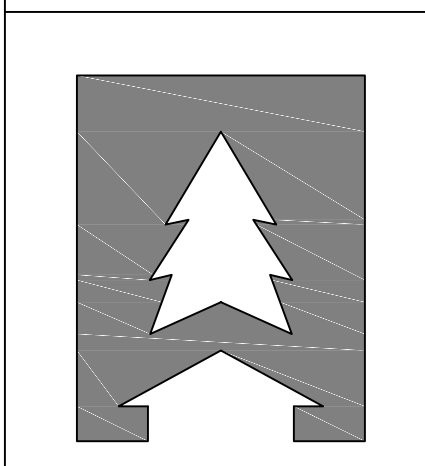

CEDARRIDGE
H O M E S

© 2020 Cedar Ridge Homes

(P) 503-666-4240
(F) 503-666-2408
www.cedarridgehomes.us

Designed by:

TYSON GREY
tyson@cedarridgehomes.us



3

Foundation Notes

- Concrete : Minimum 28 day concrete strength = 2500 psi.
- Grade beams, piers and spread footings shall be poured onto undisturbed, native soil which is free from any material that will adversely affect the soil bearing pressure.
- Footings are to be on undisturbed soil with an assumed 1500 PSF
- All slabs to be supported with a min. of 4" of compacted crushed rock fill.
- Beam pockets in concrete walls to have a min. 1/2" air space on sides, and min. 3" of bearing for all beams and girders.
- Typical pier pad to be 18" dia. x 8" concrete footing with 4x4 DF#2 post.
- Typical crawl space beam to be 4x8 DF#2. Single gusset plate to be used on both sides of attachment to post.
- Cover entire crawl space with 6 mil black visqueen vapor barrier.
- Excavate a min. of 18" below bottom of all beams.
- Install 15" x 7" closable FND vents in FND walls. Min 1 sq ft vented area for every 150 sq ft of crawl space.
- Refer to Shear Wall Schedule and Hold-Down Schedule for sill bolt spacing and hold-down size. (PAGE S1.0)

Footing Schedule	
F1	24" x 24" x 8" Concrete footing with (2) #4 bars each way.
F2	27" x 27" x 8" Concrete footing with (2) #4 bars each way.
F3	30" x 30" x 8" Concrete footing with (3) #4 bars each way.
F4	33" x 33" x 10" Concrete footing with (3) #4 bars each way.
F5	36" x 36" x 8" Concrete footing with (3) #4 bars each way.

- ▨ Shear Wall Panel
- ▨ Interior Bearing Wall (above)
- HoldDown

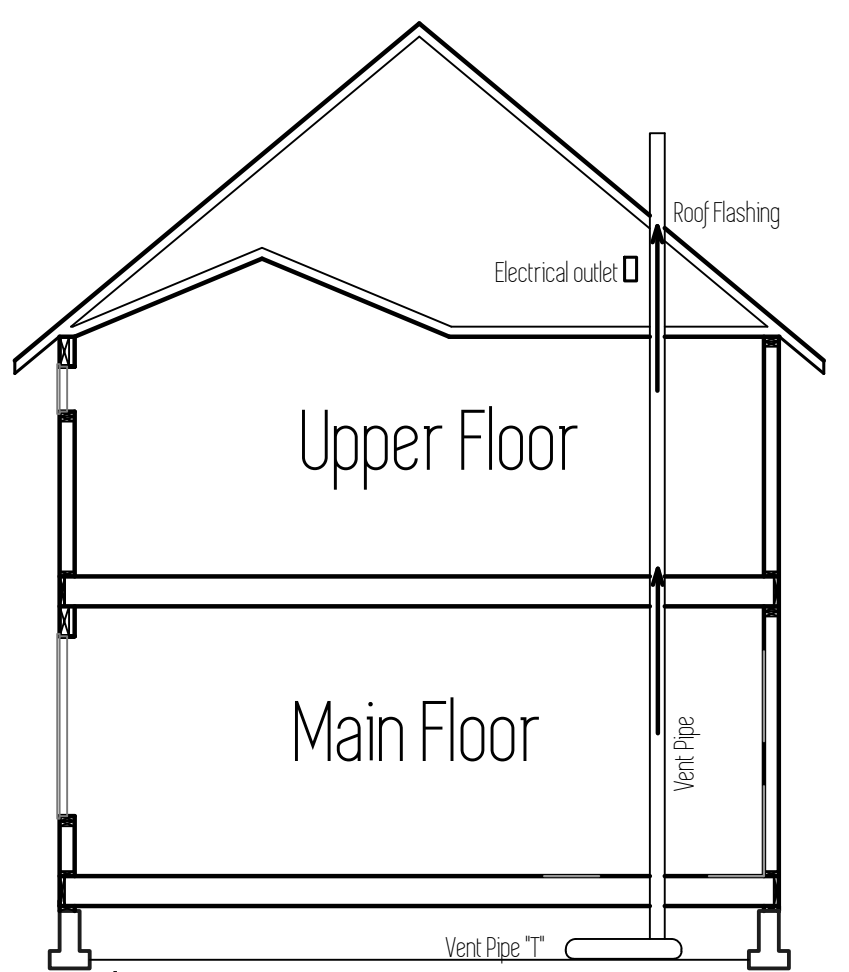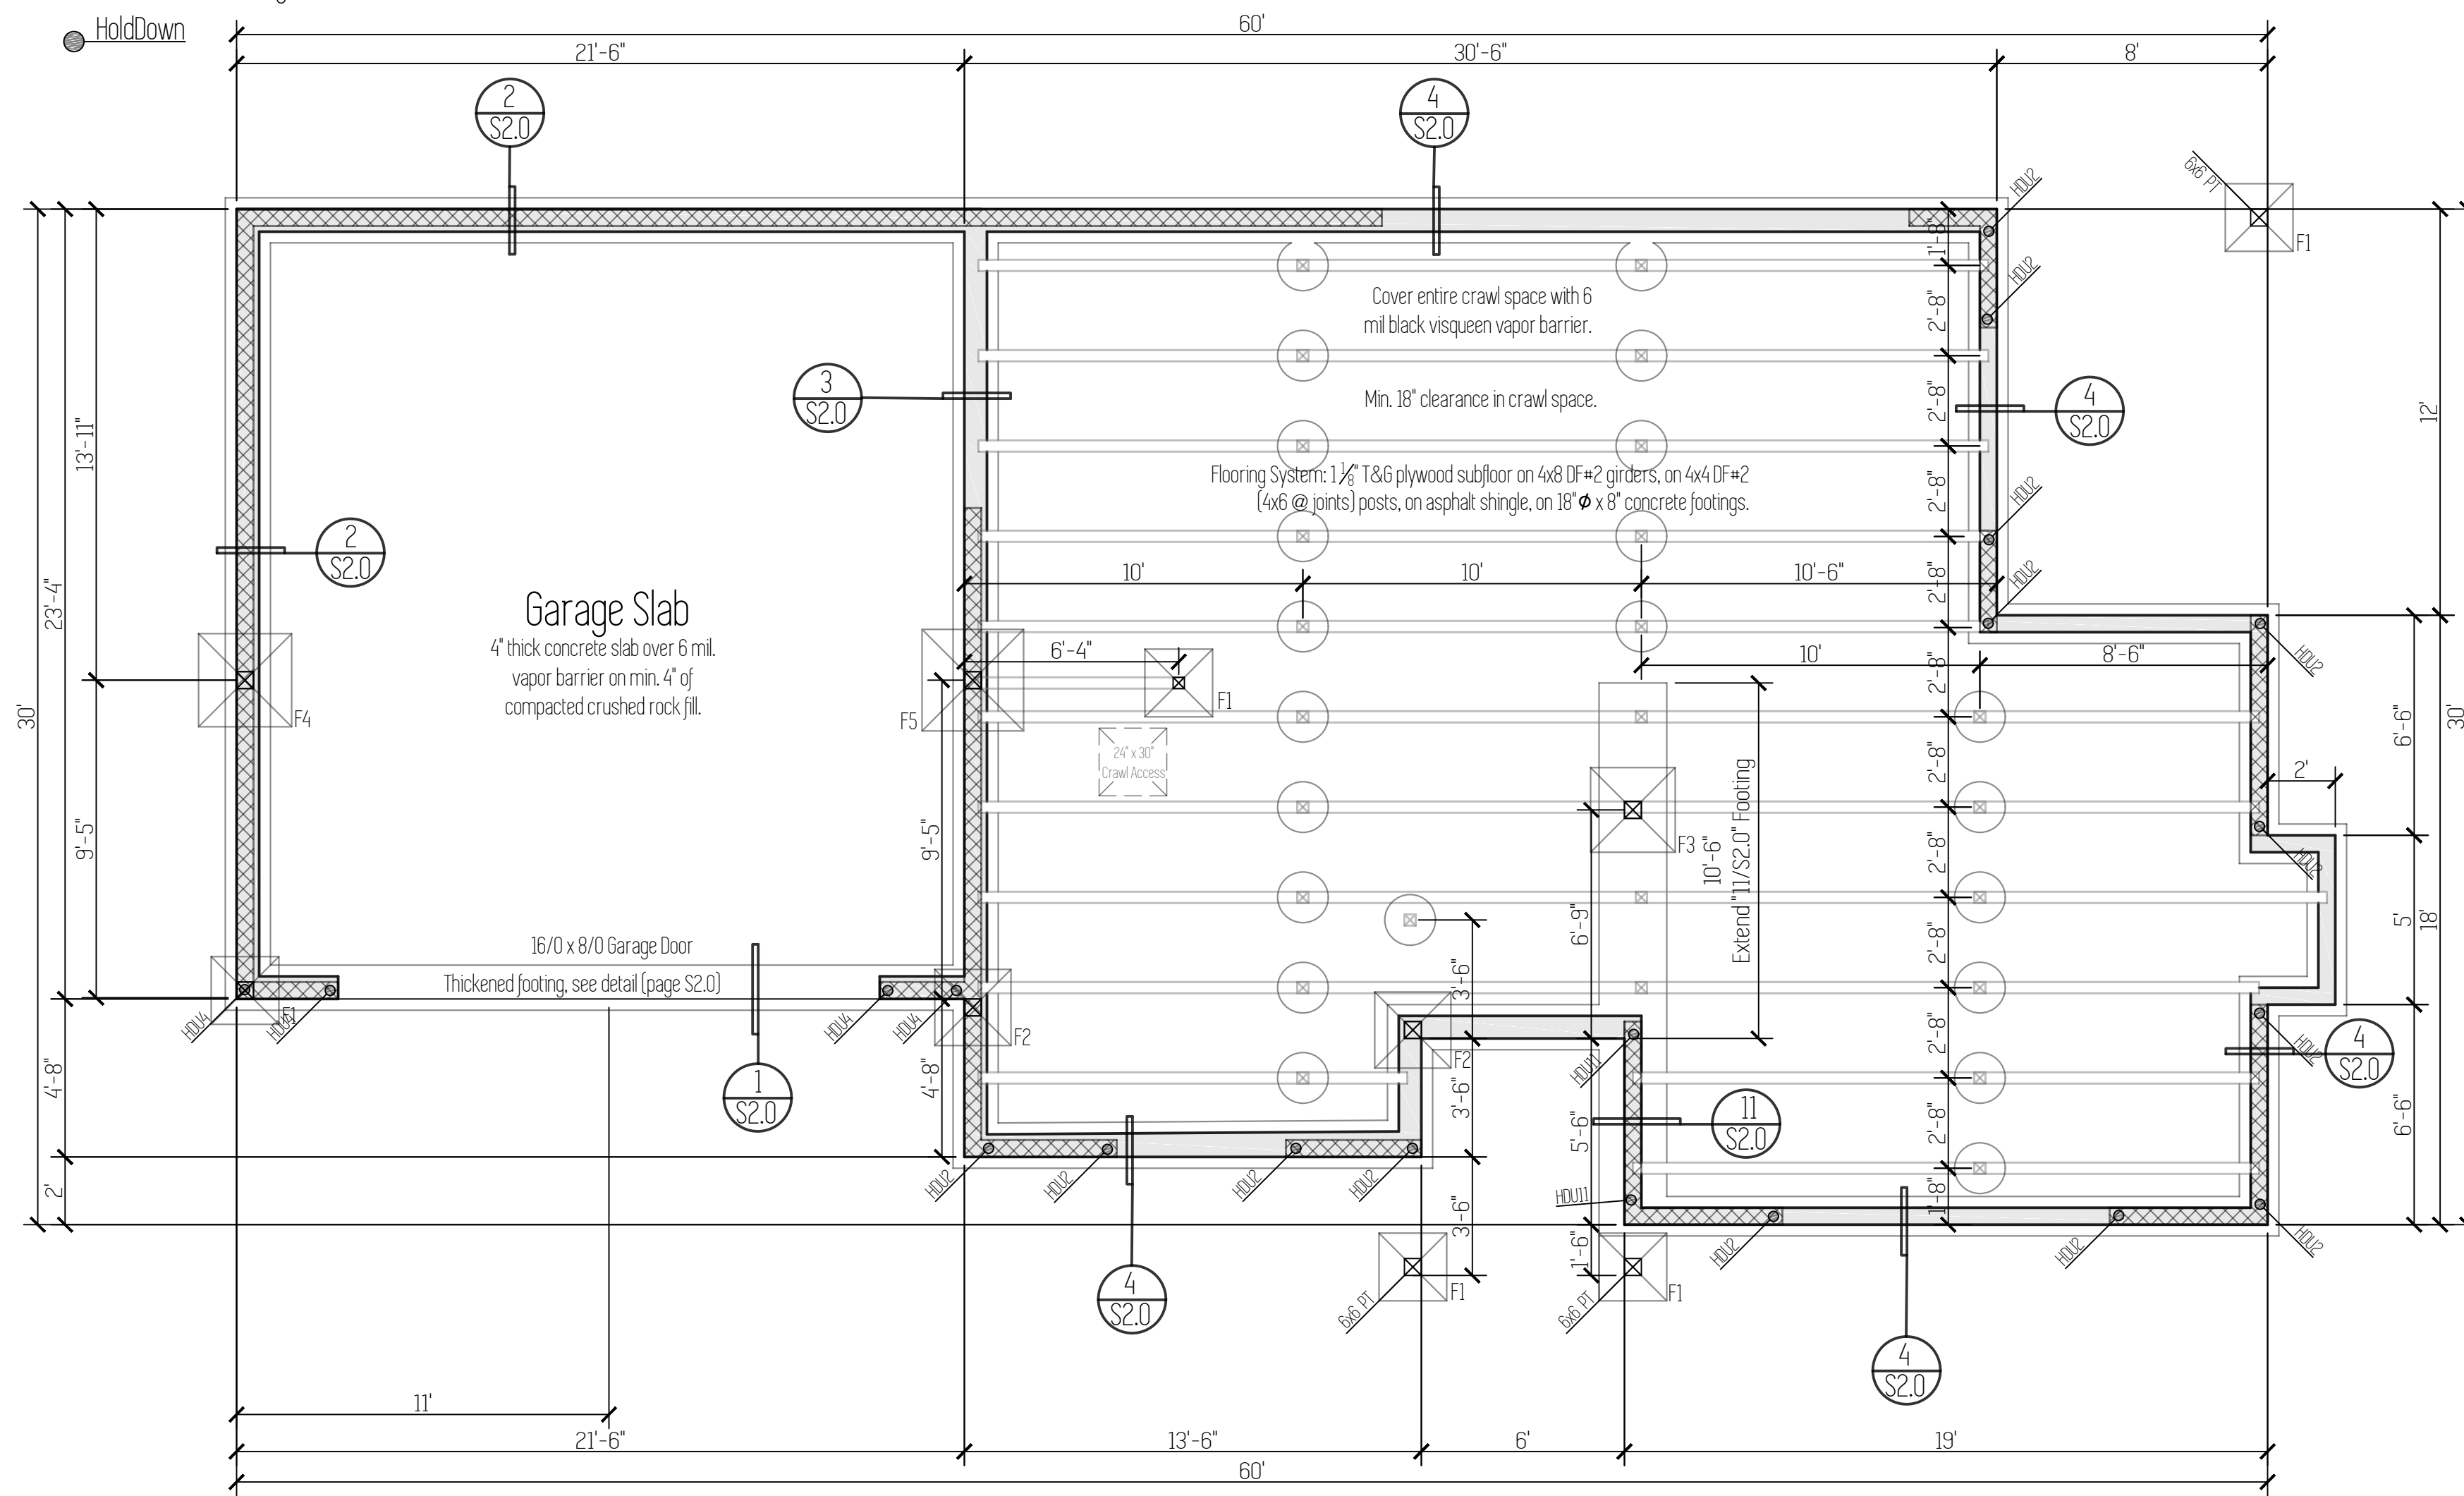

Radon Passive System

AF103.5.3 Vent Pipe
A plumbing tee or other approved connection shall be inserted horizontally beneath the sheathing and connected to a 3- or 4-inch-dia. fitting with a vertical vent pipe installed through the sheathing. The vent pipe shall be extended up through the building floors, terminate at least 12" above roof in a location at least 10' away from any window or other opening into the conditioned spaces of the building that is less than 2' below the exhaust point, and 10' from any window or other opening adjoining or adjacent buildings.
*Install electrical outlet in attic at vent pipe for future fan.


Plan Name	Skamania
Date	2/11/2020
Location	Lone Oak Estates Lot 4 Battle Ground, WA

Total Sq Ft = 2,069

Framing Plan

Scale : 1/4" = 1'

This plan is property of:

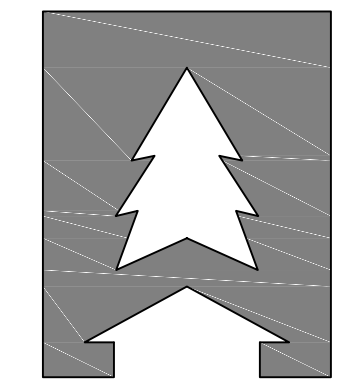

**CEDARRIDGE
HOMES**

© 2020 Cedar Ridge Homes


(P) 503-666-4240
(F) 503-666-2408
www.cedarridgehomes.us

Designed by:
TYSON GREY
tyson@cedarridgehomes.us

4

Roof Framing Plan

1. Refer to sheet S1.0 for details on Shear Panels and Strapping.
2. Exterior Headers to be 4x8 DF#2 (max. span 6') U.N.O.
3. Interior Headers to be 4x8 DF#2 (max. span 4') U.N.O.
4. Typical exterior wall post to be (2)-2x6 DF#2 (bundled stud), fasten each stud together w/16d nails @ 12" o/c, typ. entire length of stud, u.n.o. Typical interior wall post to be (2)-2x4 DF#2 (bundled stud), fasten each stud together w/16d nails @ 12" o/c, typ. entire length of stud, u.n.o.
5. Exterior post caps to be Simpson "PC" or "EPC", if exposed condition coat per manufacture's specs with exterior exposed and P.T. material.

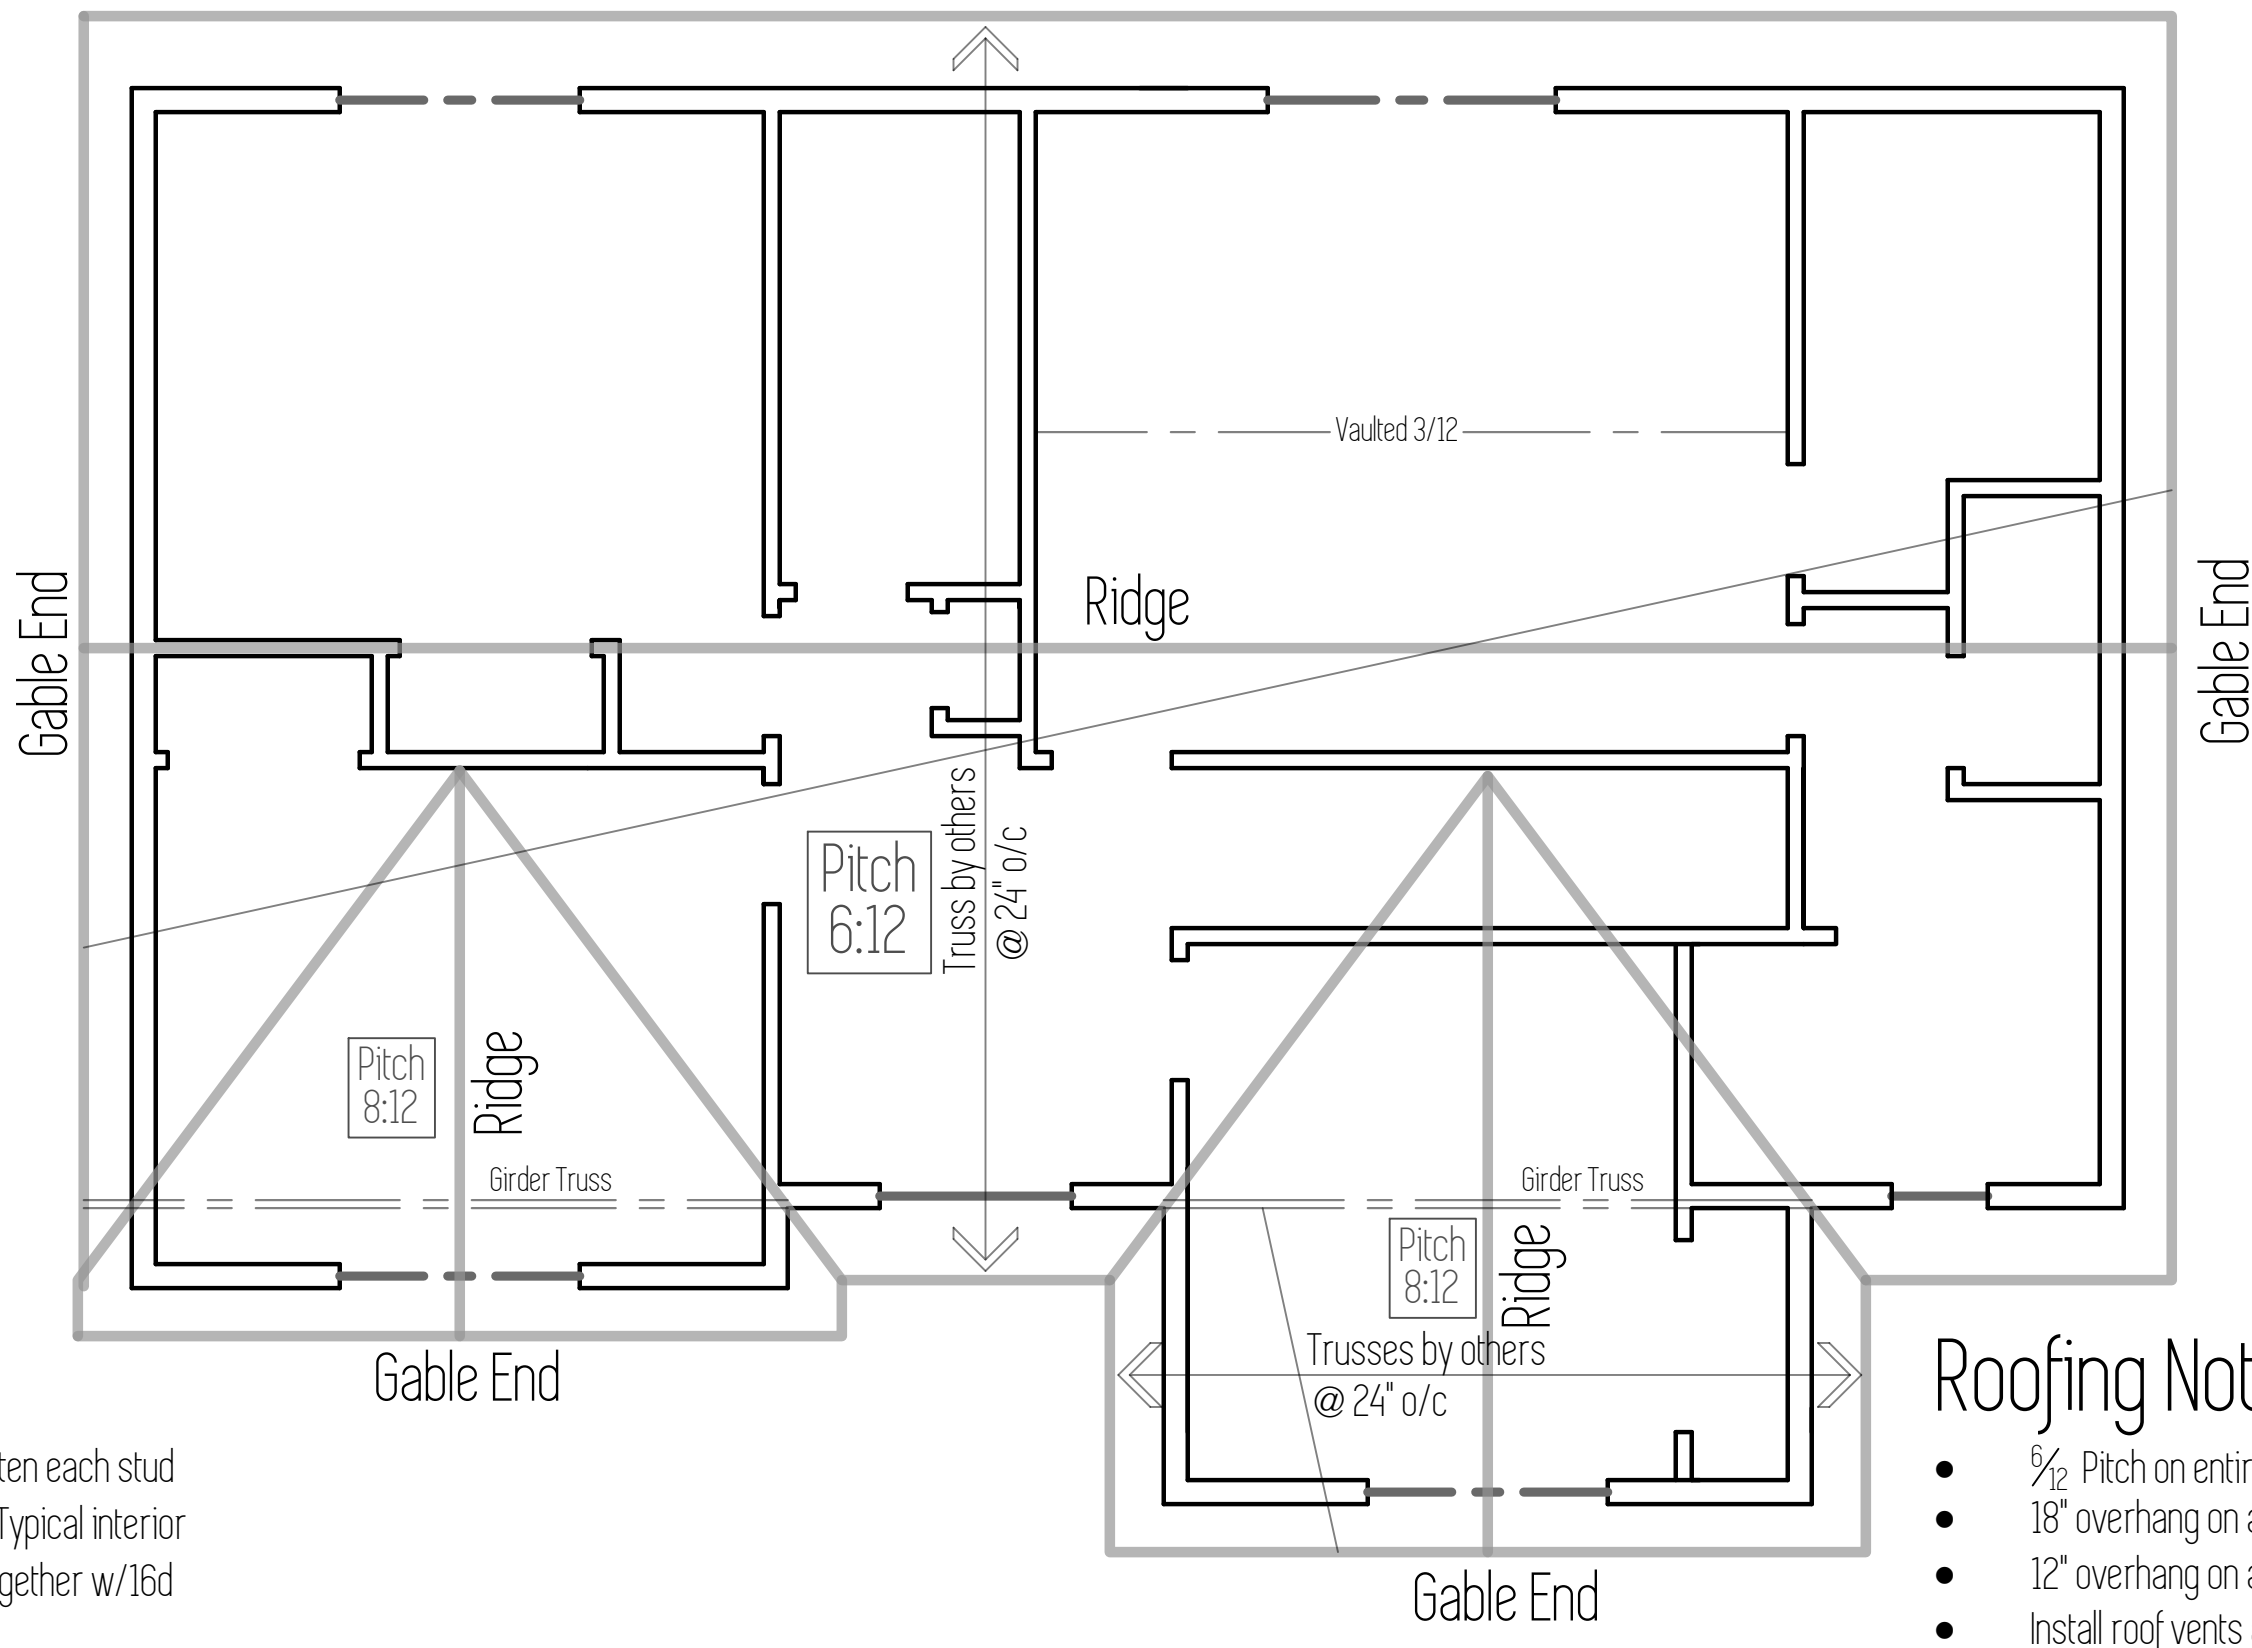


Roofing Notes


- 8/12 Pitch on entire roof.
- 18" overhang on all eaves.
- 12" overhang on all gable ends.
- Install roof vents along ridge @ 4' o.c.

Upper Floor & Lower Roof Framing Plan


1. Refer to sheet S1.0 for details on Shear Panels and Strapping.
2. Exterior Headers to be 4x12 DF#2 (max. span 4') U.N.O.
3. Interior Headers to be 4x8 DF#2 (max. span 4') U.N.O.
4. Typical exterior wall post to be (2)-2x6 DF#2 (bundled stud), fasten each stud together w/16d nails @ 12" o/c, typ. entire length of stud, u.n.o. Typical interior wall post to be (2)-2x4 DF#2 (bundled stud), fasten each stud together w/16d nails @ 12" o/c, typ. entire length of stud, u.n.o.
5. Exterior post caps to be Simpson "PC" or "EPC", if exposed condition coat per manufacture's specs with exterior exposed and P.T. material.

Interior Bearing Wall

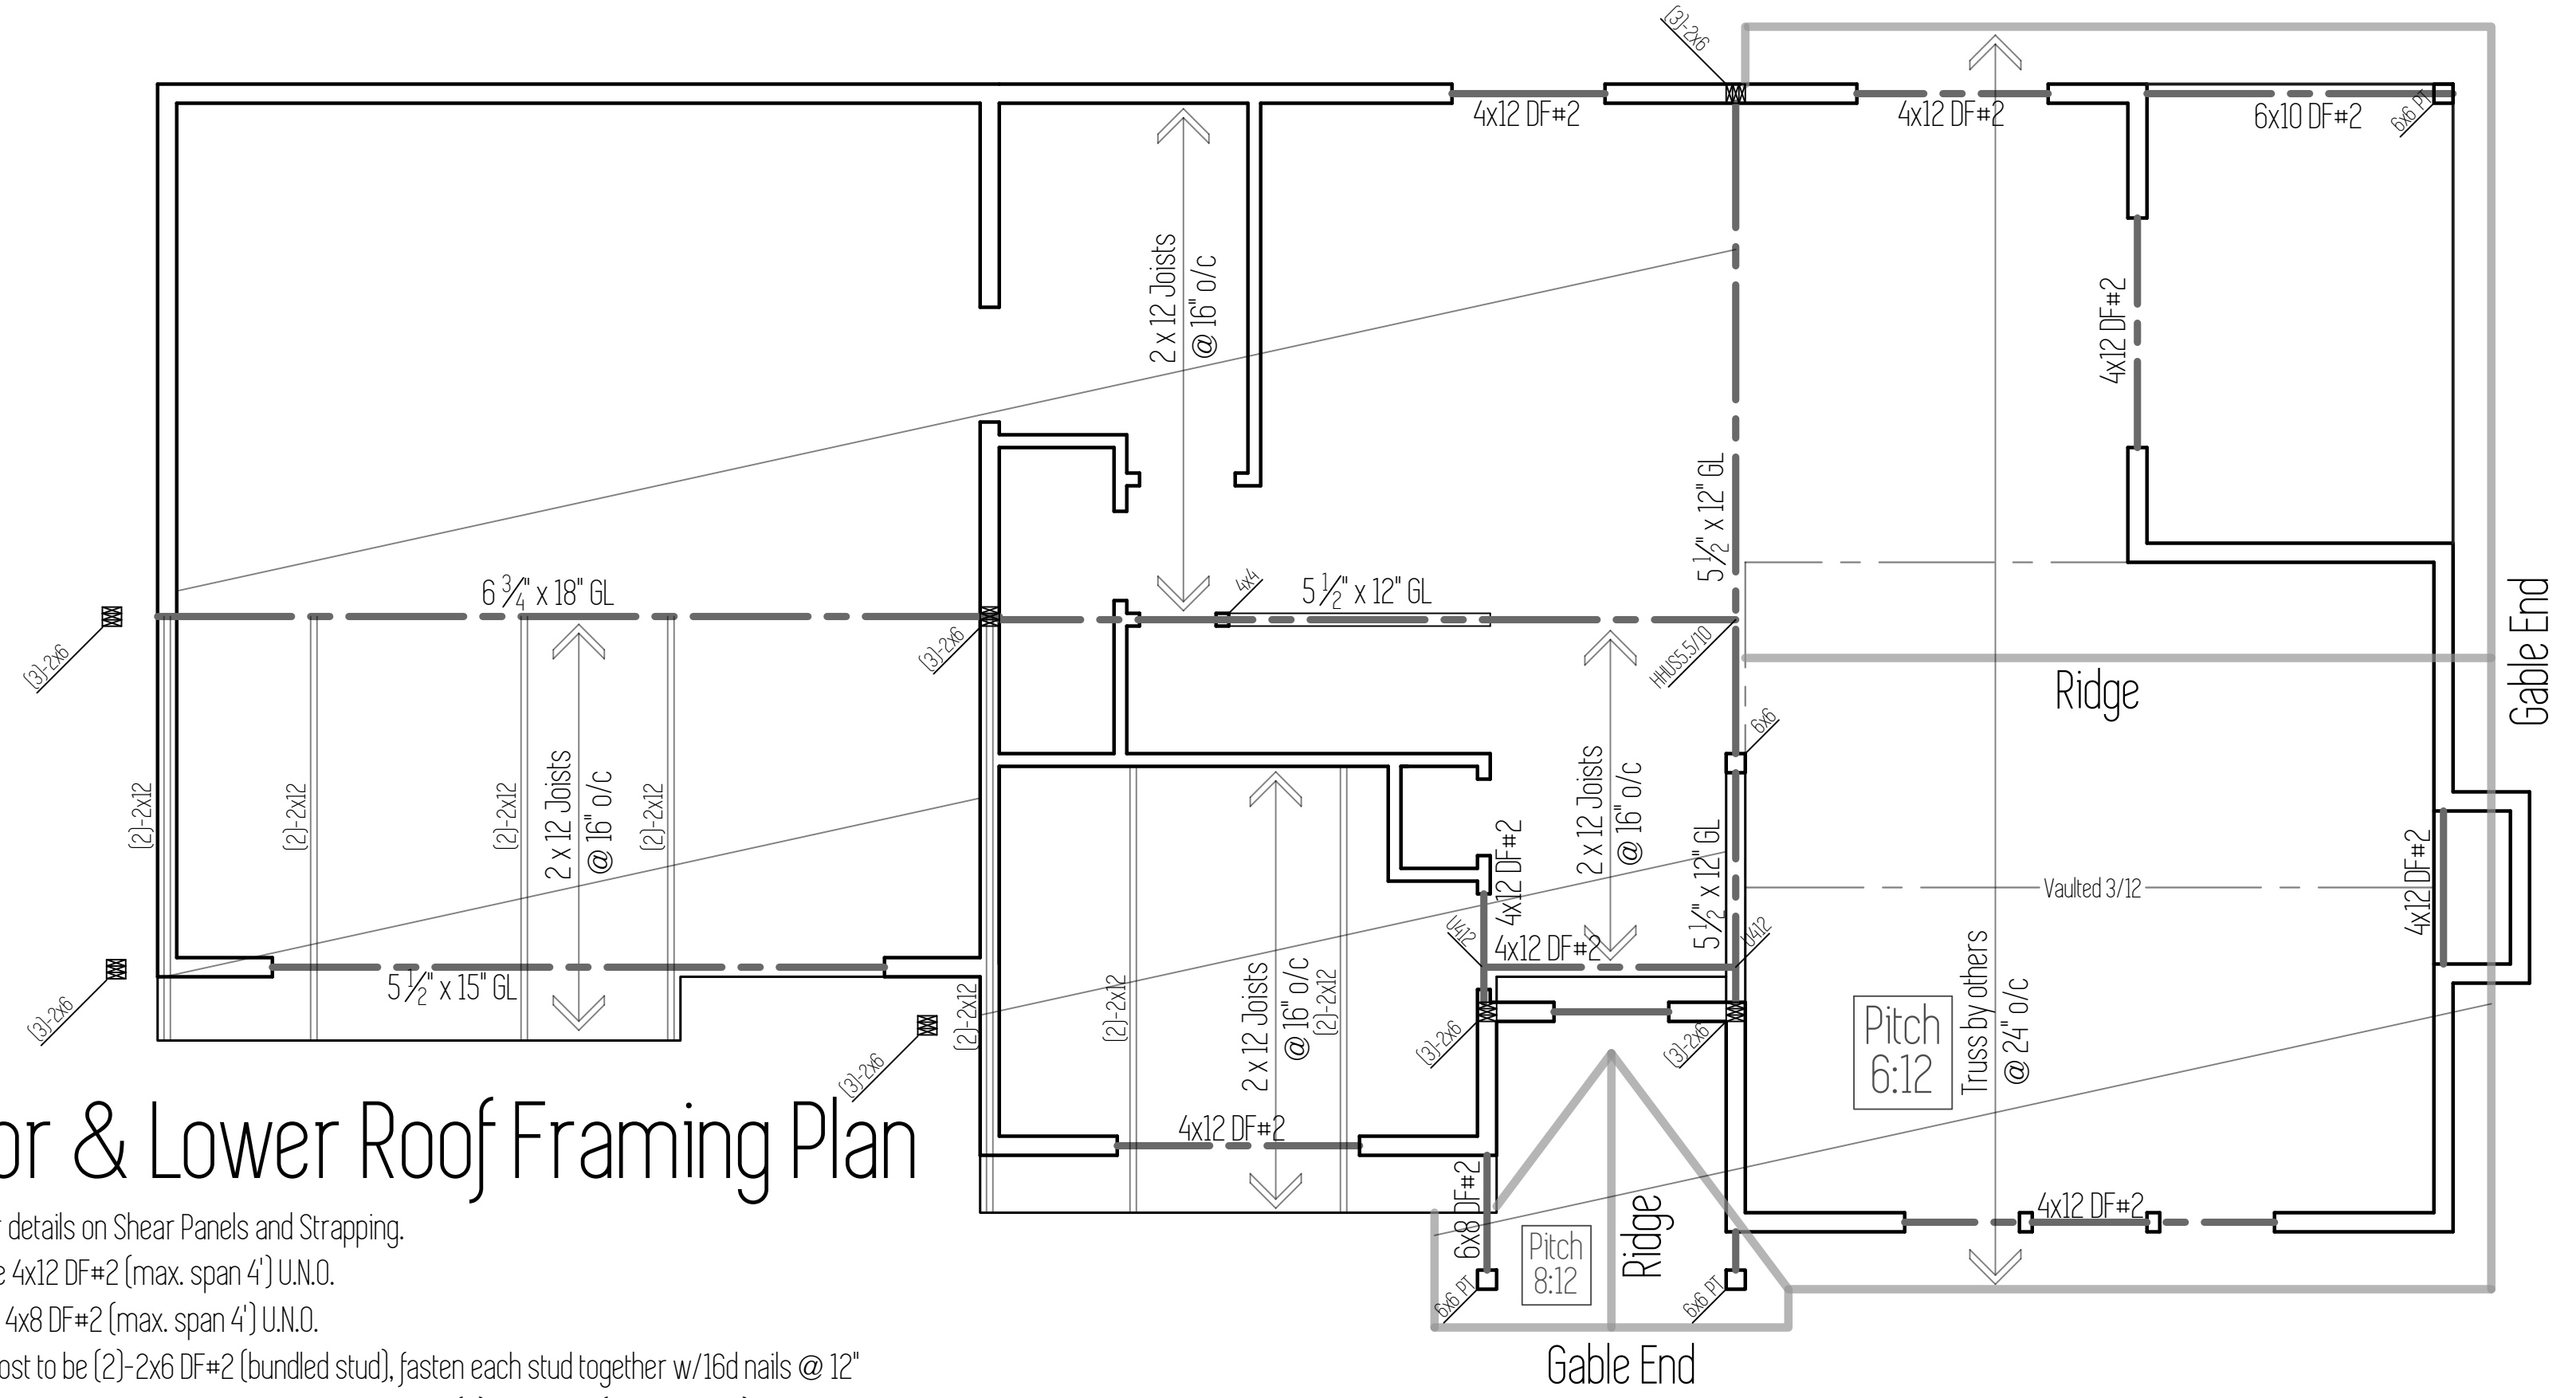

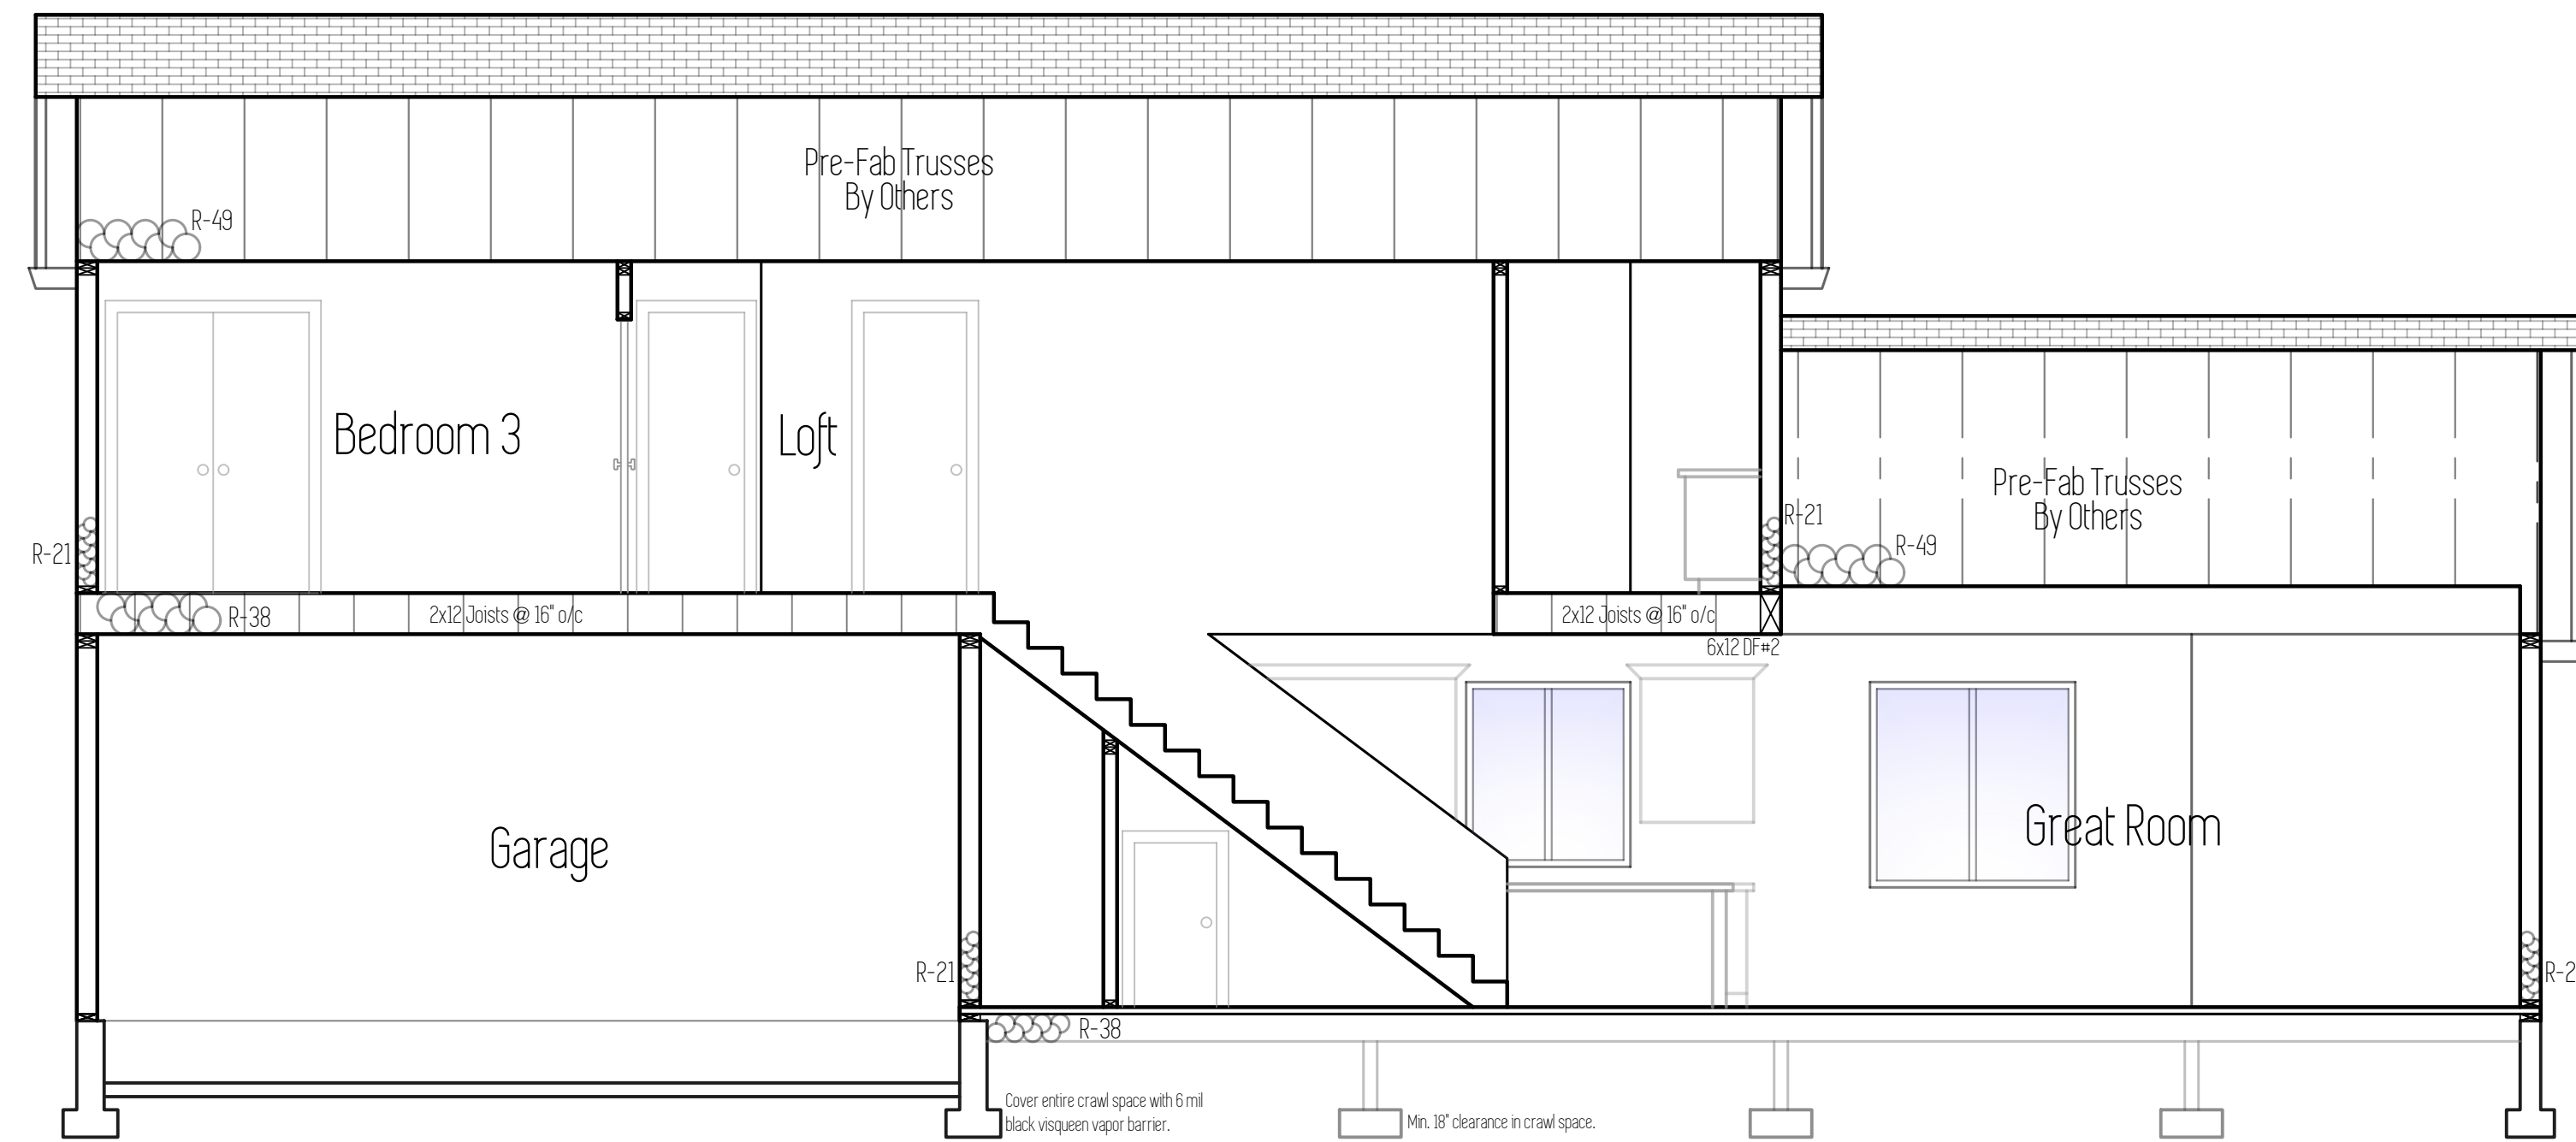

Section A

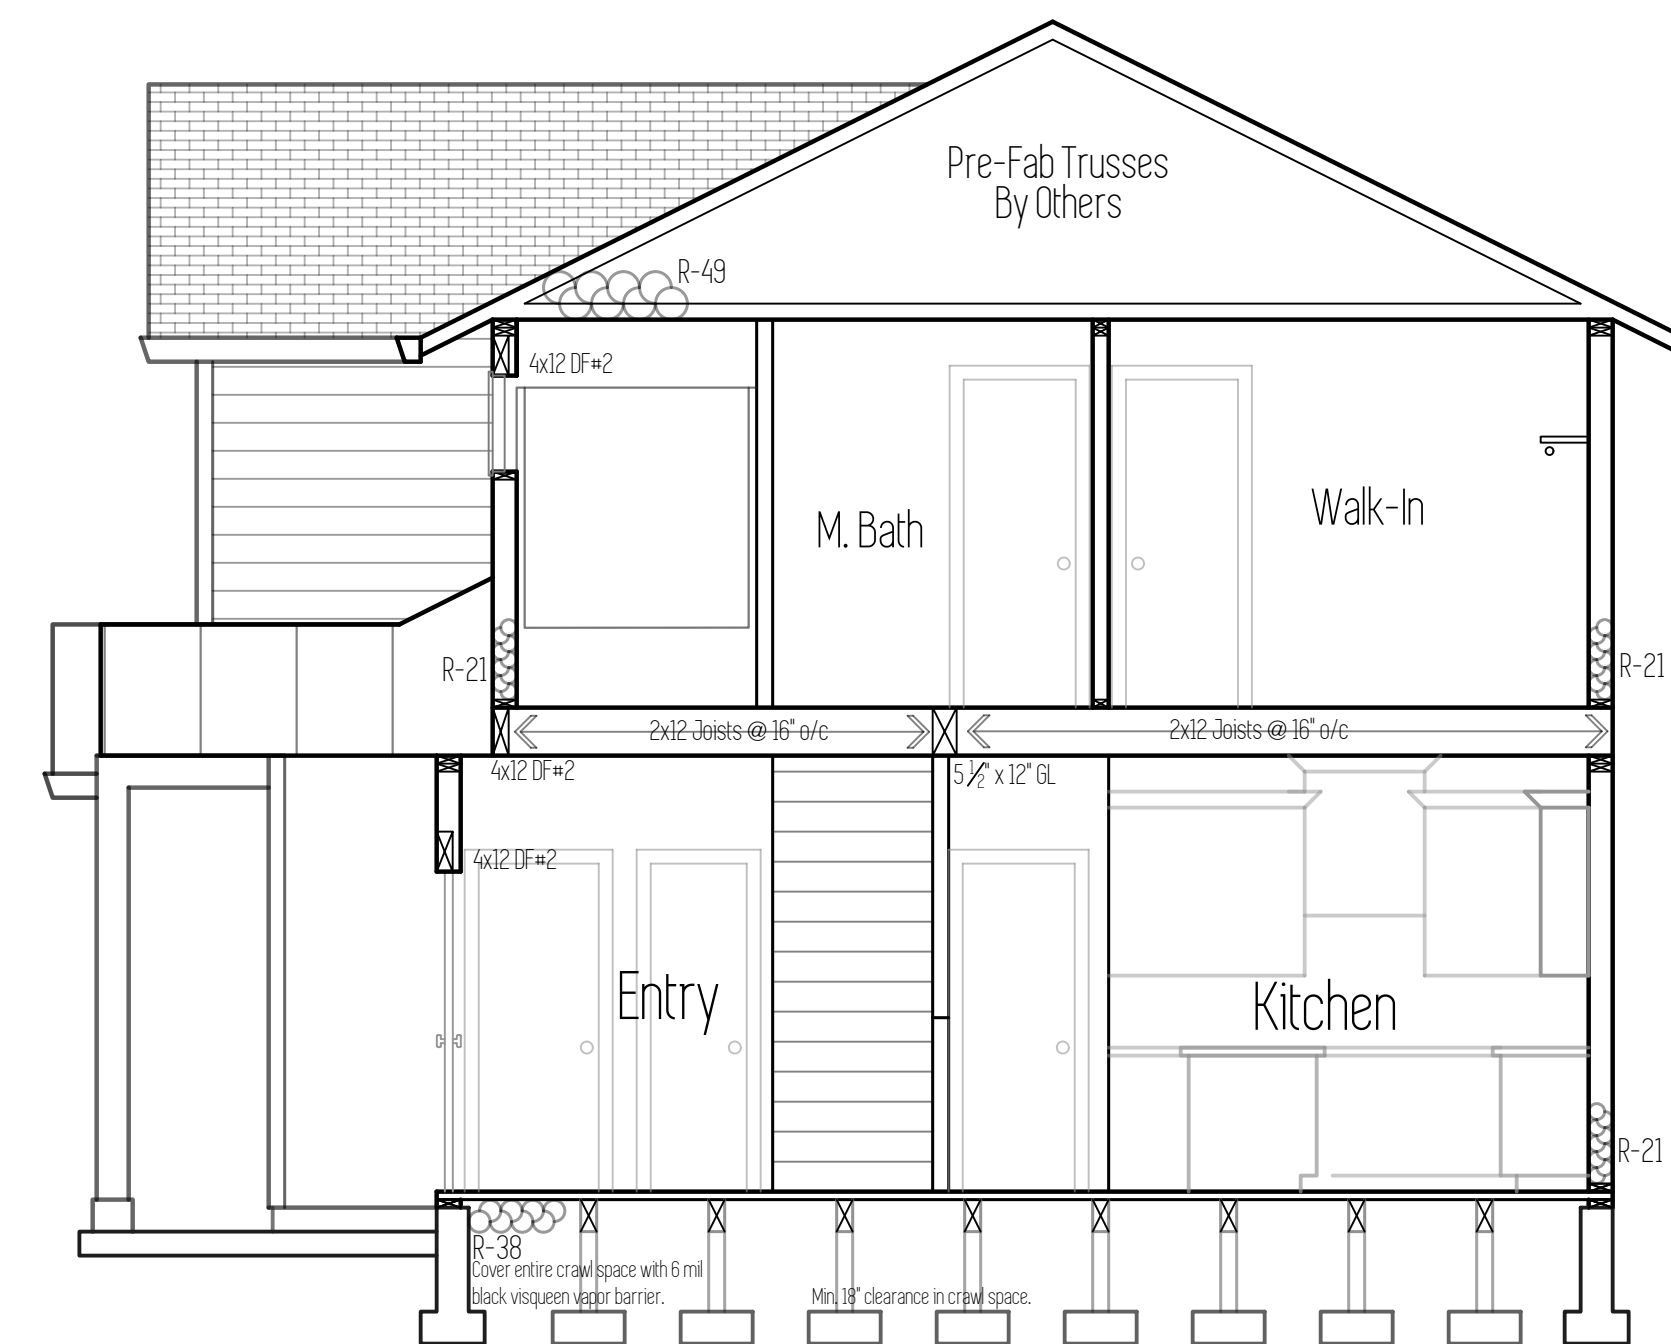

Section B


Plan Name	Skamania
Date	2/11/2020
Location	Lone Oak Estates Lot 4 Battle Ground, WA

Sections

Total Sq Ft = 2,069

Scale : 1/4" = 1'

This plan is property of:

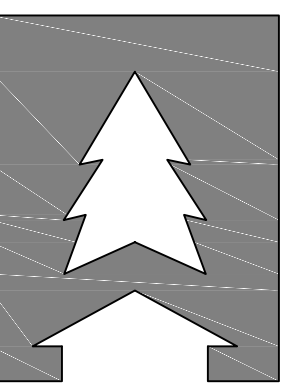

CEDARRIDGE
H O M E S

© 2020 Cedar Ridge Homes

(P) 503-666-4240
(F) 503-666-2408
www.cedarridgehomes.us

Designed by:

TYSON GREY
tyson@cedarridgehomes.us

SUMMARY OF WORK:


LOCATION: LOC LOT 4 BATTLE GROUND, WASHINGTON
STRUCTURAL ANALYSIS AND DESIGN FOR SINGLE FAMILY RESIDENCE

DESIGN LOADS:


- CODE: 2015 IBC
- USE OR OCCUPANCY OF BUILDINGS AND STRUCTURES RISK CATEGORY (ASCE TABLE 1.5-1): II
- WIND SPEED Valt: 135 MPH EXPOSURE B, V_{basd} = 105 MPH (IBC EQUATION 16-33)
- SEISMIC DESIGN CATEGORY: D
- GROUND SNOW LOAD: 25 PSF (ROOF SNOW LOAD: 25 PSF)
- ROOF DEAD LOAD: 17 PSF
- FLOOR LIVE LOAD: 40 PSF
- FLOOR DEAD LOAD: 10 PSF
- SOIL BEARING PRESSURE: 1500 PSF
- SOIL PASSIVE SOIL PRESSURE: 200 PSF

FRAMING REQUIREMENTS:


- WALL STUDS TO BE 2X6 DFL-#2 @ 16" O.C., TYPICAL U.N.O.
- ROOF SHEATHING TO BE 1/2" APA RATED CDX SHEATHING OR OSB. INSTALL PANELS HORIZONTALLY. SPACE 8d NAILS MAXIMUM 6" O.C. ALONG PANEL EDGES. FOR OTHER CONDITIONS, SPACE 8d NAILS MAXIMUM 12" O.C. ON INTERMEDIATE SUPPORTS.
- TYPICAL WALL SHEATHING (TSN) TO BE 1/2" APA RATED CDX SHEATHING OR OSB. ALL PANEL EDGES TO BE BACKED WITH 2-INCH NOMINAL OR WIDER FRAMING. INSTALL PANELS HORIZONTALLY OR VERTICALLY. SPACE 8d NAILS MAXIMUM 6" O.C. ALONG PANEL EDGES. FOR OTHER CONDITIONS AND PANEL THICKNESSES, SPACE 8d NAILS MAXIMUM 12" O.C. ON INTERMEDIATE SUPPORTS.
- FLOOR SHEATHING TO BE 1/2" APA RATED CDX SHEATHING OR OSB. SPACE 8d NAILS MAXIMUM 6" O.C. ALONG PANEL EDGES. FOR OTHER CONDITIONS, SPACE 8d NAILS MAXIMUM 12" O.C. ON INTERMEDIATE SUPPORTS.
- SILL PLATE TO BE 2X P.T. U.N.O. (REFER TO SILL BOLT SPACING IN SCHEDULE BELOW).
- FOR NAIL SIZES REFER TO BELOW.

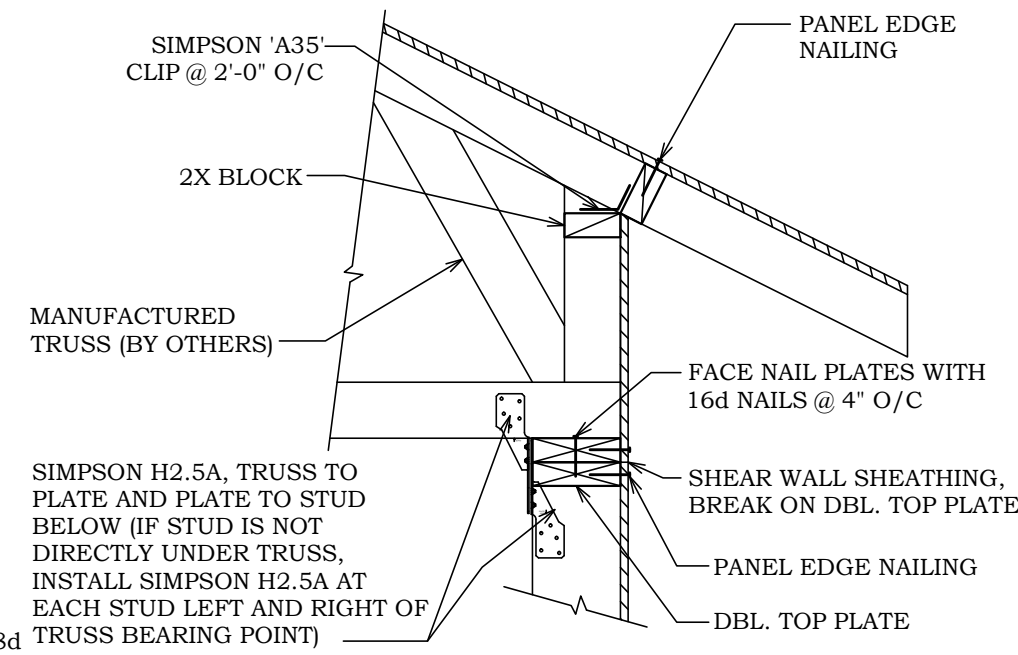

RW ROOF TO SHEAR WALL SECTION S1 RAISED HEEL OPTION

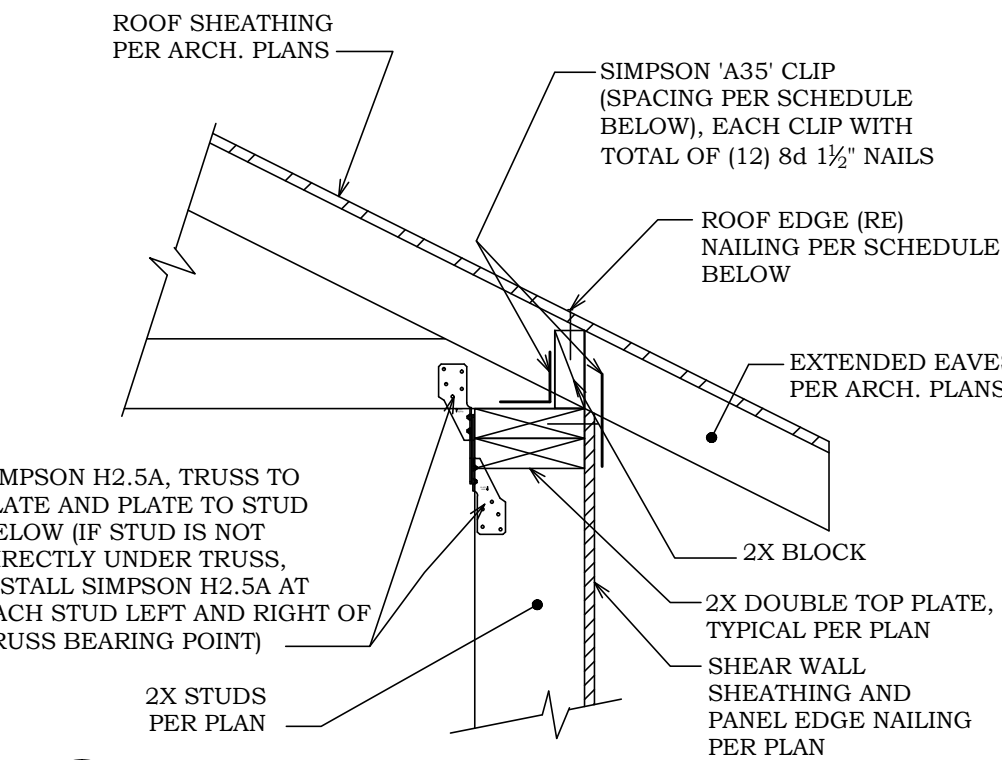

RW ROOF TO SHEAR WALL SECTION S1

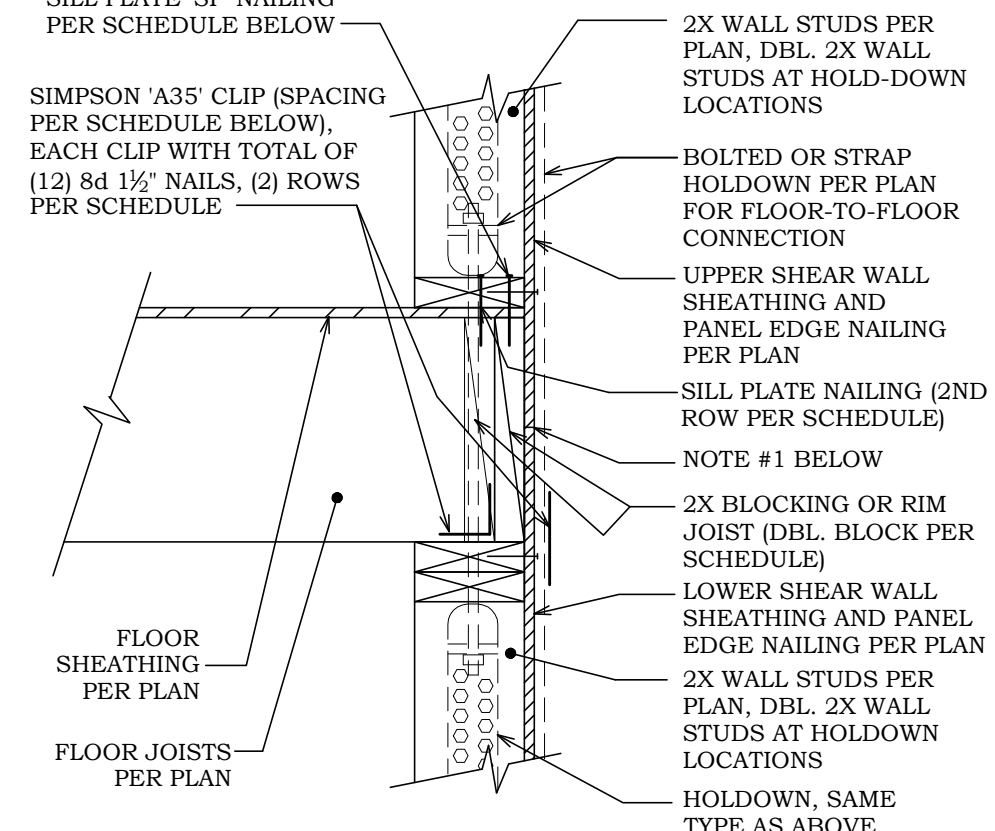

FF FLOOR TO FLOOR SECTION AT SHEAR WALL S1

NOTE: 1. IN LIEU OF CLIPS, BREAK SHEAR WALL PANELS AT BLOCKING OR RIM JOIST (INSTALL PANEL EDGE NAILING AT BREAK).

PANEL TYPE	'SP' NAIL SPACING	SIMPSON CLIP SPACING	'RE' NAIL SPACING
D6	16d @ 8" O.C.	1'-8" O.C.	8d @ 8" O.C.
D4	16d @ 4" O.C.	1'-2" O.C.	8d @ 4" O.C.
D3	16d @ 3" O.C.	0'-11" O.C.	8d @ 3" O.C.
D2	16d @ 3" O.C.	8" O.C.	8d @ 2 1/2" O.C.
E2	16d @ 2" O.C.	7" O.C.	8d @ 2" O.C.
D3X2	16d @ 3" O.C. (2) ROWS	1'-0" O.C. (2) ROWS	8d @ 3" O.C. (2) ROWS
D2X2	16d @ 2" O.C. (2) ROWS	10" O.C. (2) ROWS	8d @ 2" O.C. (2) ROWS

FOOTING	SCHEDULE	REINFORCING BARS	CAPACITY
F1	2'-0"x2'-0"x8"	(2) #4 BARS EACH WAY	5500#
F2	2'-3"x2'-3"x8"	(2) #4 BARS EACH WAY	7000#
F3	2'-6"x2'-6"x8"	(3) #4 BARS EACH WAY	8600#
F4	2'-9"x2'-9"x8"	(3) #4 BARS EACH WAY	10500#
F5	3'-0"x3'-0"x8"	(3) #4 BARS EACH WAY	12500#
F6	3'-6"x3'-6"x10"	(4) #4 BARS EACH WAY	16000#
F7	4'-0"x4'-0"x1'-0"	(6) #4 BARS EACH WAY	21000#
F8	4'-6"x4'-6"x1'-0"	(6) #4 BARS EACH WAY	27000#
F9	5'-0"x5'-0"x1'-0"	(7) #4 BARS EACH WAY	33750#

1/3" CLEAR FROM BOTTOM OF FOOTING

FOUNDATION NOTES

- REFER TO MAIN FLOOR SHEAR WALL PLAN FOR HOLD-DOWN SIZE.
- THIS DRAWING IS FOR LATERAL INFORMATION ONLY, REFER TO ARCHITECTURAL PLANS FOR ALL OTHER INFORMATION.
- TYPICAL PIER PAD BE 18" DIAM. X 8" CONCRETE FOOTING WITH 4X4 DFL-#2 POST. POST AND CONCRETE FOOTING TO BE SEPARATED BY ASPHALT SHINGLE.
- TYPICAL CRAWL SPACE BEAM TO BE C1: 4X8 DFL-#2. SINGLE GUSSET PLATE TO BE USED ON BOTH SIDES OF ATTACHMENT TO POST.

MATERIALS:


CONCRETE: MIN. 28-DAY CONCRETE STRENGTH = 2500 PSI.
GRADE BEAMS, PIERS, AND SPREAD FOOTINGS SHALL BE POURED ONTO UNDISTURBED, NATIVE SOIL WHICH IS FREE FROM ANY MATERIAL THAT WILL ADVERSELY AFFECT THE SOIL DESIGN BEARING PRESSURE REFERENCED ABOVE. ALL NON-STRUCTURAL WEATHER PROOFING AND FINISH MATERIAL TO BE DETERMINED BY OTHERS.

SLAB CONTROL JOINTS: PER OWNERS REQUIREMENTS OR DIRECTION:

MISC. SITE PREPARATIONS:


OBTAIN AND OBEY ALL APPLICABLE REGULATIONS REGARDING GRADING AND EXCAVATION. IDENTIFY, MARK, AND PROTECT FROM DAMAGE ALL EXISTING UNDERGROUND PIPES, CONDUITS, AND CABLE (WATER SUPPLY, SANITARY SEWER, STORM SEWER, GAS, STEAM, ELECTRICAL AND COMMUNICATION CABLE). REMOVE SOIL WITH ORGANIC MATTER. PERFORM BACKFILL AND COMPACTION IN A SYSTEMATIC PATTERN, TO ASSURE COMPLETE AND CONSISTENT WORK. IF ANY OVER-EXCAVATION ACCIDENTALLY OCCURS, CORRECT IT WITH WELL-COMPACTED BACKFILL. PROVIDE TESTING AND INSPECTION OF BACKFILL AND COMPACTION. LAYER BACKFILL IN 6 IN. TO 12 IN. INCREMENTS. COMPACT ALL FILL. USE STABILIZED FILL MATERIAL OF AN APPROVED TYPE AND FROM AN APPROVED SOURCE. TEST AND APPROVE MATERIAL DELIVERED FROM OTHER SITES. DO NOT ALLOW ANY DEBRIS TO BE MIXED WITH FILL. CURE CONCRETE TO FULL REQUIRED STRENGTH BEFORE BACKFILLING. PROVIDE DRAINAGE CATCHERS PER ARCHITECTURAL DRAWINGS.

SPECIAL INSPECTION: NONE

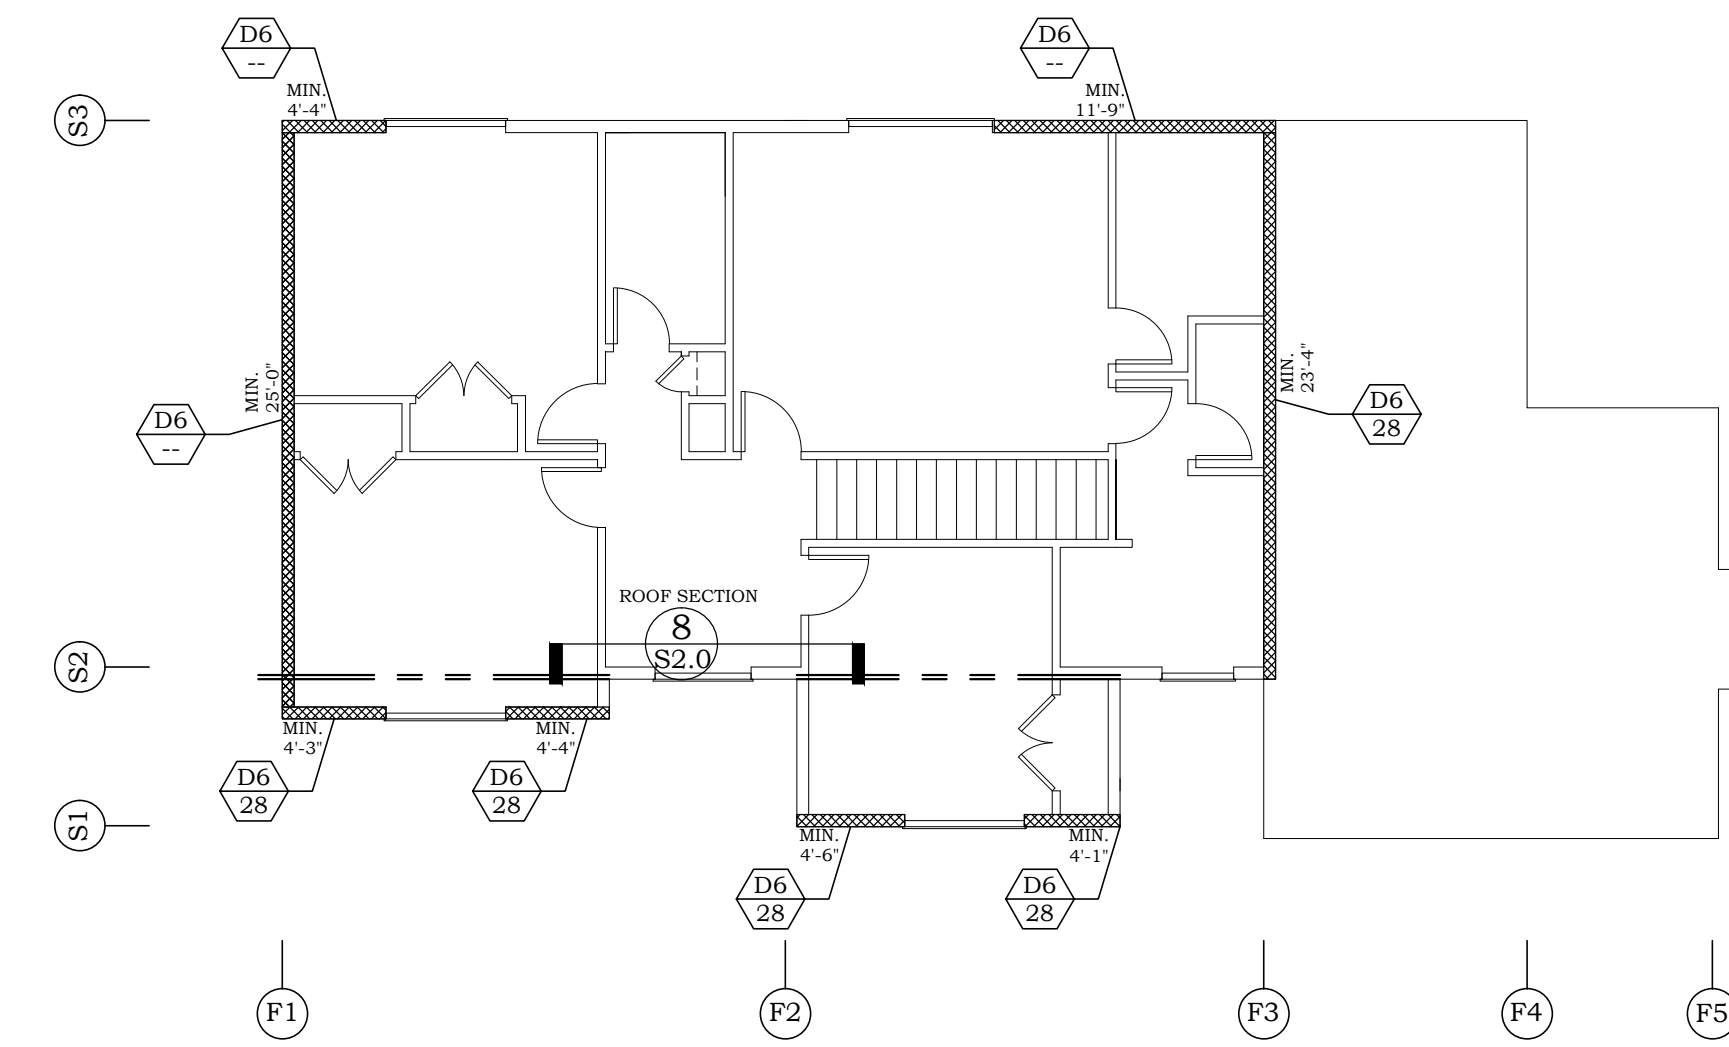


UPPER FLOOR SHEARWALL PLAN

NOTE: 1. REFER TO FRAMING REQUIREMENTS FOR TYPICAL EXTERIOR SHEATHING AND NAILING, ROOF SHEATHING AND NAILING AND FLOOR SHEATHING AND NAILING REQUIREMENTS.

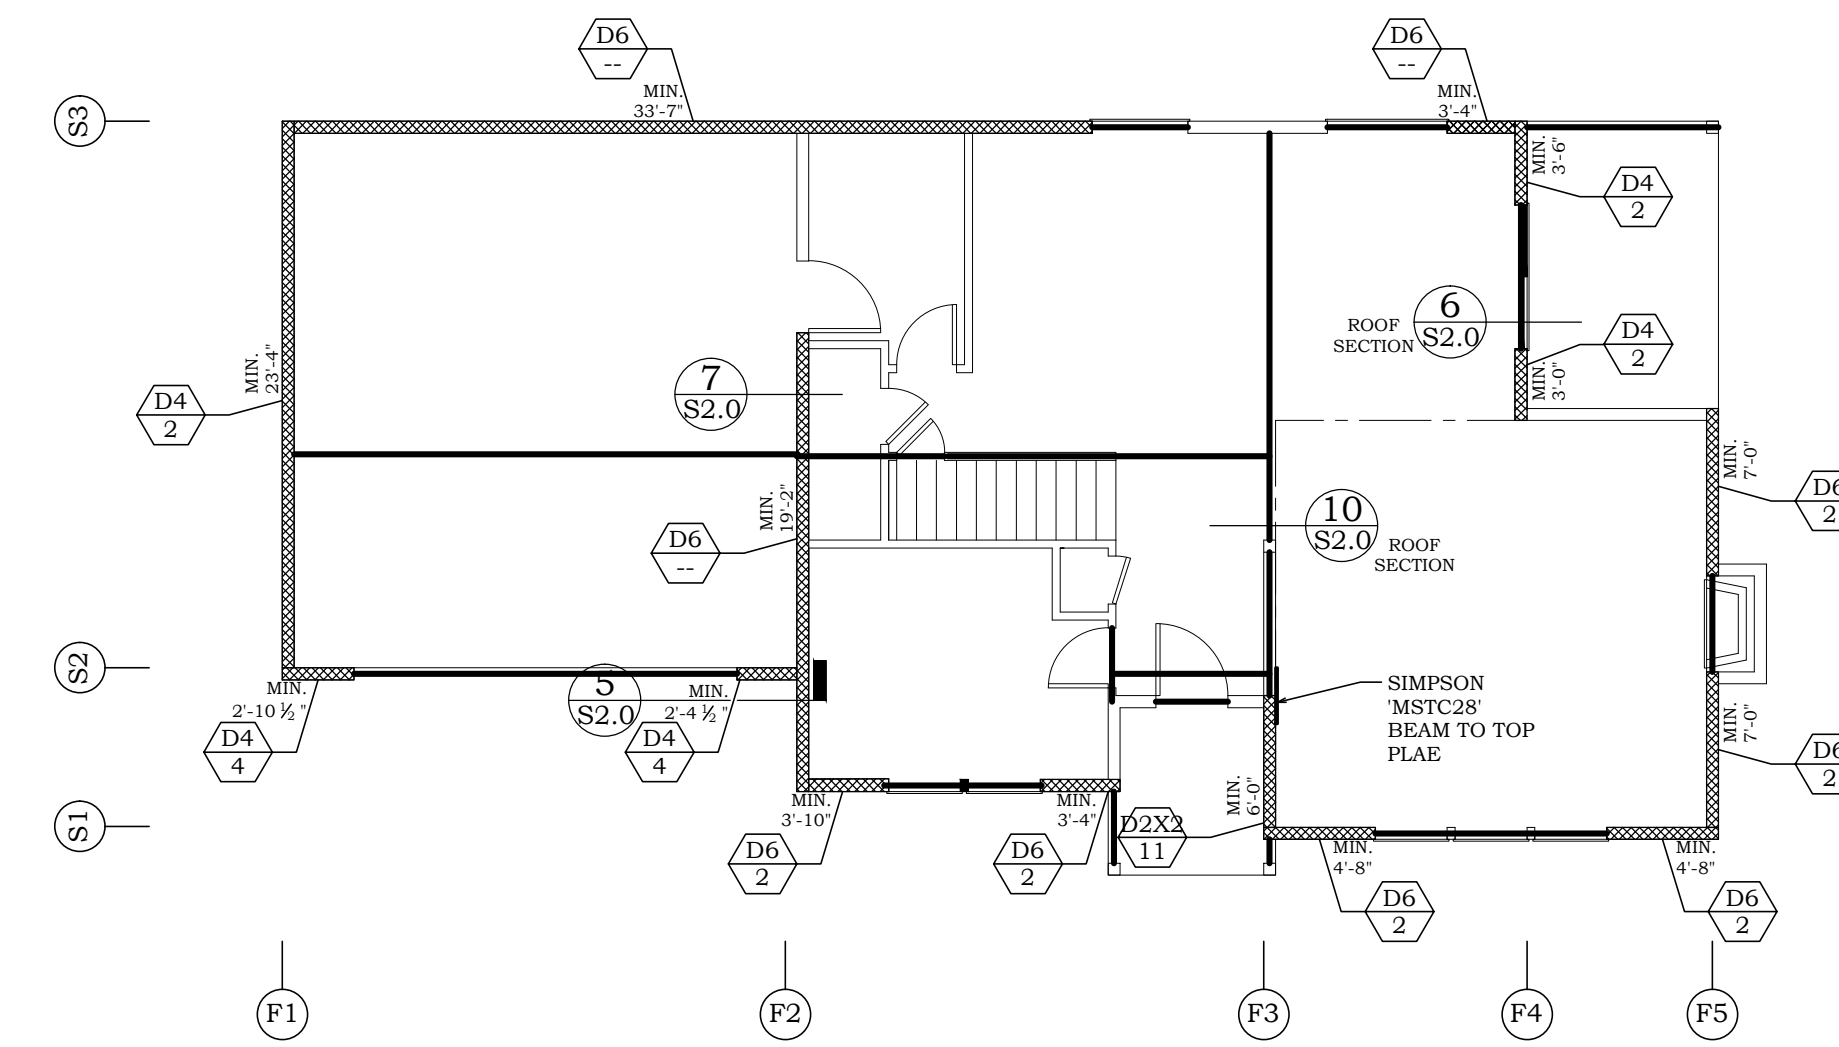

MAIN FLOOR SHEARWALL PLAN

NOTE: 1. REFER TO FRAMING REQUIREMENTS FOR TYPICAL EXTERIOR SHEATHING AND NAILING, ROOF SHEATHING AND NAILING AND FLOOR SHEATHING AND NAILING REQUIREMENTS.

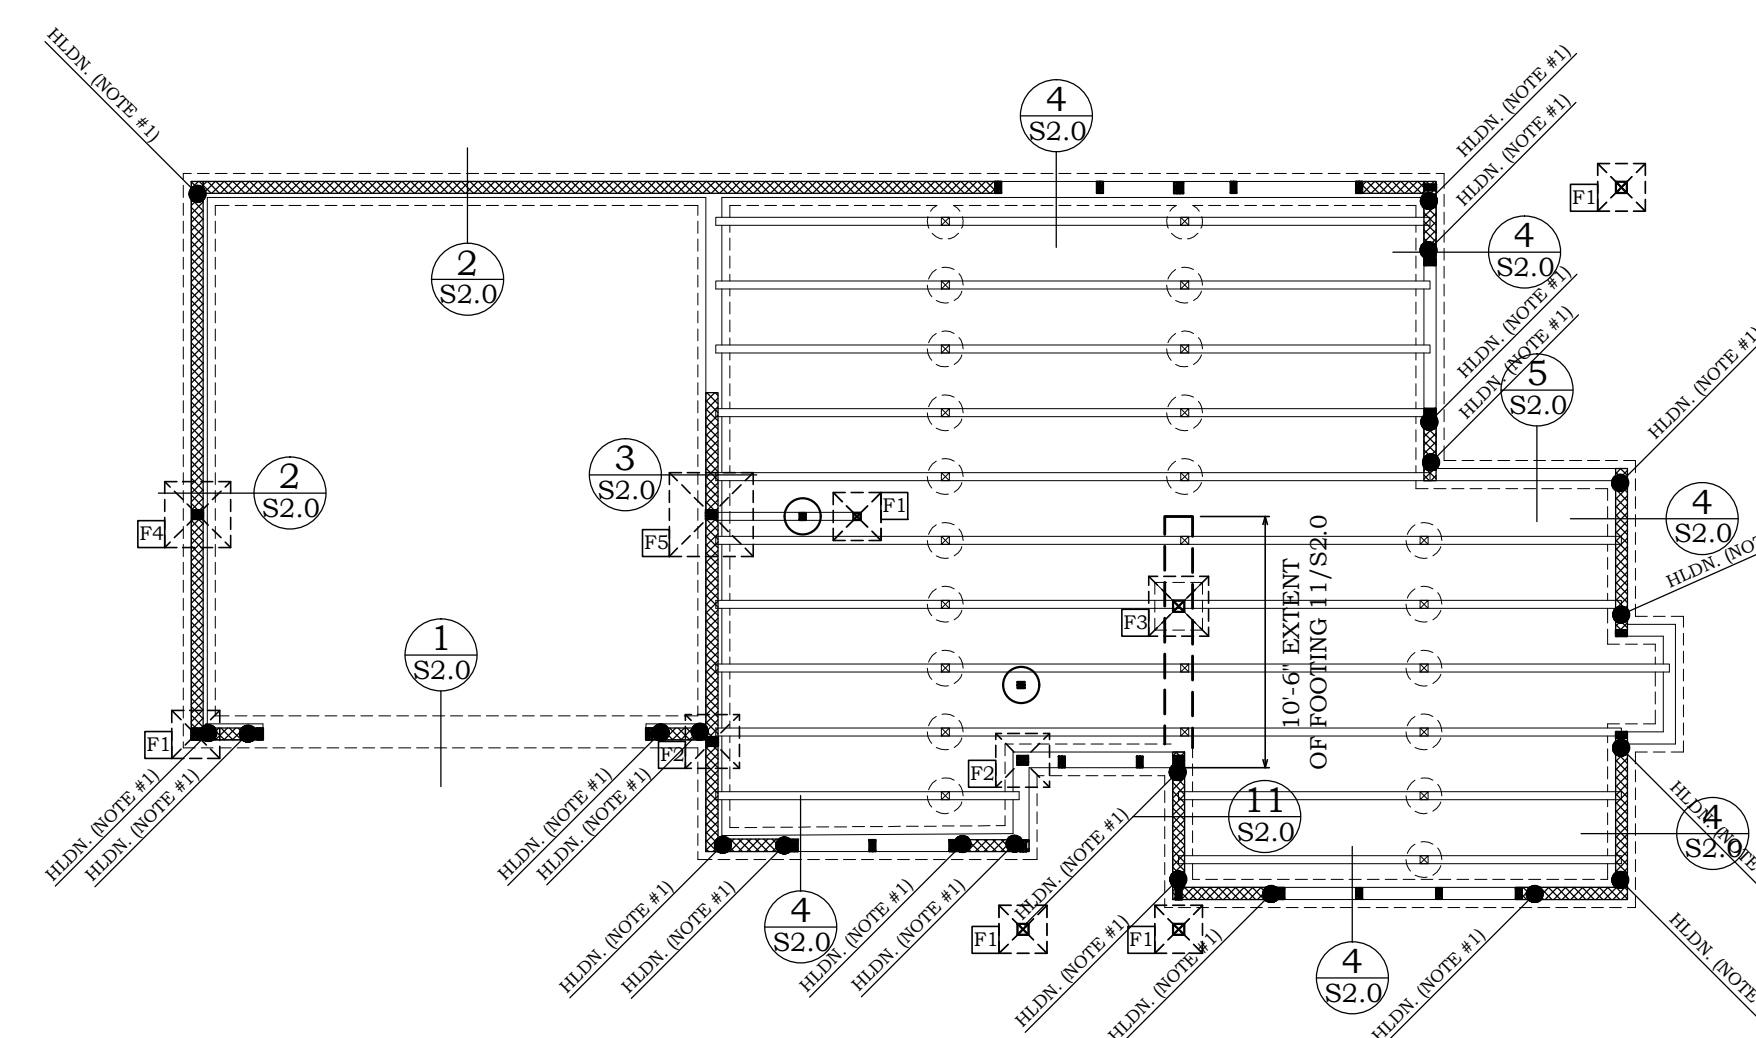

PARTIAL FOUNDATION PLAN

PANEL NOTATION	SHEATHING THICKNESS (IN.)	NAILS/SPACING	DBL. STUD CONN. (FACE NAIL)	SILL BOLT ⁽⁵⁾ SPACING	SDPWS TABLE 6.3.A	
					SHEAR CAPACITY (SEISMIC)	SHEAR CAPACITY (WIND)
D6	1 1/2" ⁽⁶⁾	8d @ 6" O/C	16d @ 9" O/C	1/2" @ 36" O/C	260 PLF	365 PLF
D4 ⁽³⁾	1 1/2" ⁽⁶⁾	8d @ 4" O/C	16d @ 6" O/C	1/2" @ 24" O/C	380 PLF	532 PLF
D3 ⁽³⁾	1 1/2" ⁽⁶⁾	8d @ 3" O/C	16d @ 4" O/C	1/2" @ 18" O/C	490 PLF	685 PLF
D2 ⁽³⁾	1 1/2" ⁽⁶⁾	8d @ 2" O/C	16d @ 3" O/C	1/2" @ 16" O/C	640 PLF	895 PLF
E2 ⁽⁶⁾	1 1/2" ⁽⁶⁾	10d @ 2" O/C	N/A	1/2" @ 14" O/C ⁽⁶⁾	770 PLF	1077 PLF
D3X2 ⁽⁶⁾⁽⁷⁾	1 1/2" EACH FACE (2) ROWS	8d @ 3" O/C	N/A	1/2" @ 12" O/C	980 PLF	1370 PLF
D2X2 ⁽⁶⁾⁽⁷⁾	1 1/2" EACH FACE (2) ROWS	8d @ 2" O/C	N/A	1/2" @ 9" O/C	1280 PLF	1790 PLF



- NOTES:**
- (1) SHEATHING TO BE APA RATED SHEATHING OR OSB (GRADE C-C OR C-D STRUCTURAL II OR BETTER).
 - (2) ALL PANEL EDGES TO BE BACKED WITH 2-INCH NOMINAL OR WIDER FRAMING (DFL-#2). INSTALL PANELS EITHER HORIZONTALLY OR VERTICALLY. SPACE NAILS MAXIMUM 6" O.C. ALONG PANEL EDGES FOR STUDS SPACED 24" O.C. FOR OTHER CONDITIONS AND PANEL THICKNESSES, SPACE NAILS MAXIMUM 12" O.C. ON INTERMEDIATE SUPPORTS.
 - (3) FRAMING AT ADJOINING PANEL EDGES SHALL BE A SINGLE 2" NOMINAL MEMBER OR 2" INCH NOMINAL MEMBER FASTENED TOGETHER WITH 16d NAILS (SPACING ABOVE) TYPICAL ENTIRE HEIGHT OF DBL. STUD. NAILS SHALL BE STAGGERED WHERE NAILS ARE SPACED 2" O.C.
 - (4) AT SHEAR WALL LOCATIONS, REFER RW/S1 AND FF/S1 FOR ROOF TO WALL AND FLOOR TO FLOOR FRAMING.
 - (5) INSTALL 3" SQUARE X 3/8" STEEL PLATE WASHER.
 - (6) FRAMING AT ADJOINING PANEL EDGES SHALL BE SINGLE 3X NOMINAL FRAMING MEMBERS AT EACH END OF THE PANEL. NAILS SHALL BE STAGGERED WHERE NAILS ARE SPACED 2" O.C. INSTALL MIN. 3X P.T. SILL PLATE, U.N.O.
 - (7) PLYWOOD TO BE INSTALLED ON BOTH SIDES OF PANEL.
 - (8) IF 1/2" NOMINAL THICK PLYWOOD OR OSB IS USED, STUDS TO BE SPACED AT 1'-4" O.C. TYPICAL.
 - (9) GALVANIZED NAILS SHALL BE HOT-DIPPED OR TUMBLED.

HOLD-DOWN SCHEDULE:

HOLD-DOWN NOTATION	'SIMPSON' HOLD-DOWN TYPE	INSTALLATION INSTRUCTIONS
2	H DU2 (3075#)	STD. SB 3/4 X 24 MIN. 18" EMBEDMENT (6) CONCRETE. ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF (2)2X6 DFL-#2 WALL STUDS (MIN. 2X" EDGE DISTANCE). FASTEN STUDS TOGETHER WITH 16d NAILS @ 6" O/C ENTIRE HEIGHT OF STUD. INSTALL HOLD-DOWN PER MANUFACTURER'S SPECIFICATIONS.
4	H DU4 (4565#)	STD. SB 3/4 X 24 MIN. 18" EMBEDMENT (6) CONCRETE. ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF (2)2X6 DFL-#2 WALL STUDS (MIN. 2X" EDGE DISTANCE). FASTEN STUDS TOGETHER WITH 16d NAILS @ 6" O/C ENTIRE HEIGHT OF STUD. INSTALL HOLD-DOWN PER MANUFACTURER'S SPECIFICATIONS.
5	H DU5 (5645#)	STD. SB 3/4 X 24 MIN. 18" EMBEDMENT (6) CONCRETE. ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF (2)2X6 DFL-#2 WALL STUDS (MIN. 2X" EDGE DISTANCE). FASTEN STUDS TOGETHER WITH 16d NAILS @ 6" O/C ENTIRE HEIGHT OF STUD. INSTALL HOLD-DOWN PER MANUFACTURER'S SPECIFICATIONS.
8	H DU8 (5980# 6970# 7870#)	STD. SB 3/4 X 24 MIN. 18" EMBEDMENT (6) CONCRETE. ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF (2)2X6 DFL-#2 WALL STUDS (MIN. 2X" EDGE DISTANCE). FASTEN STUDS TOGETHER WITH 16d NAILS @ 6" O/C ENTIRE HEIGHT OF STUD. INSTALL HOLD-DOWN PER MANUFACTURER'S SPECIFICATIONS.
11	H DU11 (9535#)	STD. 1" O ANCHOR BOLT OR ALTERNATIVE TO BE EMBEDDED INTO CONCRETE FOOTING (MIN. 12"). ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF 6X6 DFL-#2 (MIN. 2X" EDGE DISTANCE). INSTALL HOLD-DOWN PER MANUFACTURER'S SPECIFICATIONS.
14	H DU14 (14445#)	STD. 1" O ANCHOR BOLT OR ALTERNATIVE TO BE EMBEDDED INTO CONCRETE FOOTING (PER 2/S1). ANCHOR TO BE INSTALLED PLUMB AND LOCATED ALONG CENTER LINE OF 6X6 DFL-#2 (MIN. 2X" EDGE DISTANCE). INSTALL HOLD-DOWN PER MANUFACTURER'S SPECIFICATIONS.
28	MSTC28	INSTALL STRAP ACROSS FLOOR LINE. INSTALL MIN. (8) 16d NAILS INTO DOUBLE WALL STUDS ABOVE FLOOR AND INTO DOUBLE WALL STUDS BELOW. CENTER STRAP ON STUDS TO INSTALL NAILS INTO MIDDLE THIRD OF STUD.
40	MSTC40	INSTALL STRAP ACROSS FLOOR LINE. INSTALL MIN. (16) 16d NAILS INTO DOUBLE WALL STUDS ABOVE FLOOR AND INTO DOUBLE WALL STUDS BELOW. CENTER STRAP ON STUDS TO INSTALL NAILS INTO MIDDLE THIRD OF STUD.
52	MSTC52	INSTALL STRAP ACROSS FLOOR LINE. INSTALL MIN. (24) 16d NAILS INTO DOUBLE WALL STUDS ABOVE FLOOR AND INTO DOUBLE WALL STUDS BELOW. CENTER STRAP ON STUDS TO INSTALL NAILS INTO MIDDLE THIRD OF STUD.
66	MSTC66	INSTALL STRAP ACROSS FLOOR LINE. INSTALL MIN. (34) 16d NAILS INTO DOUBLE WALL STUDS ABOVE FLOOR AND INTO DOUBLE WALL STUDS BELOW. CENTER STRAP ON STUDS TO INSTALL NAILS INTO MIDDLE THIRD OF STUD.

- NOTES:**
- (1) IN LIEU OF SIMPSON SSTB BOLTS ANCHOR BOLTS TO BE A307 OR A308 THEREADED ROD WITH STD. NUT AND 2" X 2" X 3/4" STEEL PLATE WASHER ON BOTTOM OF BOLT.
 - (2) HOLD-DOWNS TO BE FASTENED TO DOUBLE STUDS CONTINUOUS FROM SILL PLATE TO DOUBLE TOP PLATE AT PANEL ENDS. WALL STUDS SHOULD BE PANEL EDGE NAILING FROM SHEAR WALL SHEATHING.
 - (3) IF HOLD-DOWNS 2, 5, 6, AND 8 ARE INSTALLED FROM FLOOR TO FLOOR, REFER TO DETAIL, FF/S1.
 - (4) U.N.O. INSTALL (1) #4 CONTINUOUS HORIZONTAL TOP BAR 3" FROM TOP OF WALL AT ALL HOLD-DOWN ANCHORS. EXTEND BAR MIN. 5'-0" PAST HOLD-DOWN IN BOTH DIRECTIONS (BEND BAR AROUND AT CORNER CONDITION). FOR THIS 10'-0" SECTION INSTALL (1) #4 VERTICAL BAR AT 24" O.C. THE HOLD-DOWN ANCHOR TO HORIZONTAL TOP BAR.

SHEAR WALL / HOLD-DOWN NOTATION DIAGRAM

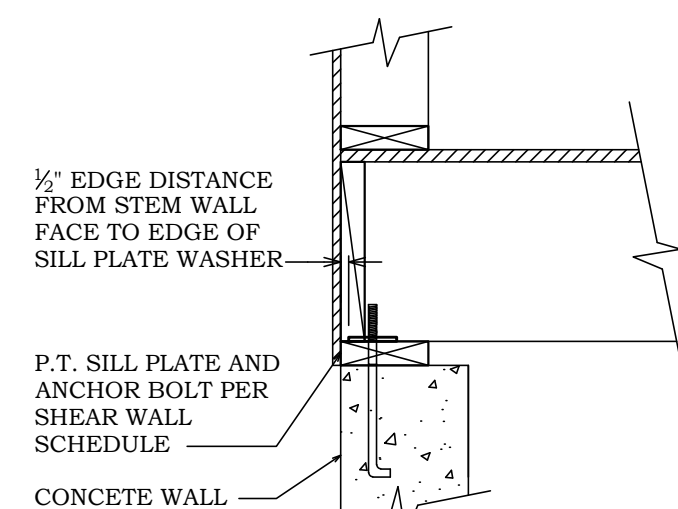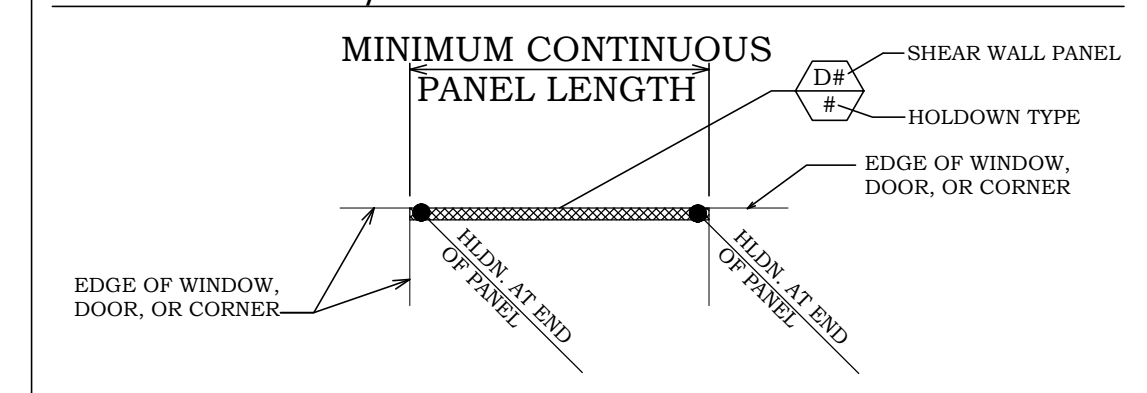

FSP FDN. SILL PLATE SECTION S1

PROJECT NAME	LOC LOT 4 SHEAR WALL AND HOLD-DOWN SCHEDULE
DESCRIPTION	
No.	
DATE	


PROJECT NAME	LOC LOT 4 SHEAR WALL AND HOLD-DOWN SCHEDULE
DESCRIPTION	
No.	
DATE	

PROJECT NAME	LOC LOT 4 SHEAR WALL AND HOLD-DOWN SCHEDULE
DESCRIPTION	
No.	
DATE	


TURNER ENGINEERING & DESIGN
 Office / Cell: (503) 970-8807
 Email: turner.tendesign@gmail.com
 1000 E. GLENN CREEK, OREGON 97022

ENGINEERS STAMP
 REGISTERED PROFESSIONAL ENGINEER
 58949PE
 Richard J. Turner
 OREGON
 JULY 15, 2009
 RICHARD J. TURNER
 EXP. DATE: 06-30-20
 ISSUE CD
 DESIGNED BY RJT
 DRAWN BY RJT
 CHECKED BY RJT
 DATE 10/31/19
 PROJECT NO. R19463
 SHEET NO. S1.0


BRACE LENGTH	BRACE SIZE	SPACING	CLIP AT TOP PLATE	# OF BLOCKS	# OF NAILS	PANEL EDGE NAILS
5 TO 8FT	(2)2X6	3'-0" O/C	SIMPSON 'GBC'	(2)	(6) EACH BLOCK	3" O/C, (2) ROWS
1 TO 5FT	2X6	4'-0" O/C	SIMPSON 'GBC'	(2)	(6) EACH BLOCK	3" O/C, (2) ROWS

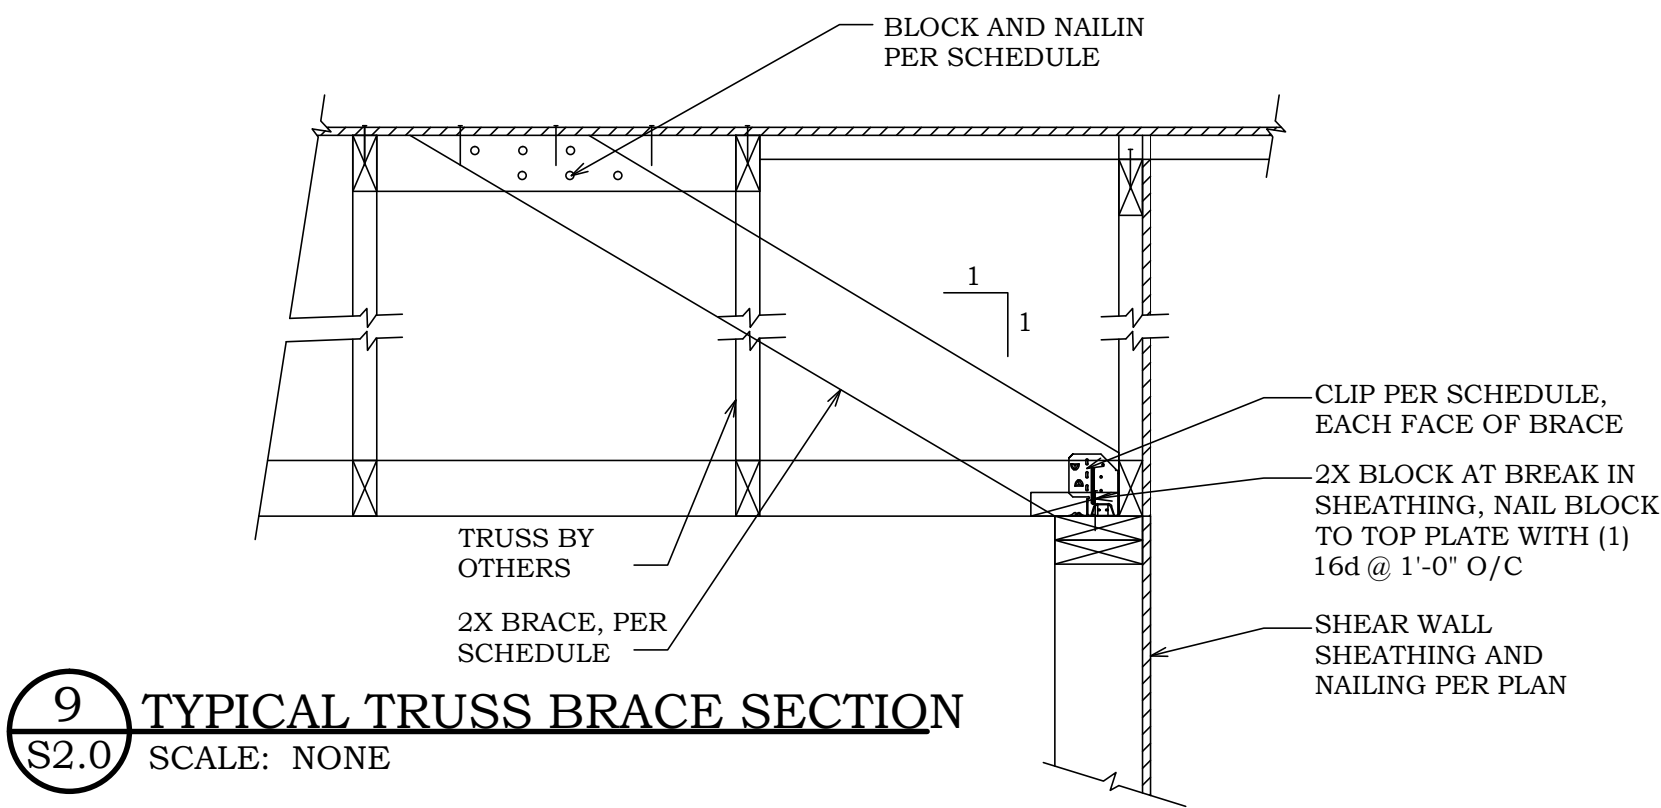


9 TYPICAL TRUSS BRACE SECTION
S2.0 SCALE: NONE

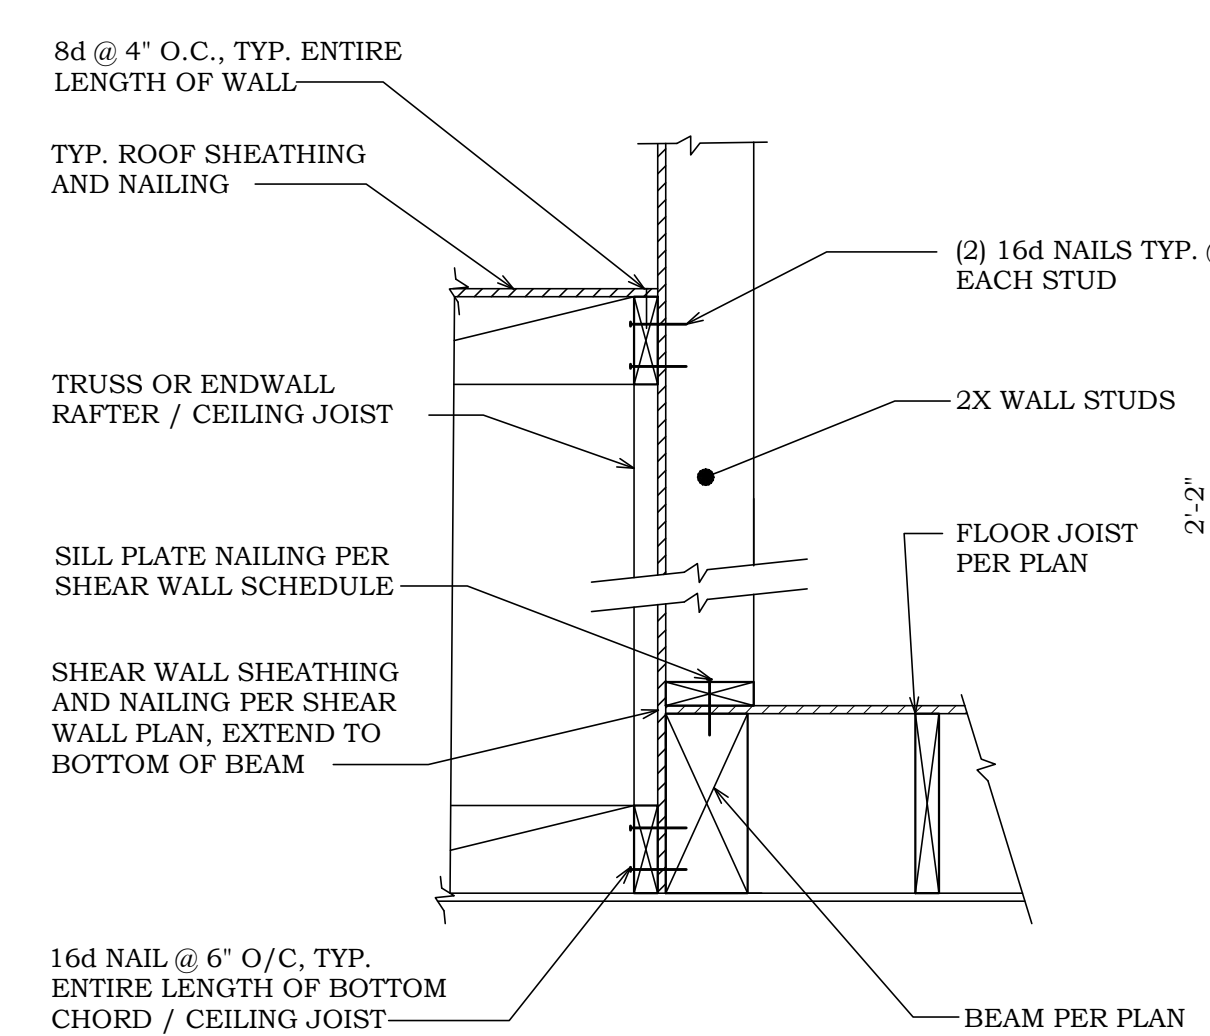


10 LOWER ROOF SECTION
S2.0 SCALE: 1" = 1'-0"

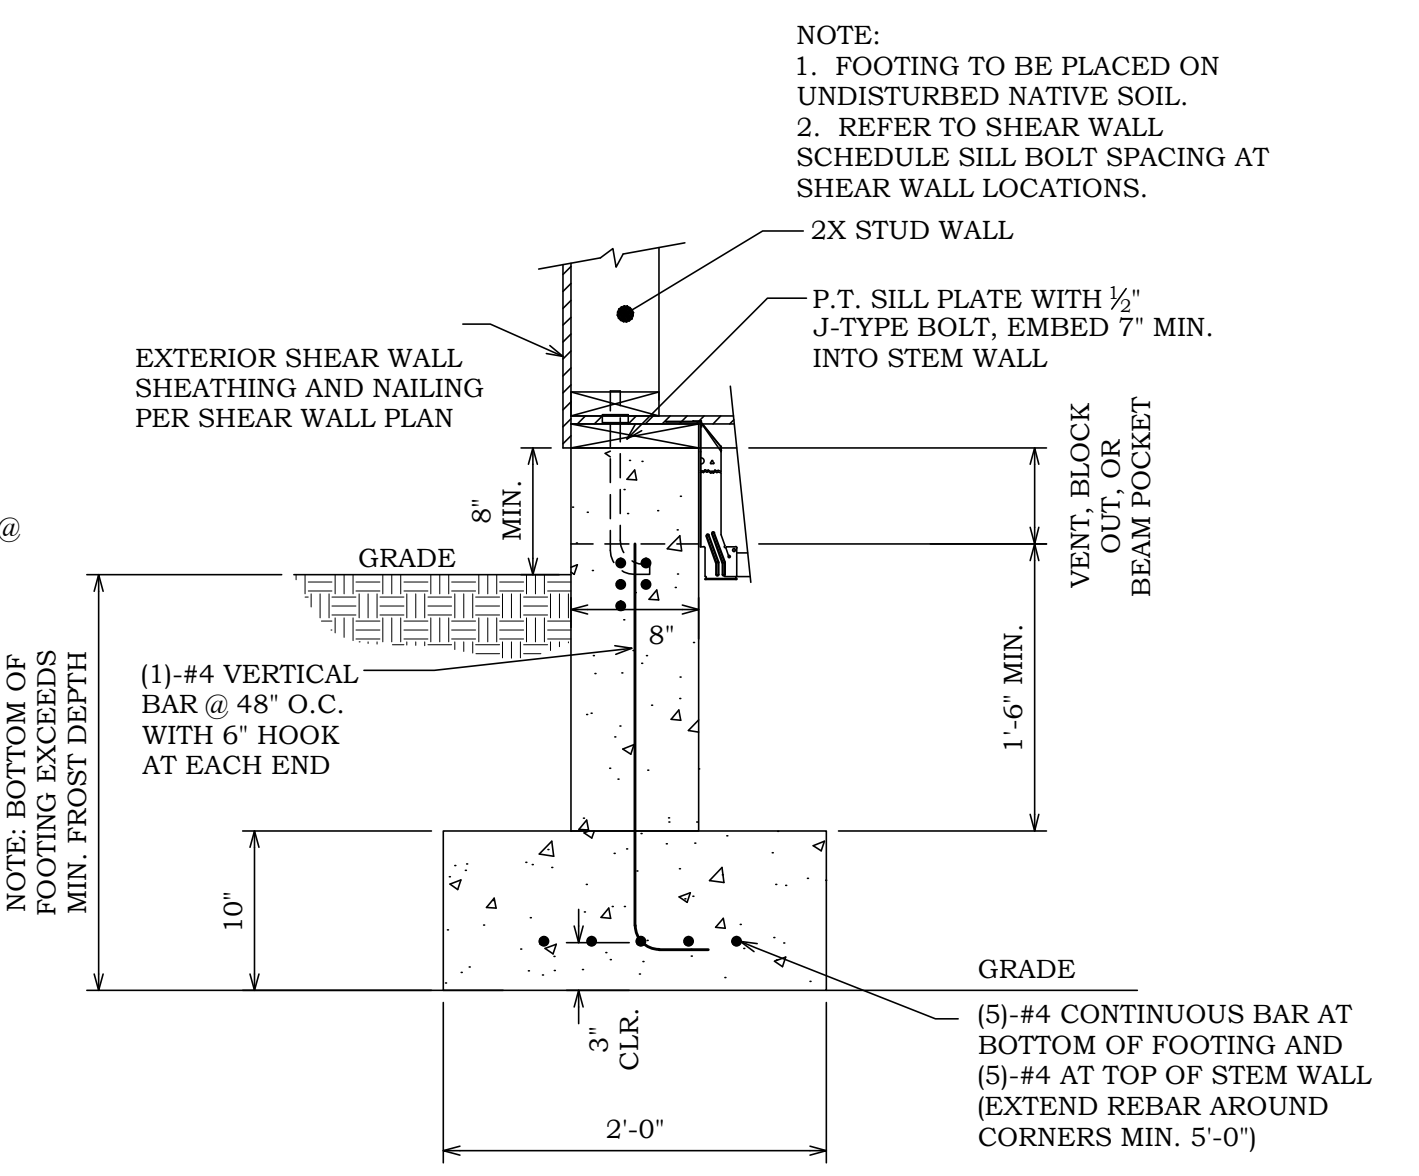


11 FOOTING SECTION
S2.0 SCALE: 1" = 1'-0"

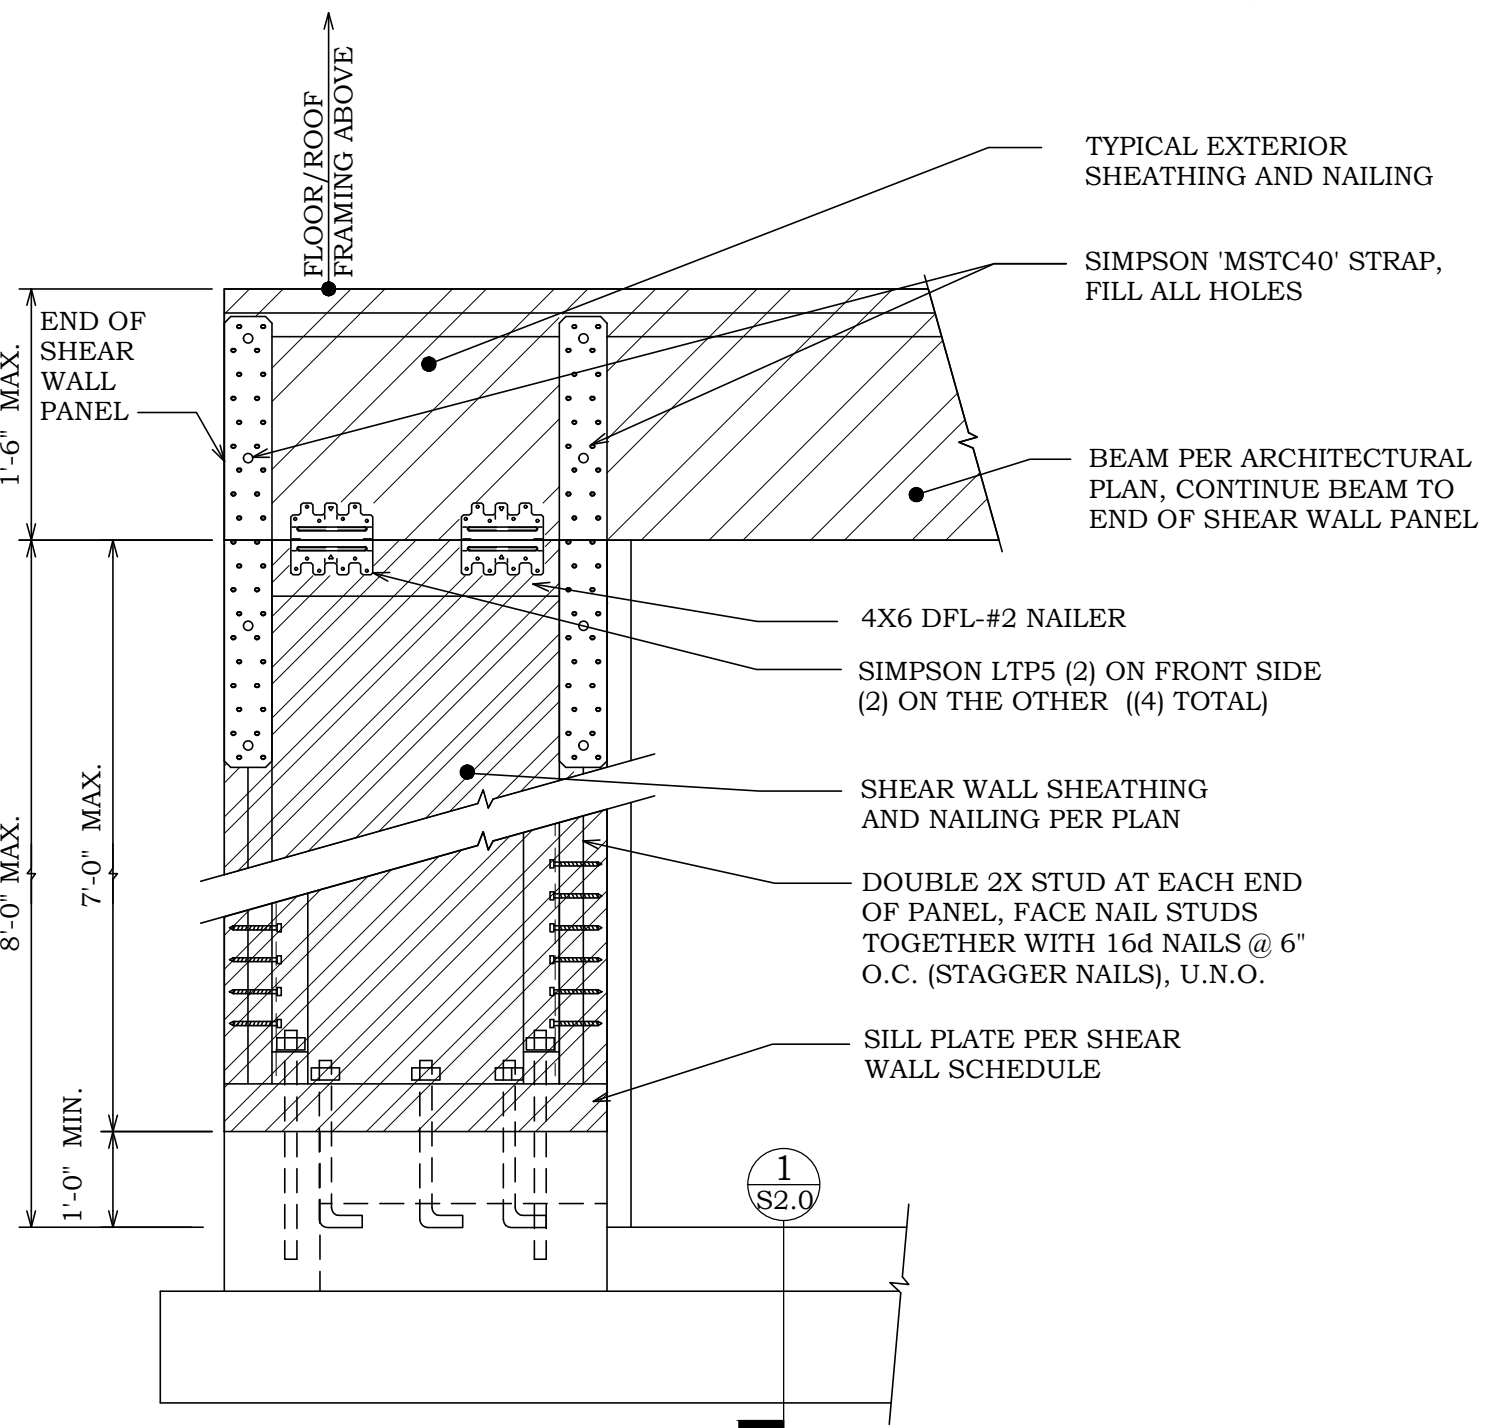


5 PORTAL FRAME ELEVATION
S2.0 SCALE: NONE

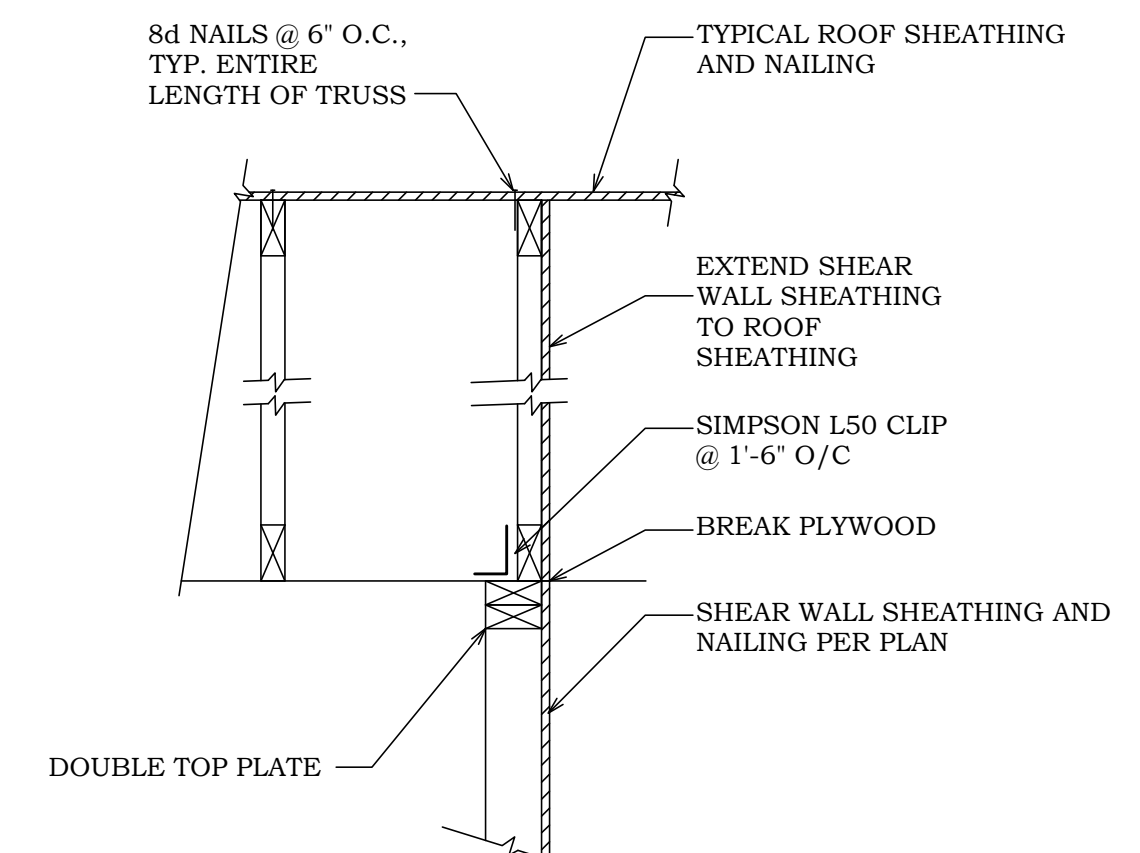


6 TRUSS TO WALL SECTION
S2.0 SCALE: NONE

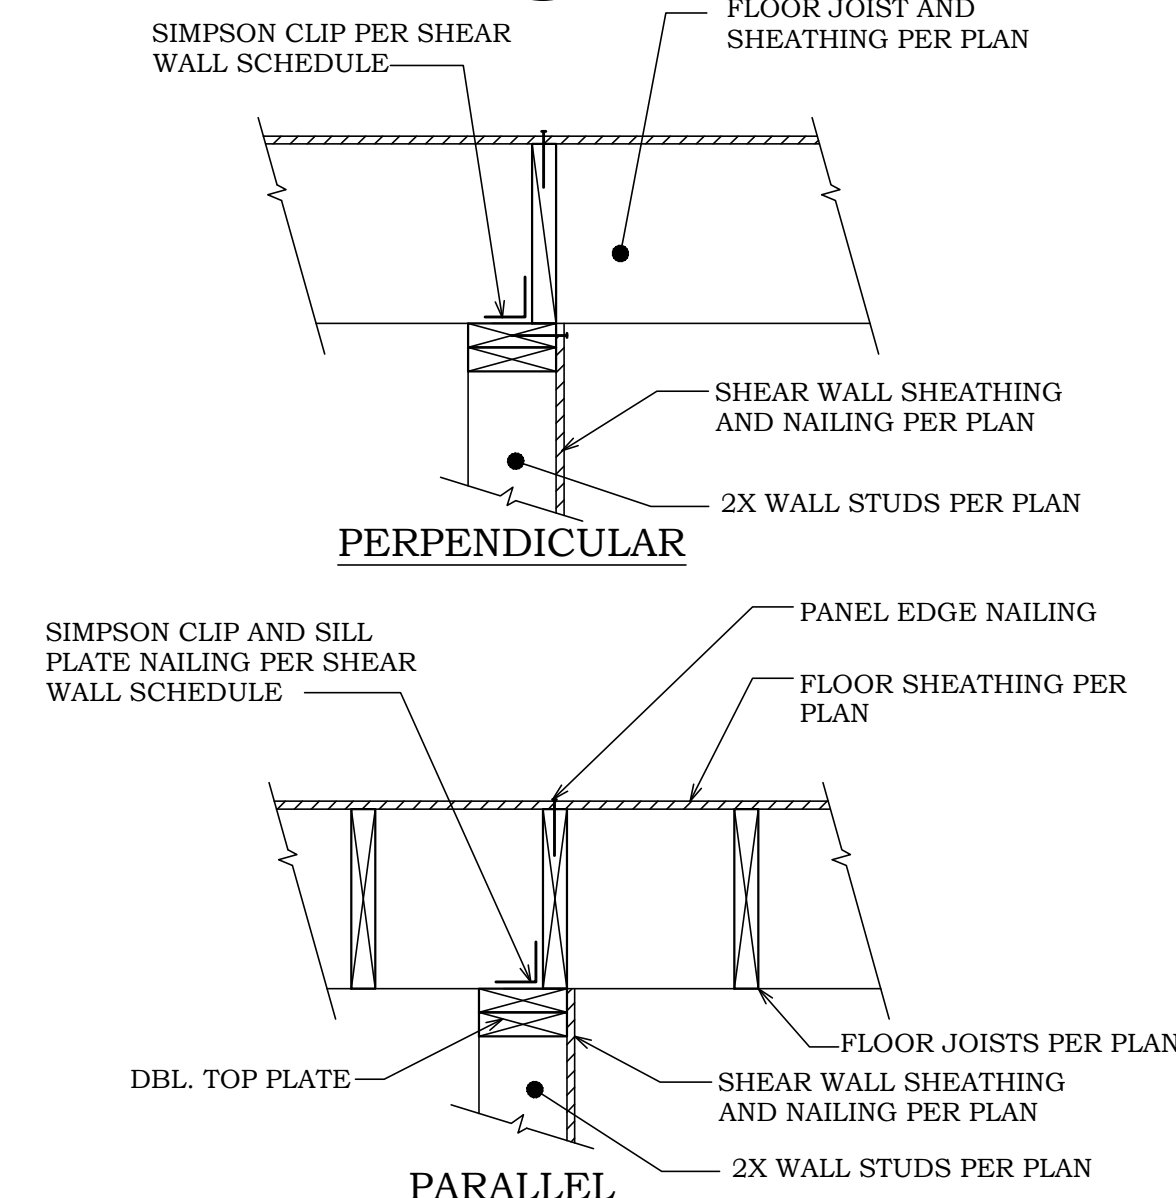


7 FLOOR SECTION
S2.0 SCALE: NONE

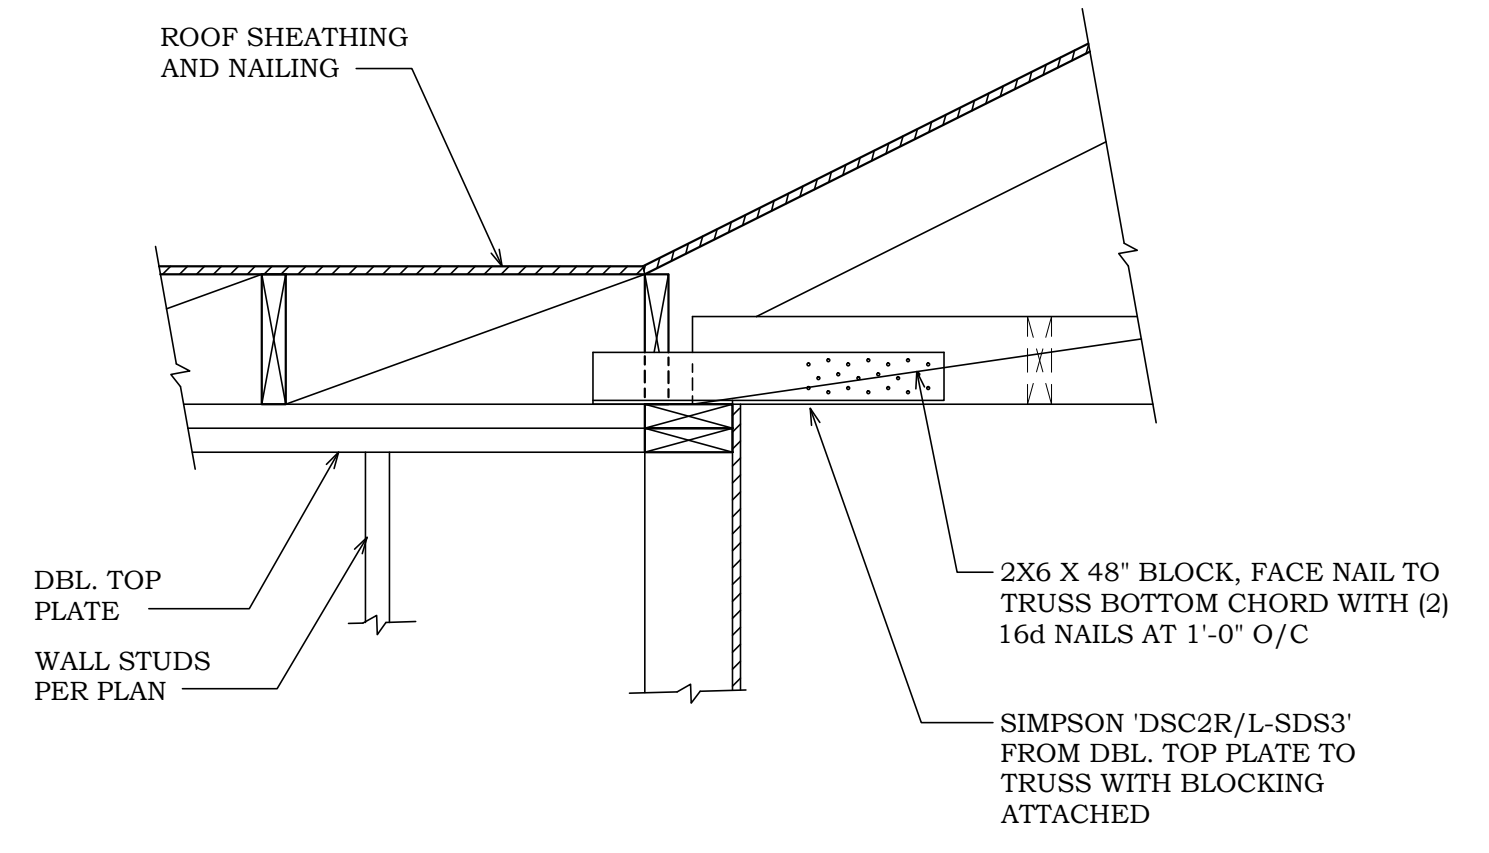


8 ROOF SECTION
S2.0 SCALE: NONE

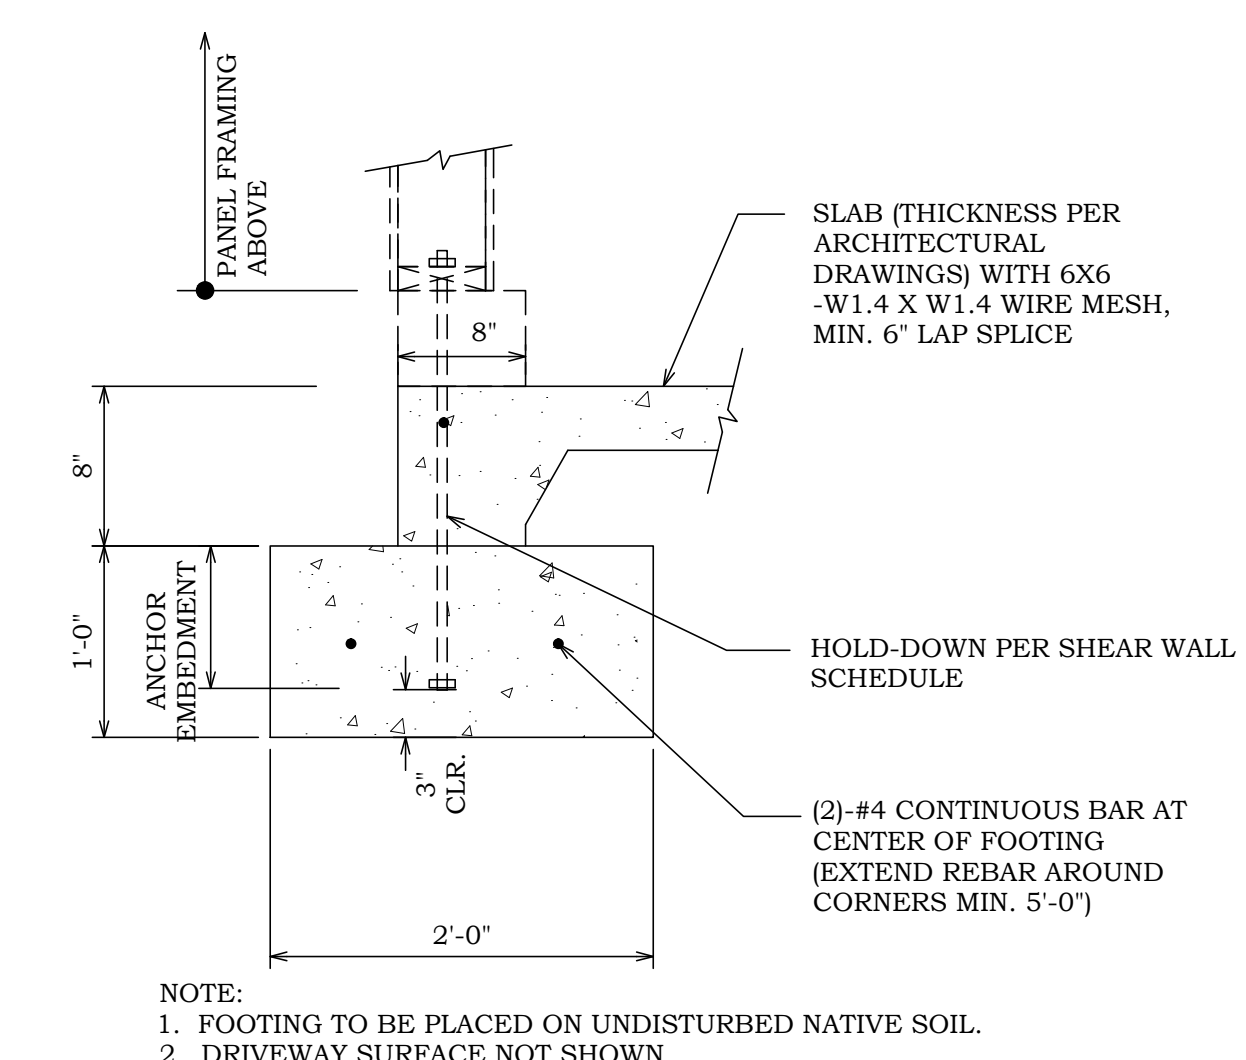


1 FOOTING SECTION
S2.0 SCALE: 1" = 1'-0"

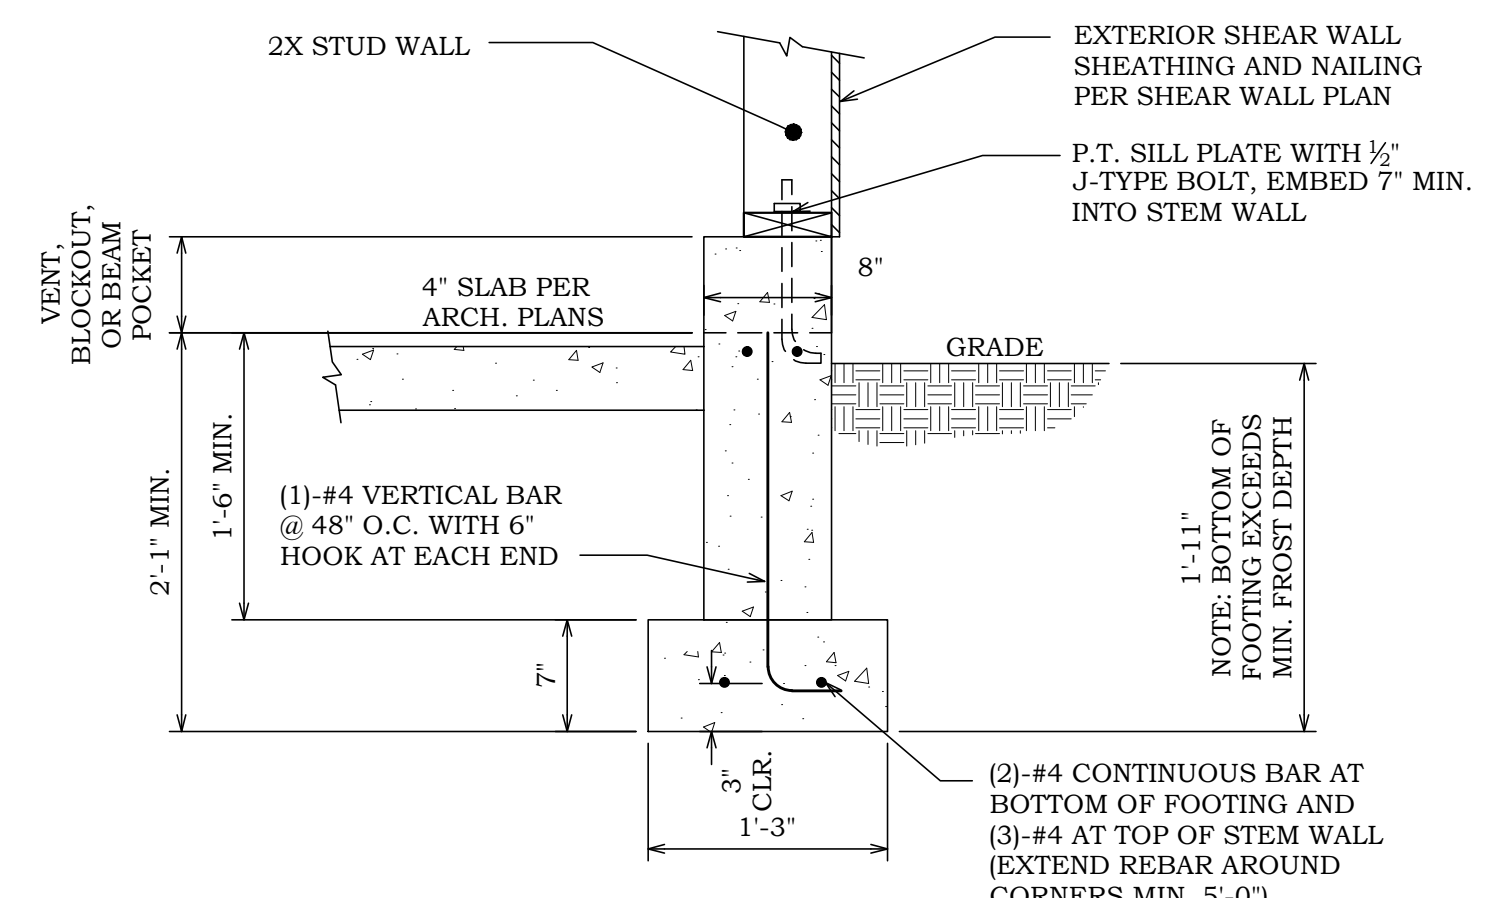

2 FOOTING SECTION
S2.0 SCALE: 1" = 1'-0"

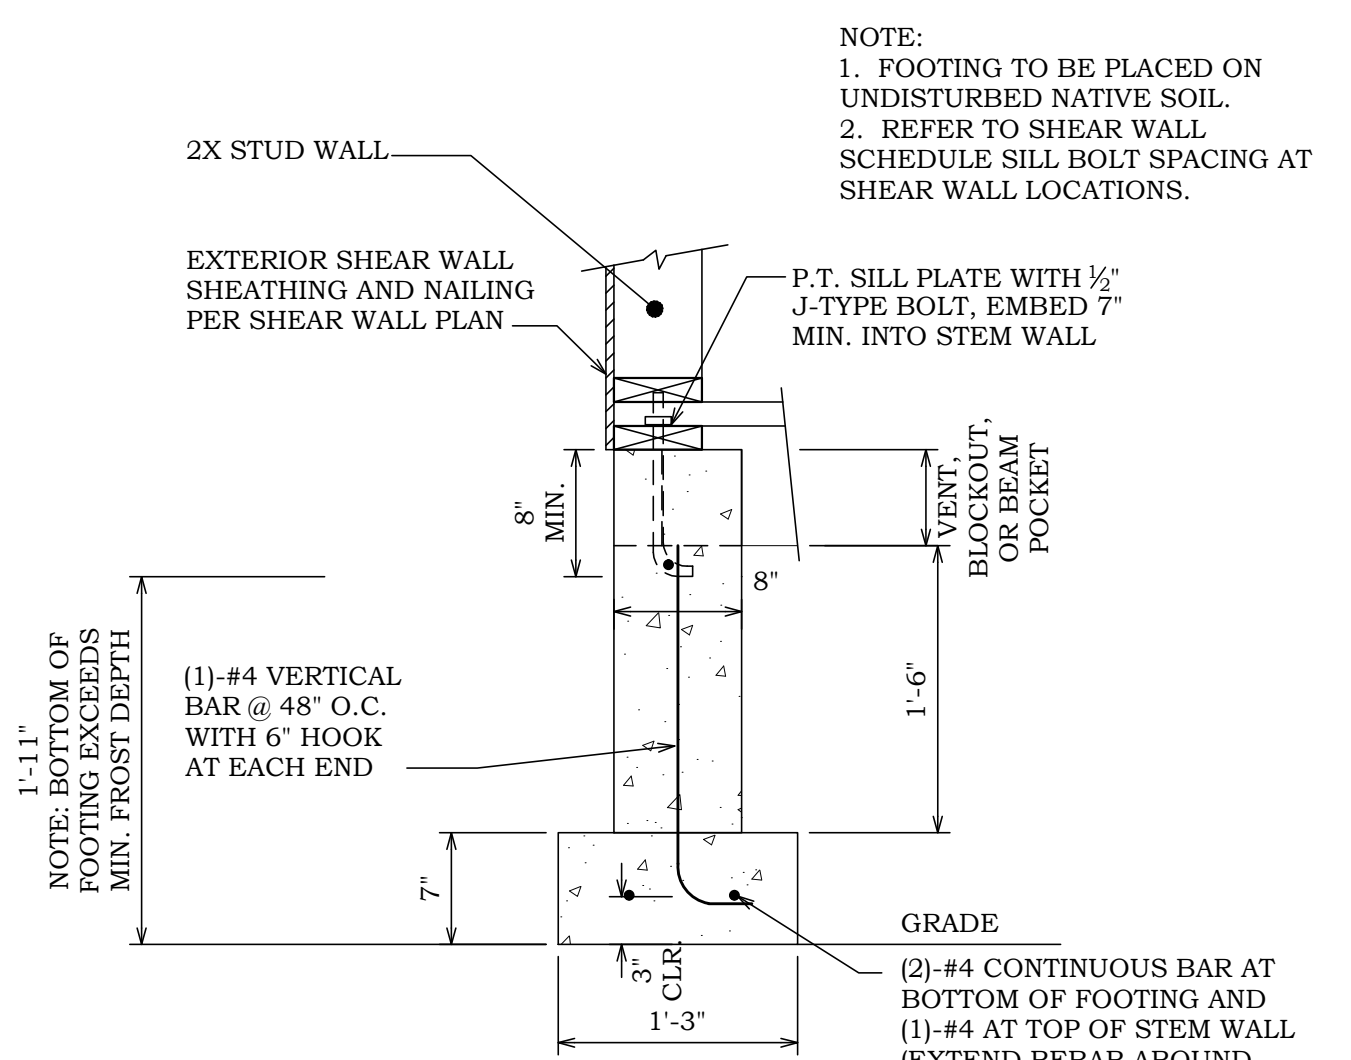

3 FOOTING SECTION
S2.0 SCALE: 1" = 1'-0"

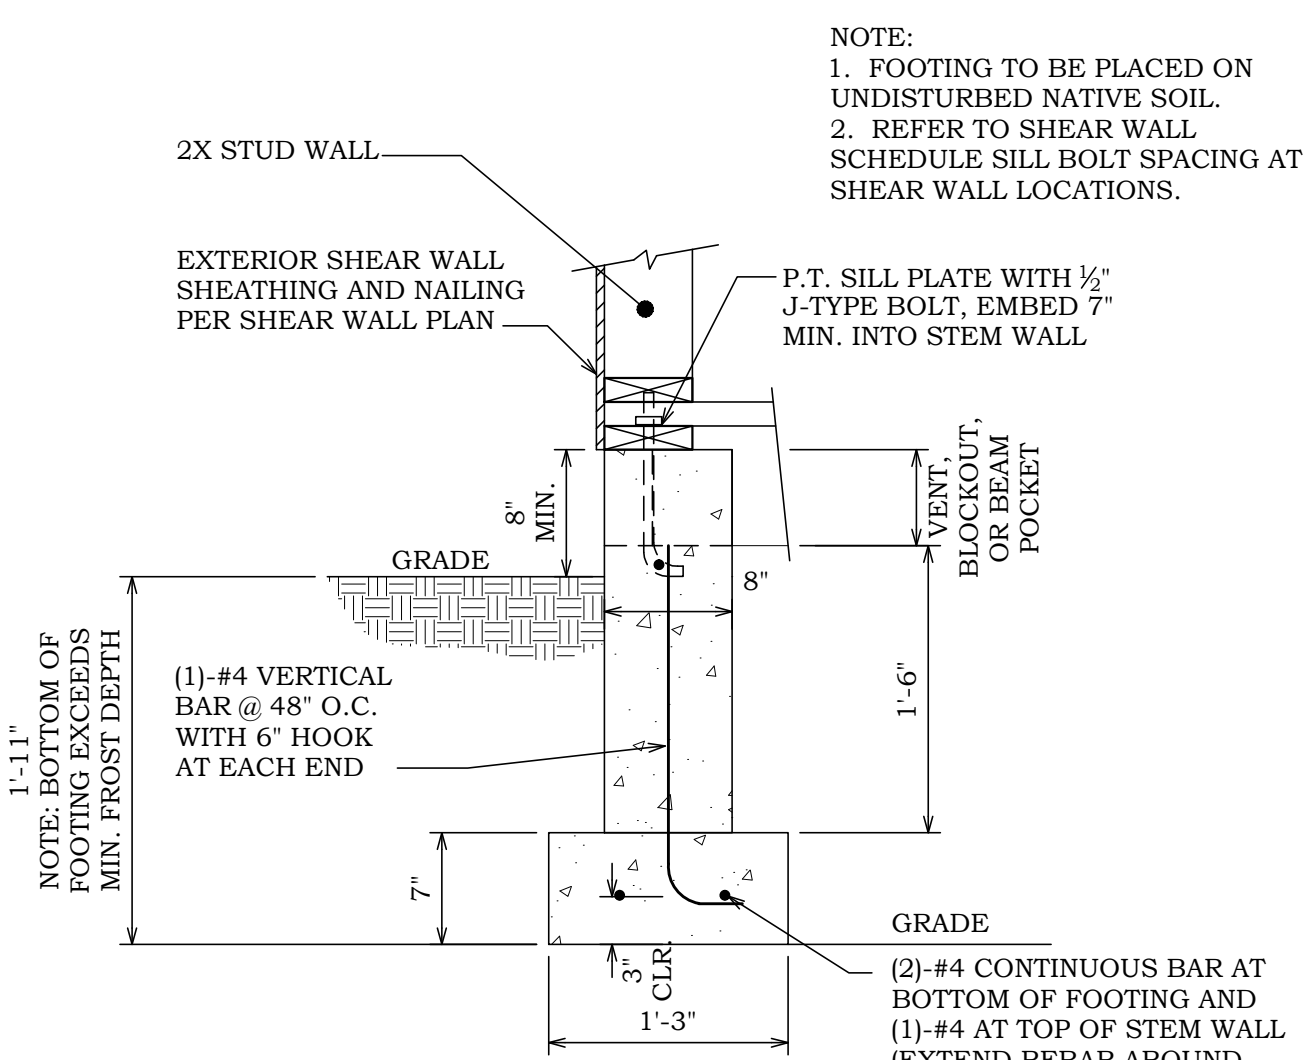

4 FOOTING SECTION
S2.0 SCALE: 1" = 1'-0"

NOTE:
1. FOOTING TO BE PLACED ON UNDISTURBED NATIVE SOIL.
2. REFER TO SHEAR WALL SCHEDULE SILL BOLT SPACING AT SHEAR WALL LOCATIONS.

NOTE:
1. FOOTING TO BE PLACED ON UNDISTURBED NATIVE SOIL.
2. REFER TO SHEAR WALL SCHEDULE SILL BOLT SPACING AT SHEAR WALL LOCATIONS.

NOTE:
1. FOOTING TO BE PLACED ON UNDISTURBED NATIVE SOIL.
2. REFER TO SHEAR WALL SCHEDULE SILL BOLT SPACING AT SHEAR WALL LOCATIONS.

NOTE:
1. FOOTING TO BE PLACED ON UNDISTURBED NATIVE SOIL.
2. REFER TO SHEAR WALL SCHEDULE SILL BOLT SPACING AT SHEAR WALL LOCATIONS.

No.	DATE	DESCRIPTION

PROJECT NAME	LOE LOT 4
STRUCTURAL DETAILS	

TURNER ENGINEERING & DESIGN
Office/Cell: (503) 979-8807
Email: turner_tdesign@gmail.com
10000 N. GARDEN
ENGLE CREEK, OREGON 97022

ENGINEERS STAMP
REGISTERED PROFESSIONAL ENGINEER
58949PE
Richard J. Turner
OREGON
JULY 15, 2009
RICHARD J. TURNER

EXP. DATE:	06-30-20
ISSUE	CD
DESIGNED BY	RJT
DRAWN BY	RJT
CHECKED BY	RJT
DATE	10/31/19
PROJECT NO.	R19463
SHEET NO.	S2.0